


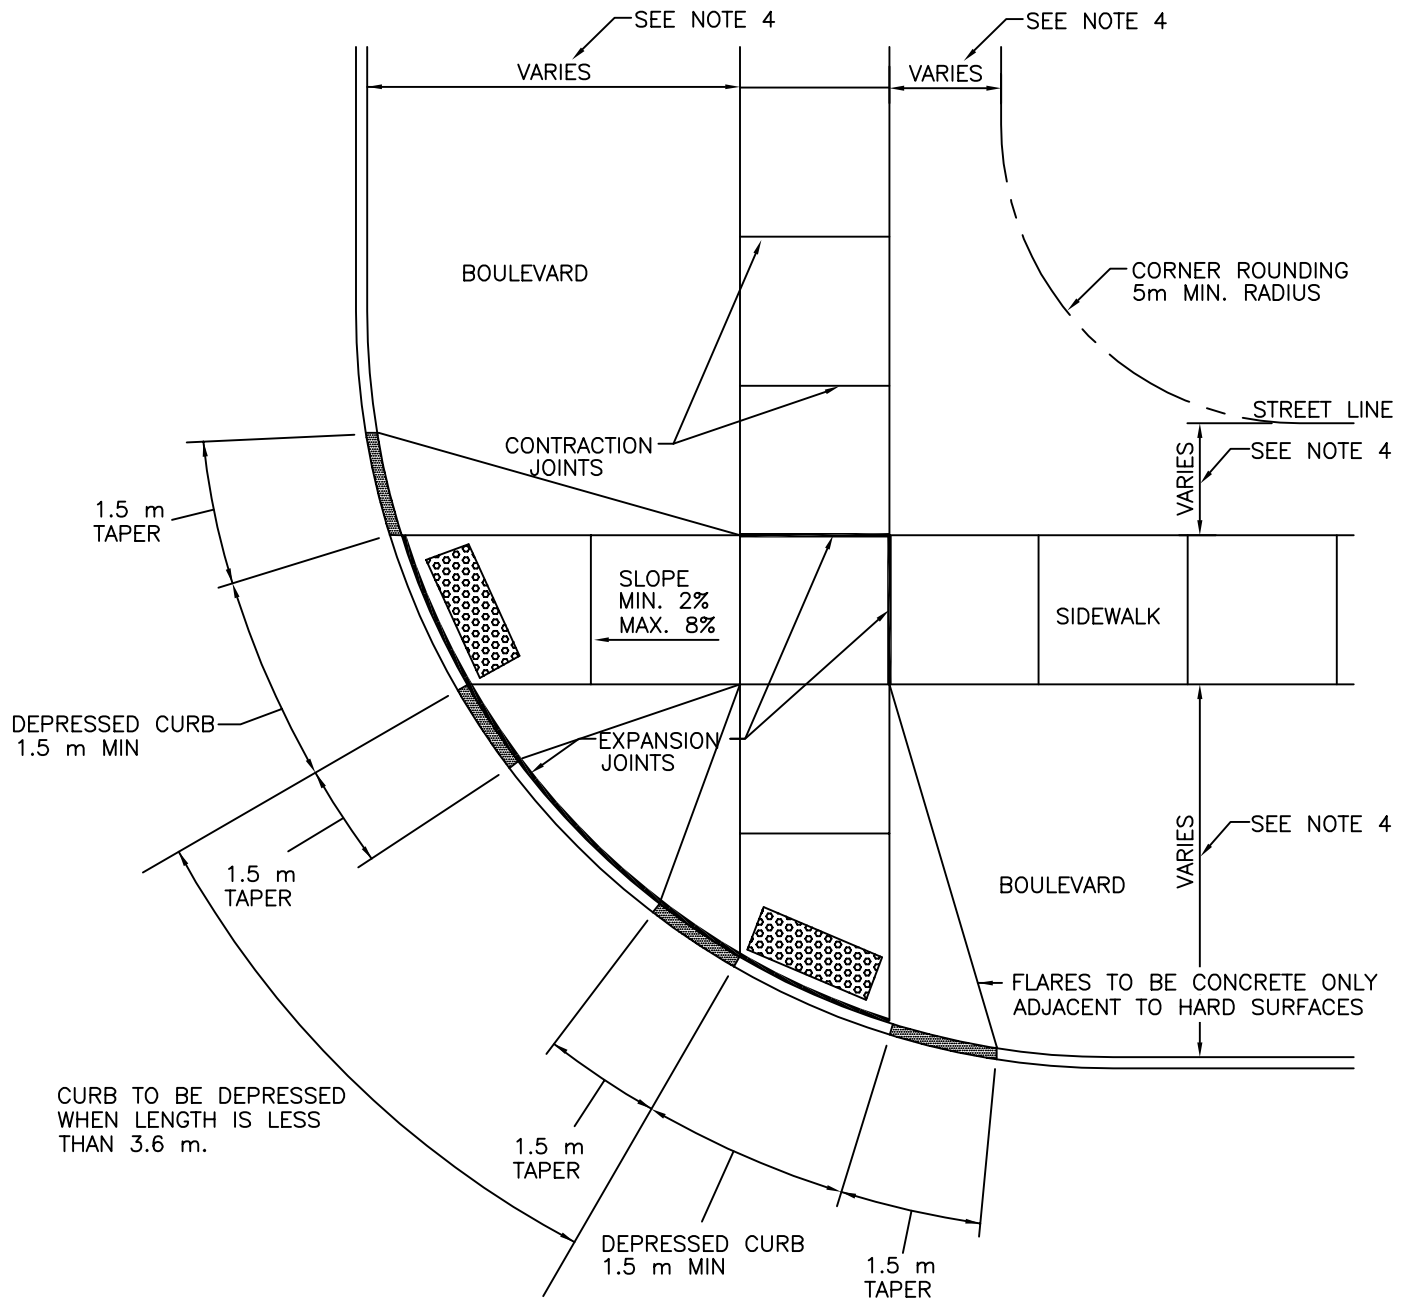

NOTES :

1. FOR INTERSECTIONS NOT AT 90 DEGREE, RAMP CONFIGURATION SHALL BE DETERMINED ON AN INDIVIDUAL BASIS.
2. EXPANSION JOINTS ARE TO BE PLACED TO THE FULL DEPTH OF SIDEWALK AND CONTRACTION JOINTS ARE TO BE 25% OF FULL DEPTH OF SIDEWALK. (SEE P-610 FOR DETAILS)
3. ADDITIONAL EXPANSION JOINTS AS DIRECTED BY THE CITY.
4. REFER TO P-700 SERIES AND SEATON R.O.W. CROSS SECTIONS
5. TACTILE WALKING SURFACE INDICATOR (T.W.S.I.), OPSD 310.039
6. INSTALL FULL RADIUS T.W.S.I. AT ALL FULLY DEPRESSED RADII

All dimensions are in millimetres unless otherwise noted.

City of Pickering		Engineering Services Department	
DRAWN	P. NEUMAN	REVISION NO.	3
APPROVED	S.A. VOKES	DATE	JULY 2019
DATE	JANUARY 1993	P-611	

**SIDEWALK RAMP AT
A 90 DEGREE INTERSECTION**