


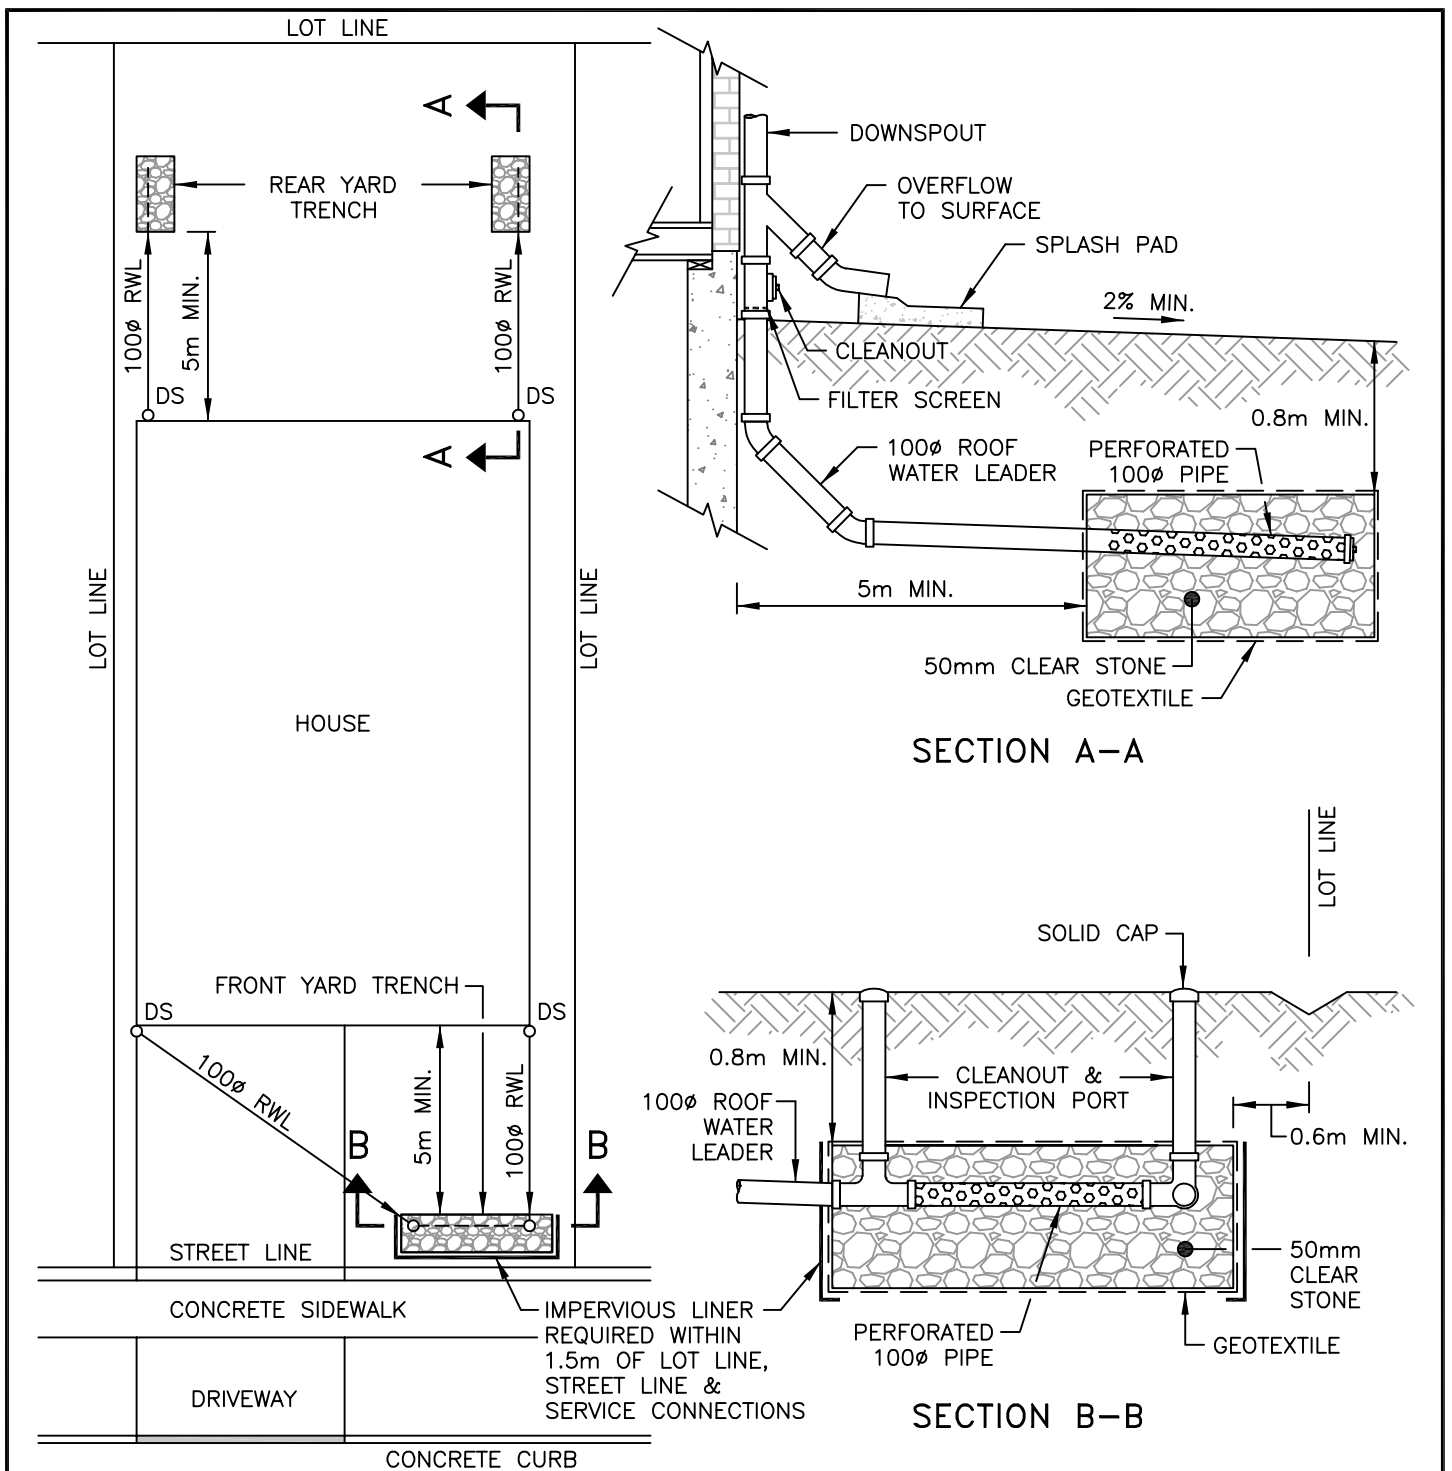

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.
2. TO BE READ IN CONJUNCTION WITH SECTION 5.3.1 OF THE SWM DESIGN GUIDELINES.
3. FOR SCHEMATIC PURPOSES ONLY. CONSULTING ENGINEER TO PROVIDE DESIGN DETAILS AND SPECIFICATIONS.
4. ALL DOWNSPOUTS SHALL BE EQUIPPED WITH OVERFLOW TO SURFACE AS SHOWN ON SECTION A-A.
5. GEOTEXTILE SHALL BE NON-WOVEN NEEDLE PUNCHED OR WOVEN MONOFILAMENT WITH 300mm MIN. OVERLAP.
6. 48HR NOTICE MUST BE PROVIDED TO ENGINEERING SERVICES TO INSPECT INSTALLATION PRIOR TO BACKFILLING.

City of Pickering

Engineering Services Department

DRAWN
B. TRAJCESKI

APPROVED
P. HELGESEN

DATE
JUNE 2022

TYPICAL RESIDENTIAL ROOF WATER
INFILTRATION TRENCH

REVISION NO.

DATE

P-1020