



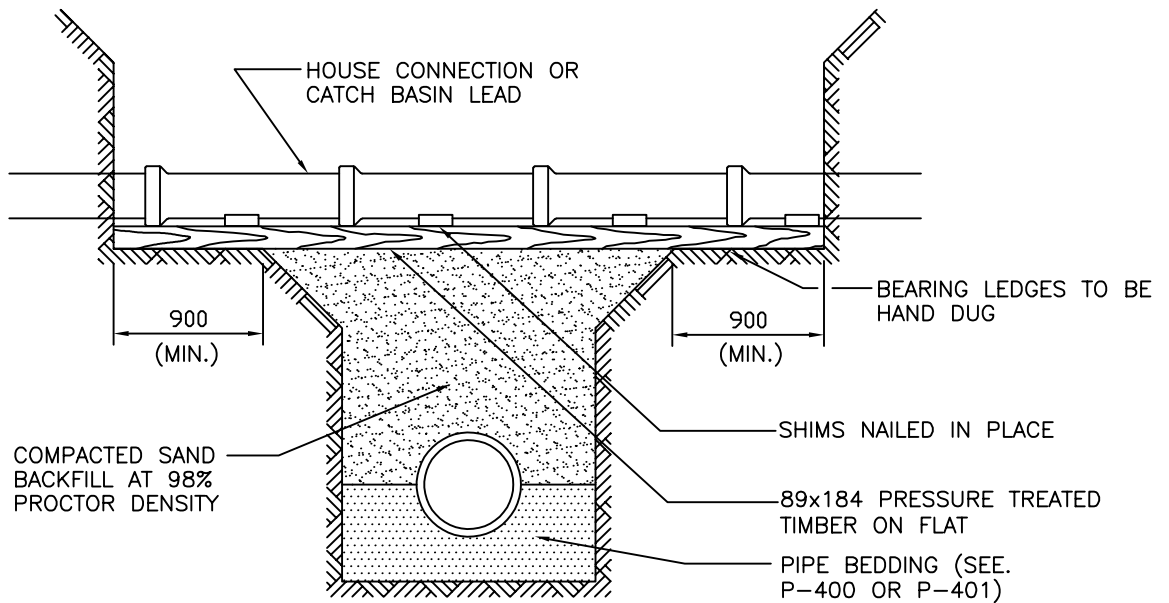

DETAIL "A"

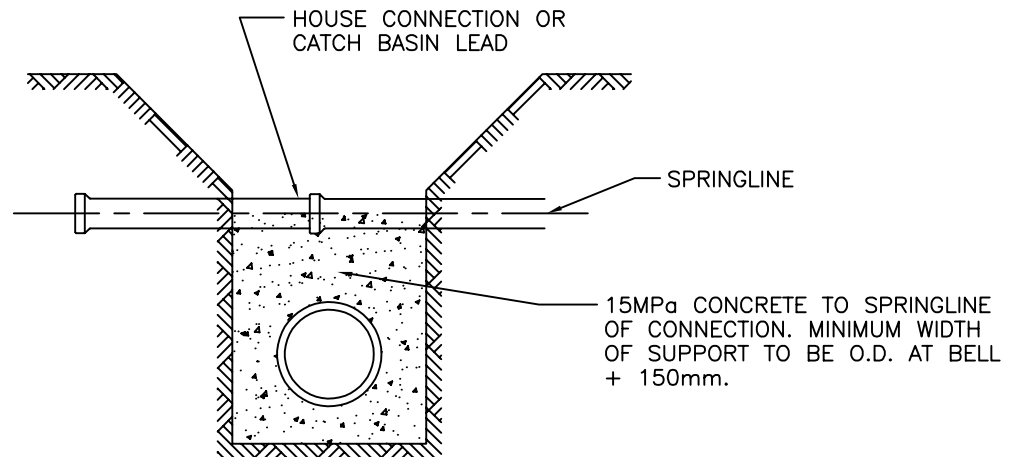

DETAIL "B"

NOTE : WHERE HOUSE CONNECTIONS OR CATCH BASIN LEADS CROSS A SEWER TRENCH, THEY WILL BE SUPPORTED ON A NEW 89x184 PRESSURE TREATED TIMBER WHICH HAS A MINIMUM BEARING OF 900mm AT EACH END ON STRUCTURALLY SOUND GROUND. CONNECTION MUST BE PROPERLY SHIMMED (SEE DETAIL "A") OR BEDDED ON 15MPa CONCRETE FILL, TO SPRINGLINE. (SEE DETAIL "B")

All dimensions are in millimetres unless otherwise noted.

City of Pickering		Engineering Services Department	
DRAWN	P. NEUMAN	REVISION NO.	1
APPROVED	S. A. VOKES	DATE	NOVEMBER 2019
DATE	JANUARY 1993	P-420	

SUPPORT FOR CONNECTIONS CROSSING TRENCH