

VALDOR ENGINEERING INC.

Municipal • Land Development • Water Resources
Site Development • Project Management • Contract Administration
Consulting Engineers – est. 1992

571 Chrislea Road, Unit 4 Woodbridge, Ontario L4L 8A2 TEL (905) 264-0054 FAX (905) 264-0069 info@valdor-engineering.com www.valdor-engineering.com

FUNCTIONAL SERVICING REPORT

Proposed Residential In-Fill Development (8 Lots)

N/E corner of Finch Avenue / Nature Haven Crescent City of Pickering Region of Durham

April 2021

Rev: September 2021

Rev: May 2024

Rev: February 2025

Prepared For: Highglen Homes Limited

File: 17149



s:\projects\2017\17149\report\fsr\revision 3\17149 FSR February 2025.doc



TABLE OF CONTENTS

1.0	0 INTRODUCTION	 4
	1.1 Existing Conditions	 4
	1.2 Proposed Development	 4
	1.3 Purpose of Report	 4
2.0	0 WATER SUPPLY	 5
	2.1 Domestic Demand	 5
	2.2 Water Service Connections	 5
	2.3 Water Meter	 6
	2.4 Fire Protection	 6
3.0	0 WASTEWATER ERVICING	 6
	3.1 Wastewater Loading	 7
	3.2 Sanitary Service Connections	 7
4.0	0 STORM DRAINAGE	 8
	4.1 Minor System	 8
	4.2 Major System	 8
	4.3 Foundation Drainage	 9
	4.4 Roof Drainage	 9
	4.5 Flood Plain	 9
5.0	0 STORMWATER MANGEMENT	 9
	5.1 Quantity Control	 10
	5.1.1 Pre-Development Peak Flows	 10
	5.1.2 Post-Development Peak Flows: Un-Mitigated	 10
	5.1.3 Post-Development Peak Flows: Mitigated	 10
	5.2 Quality Control	 11
	5.3 Water Balance	 11
6.0	0 VEHICULAR & PEDESTRIAN ACCESS	 12
	6.1 Driveways & Parking	 12
	6.2 Sidewalks	 12
7.0	0 GRADING	 13



TABLE OF CONTENTS (Continued)

8.0 EROSION & SE	DIMENT CONTROL DURING CONSTRUCTION	13	
8.1 Control N	Neasures	13	
8.2 Construc	tion Sequencing	14	
8.3 ESC Insp	pection & Maintenance	14	
9.0 SUMMARY		15	
10.0 REFERENCES	& BIBLIOGRAPHY	17	
LIST OF TABLE	ES .		
Table 1	Development Statistics	4	
Table 2	Domestic Water & Fire Flow Demand	5	
Table 3	Wastewater Loading Summary	7	
Table 4	Storm Peak Flow Summary	10	
Table 5	Water Balance Summary	12	
LIST OF FIGUR	ES		
Figure 1	Location Plan	Follows Tex	t
Figure 2	Pre-Development Storm Drainage Plan	Follows Tex	t
Figure 3	Post-Development Storm Drainage Plan	Follows Tex	t
LIST OF DRAW	INGS		
Dwg FGP-1	Functional Grading Plan	Appendix "J'	,,
Dwg FSP-1	Functional Servicing Plan	. Appendix "J'	,,
LIST OF APPEN	NDICES		

- Appendix "A" Draft Plan, Site Plan & Equivalent Population Calculation
- Appendix "B" Water System Calculations & Details
- Appendix "C" Wastewater Calculations & Details
- Appendix "D" Watershed Map & IDF Data
- Appendix "E" Peak Flow Calculations
- Appendix "F" Stormwater Quality Treatment
- Appendix "G" Water Balance Calculations
- Appendix "H" Topographic Survey
- Appendix "I" FSR for ORC Altona Road Lands
- Appendix "J" Functional Grading & Servicing Plans



1.0 INTRODUCTION

Valdor Engineering Inc. has been retained by the Highglen Homes Limited. to provide consulting engineering services for the proposed development of their site located at the northeast corner of Finch Avenue and Nature Haven Crescent in the City of Pickering as indicated in **Figure 1**.

1.1 Existing Conditions

The site is approximately 0.510 hectares in size and is vacant and grass covered. There are no watercourses or other natural features within the subject site.

The site is bound to the north by valley lands to the west by the road allowance of Nature Haven Crescent, to the south by the road allowance of Finch Avenue and to the east by valley lands and a detached dwelling.

1.2 Proposed Development

The proposed in-fill development will be in the form of eight detached dwellings on lots having frontage on existing municipal roads, namely, Nature Haven Crescent or Finch Avenue.

A copy of the Concept Plan and Site Plan are included in **Appendix "A"** together with a calculation of the equivalent population contained in **Table A1**. The development statistics and the equivalent population data are summarized in **Table 1**.

Table 1. Development Statistics

Land Use	No of Units	Equivalent Population		
Detached Dwelling	8	28		
Total:	8	28		

1.3 Purpose of Report

This Functional Servicing Report has been prepared to demonstrate the servicing feasibility of the proposed development in conjunction with the zoning by-law amendment and draft plan of subdivision applications. It has been prepared based on a review of the topographic survey and information from servicing plans obtained from the municipal archives.

This report outlines the engineering design elements for the proposed development, including water supply, sanitary sewers, storm sewers and stormwater management as well as grading and driveway access all of which are presented in the following sections. A **Preliminary Grading Plan** and a **Preliminary Servicing Plan** have been prepared in conjunction with this report and are included in **Appendix "J"**.



The subject site was formerly part of land holdings owned by the Ontario Realty Corporation (ORC) which were deemed surplus and sold as development lands. During this process a Functional Servicing Report (ORC FSR) was prepared in which the subject site is described as being within the north part of "Parcel 1". A copy of the ORC FSR is included in **Appendix "I"**.

2.0 WATER SUPPLY

The Region of Durham owns and operates twelve drinking water systems using three supply sources including Lake Ontario, Lake Simcoe and groundwater wells. The Region is responsible for operating and maintaining every component of the water supply system including treatment, storage and distribution of potable water to consumers throughout the Region. In this regard, the Region operates and maintains 6 surface water supply plants, 22 water storage facilities, 18 pumping stations, 23 groundwater wells and approximately 2,400 km of watermains.

The subject site is serviced by the Oshawa / Whitby / Ajax distribution system which delivers treated water through approximately 2,000 kilometres of watermains to provide potable water to consumers in the City of Pickering as well as the City of Oshawa, Community of Courtice, Town of Ajax, Town of Whitby and Community of Brooklin. The source water for the treatment process is drawn from Lake Ontario. A plan of the various drinking water systems in the Region is included in **Appendix "B"**.

The following is a summary of the waster servicing requirements for the development.

2.1 Domestic Demand

The domestic demand is to be calculated using the Region of Durham engineering design standards which include the following parameters:

Residential Average Day Demand: 364 L/person/day

Maximum Day Factor: 2.0 Peak Hour Factor 3.0

Based on the above, it is anticipated that the development will have a water demand as summarized in **Table 2**. A detailed tabulation of the domestic water demand calculation is detailed in **Table B1** of **Appendix "B"**.

Table 2. Domestic Water & Fire Flow Demand

Equivalent Population	Average Day Demand	Maximum Day Demand	Peak Hour Demand	Fire Flow	Maximum Day Plus Fire Flow	Maximum Day Plus Fire Flow
(Persons)	(L/min)	(L/min)	(L/min)	(L/min)	(L/min)	(L/s)
28	7.1	14.2	21.2	6,000.0	6014.2	100.2

2.2 Watermains & Service Connections

An existing 250mm diameter watermain is located on the south side of Finch Avenue and a 150mm diameter watermain is located in the west boulevard of Nature Haven Crescent.



Based on Ontario Building Code (OBC 2012) regulations (7.6.3.4.(1) and (5) and Table 7.6.3.4), the proposed detached dwelling will be serviced with 25mm diameter water connections given that it is anticipated that the dwellings will each have more than 16 fixture units.

The location of the existing watermains and the proposed water service connections are indicated on the **Preliminary Servicing Plan**. A copy of the Region of Durham's standard water service connection detail is included in **Appendix "B"**.

2.3 Water Meters

The proposed detached dwellings will have a water meters located in the basement with a remote readout device located on the exterior ground floor wall of the unit. Generally, residential water meters are selected to be one size smaller than the water service and therefore 20mm x 25mm water meters will be installed. Water meters are to be purchased from the Region of Durham. A copy of the Region of Durham's standard water meter details is included in **Appendix "B"**.

2.4 Fire Protection

The fire flow required for the proposed buildings was calculated using the criteria indicated in the *Water Supply for Public Fire Protection Manual*, 1999, by the Fire Underwriters Survey (FUS). The calculation incorporates various parameters such as coefficient for fire-resistant construction, an area reduction accounting for a fire-resistant (one hour rating) protection, a reduction for low-hazard occupancies, an adjustment for sprinkler protection system, and a factor for neighbouring building proximity.

In accordance with the FUS, the required fire flow for the detached dwellings was calculated based on the floor area. Based on a floor area of 296 m² (3,186 sqft.), a minimum fire suppression flow of 6,000 L/min is required. The detailed fire flow calculation is provided in **Table B2** contained in **Appendix "B"**. This fire flow plus the maximum day demand must be available at the nearest hydrant with a minimum pressure of 140 KPa.

A fire hydrant is to be located within 90m of the principal entrances to the dwellings in accordance with the Ontario Building Code (OBC 2012). Based on the foregoing, the existing street fire hydrants will provide sufficient coverage.

The location of the existing and proposed fire hydrants as well as a copy of the Region's standard fire hydrant detail is included in **Appendix "B"**.

3.0 WASTEWATER SERVICING

The Region of Durham is responsible for wastewater servicing provided to the residents and businesses within the Region including the City of Pickering. The Region operates and maintains 11 sewage treatment plants, 48 sewage pumping stations and approximately 1,400 km of sanitary sewers.



The subject site is located within the service area of the Duffin Creek Water Pollution Control Plant (WPCP) which is located at 901 McKay Road in Pickering. This plant discharges fully treated water into Lake Ontario. The Duffin Creek WPCP, jointly owned and operated by The Regional Municipalities of York and Durham, is a critical component of the York Durham Sewage System (YDSS). In this regard, the plant treats sewage from the City of Pickering and Town of Ajax as well as sewage from York Region communities as far north as the Towns of Aurora and Newmarket, as far west as the City of Vaughan, and the Towns of Richmond Hill and Markham.

The following is a summary of the wastewater servicing analysis for the subject site.

3.1 Wastewater Loading

The wastewater loading has been calculated using the Region of Durham engineering design standards which include the following parameters:

Domestic Flow: Q = 364 L/person/dayExtraneous Flow: I = 0.26 L/s/Ha (Infiltration)

Peaking Factor: $K_{H} = 1 + \frac{14}{4 + \sqrt{P}}$ (K_H =1.5 min., 3.8 max.)

Where: K_H = Harmon Peaking Factor P = Population in thousands

Design Flow, $Q = Q \times K_H + I$

Based on the above criteria the sewage flow calculations are provided in **Table C1** contained in **Appendix "C"** and the total flow is summarized in **Table 3**.

Table 3. Wastewater Loading Summary

Area	Equivalent Population	Average Daily Flow	Harmon Peaking Factor	Peak Daily Flow	Infiltration Rate	Total Flow
(Ha)	(Persons)	(L/s)		(L/s)	(L/s)	(L/s)
0.510	28	0.118	3.800	0.45	0.133	0.58

3.2 Sanitary Sewers & Service Connections

An existing 200mm diameter sanitary sewer is located on Nature Haven Crescent and on Finch Avenue across the frontages of the subject site. In order to service the proposed detached dwelling, 100mm diameter sanitary services will be installed which will connect to these sewers.

The location of the existing sanitary sewer and the sanitary service connections is illustrated on the **Preliminary Servicing Plan**. The Region of Durham's standard detail for sanitary service connection is included in **Appendix "C"**.



4.0 STORM DRAINAGE

The subject site is located in the Petticoat Creek watershed which is under the jurisdiction of the Toronto and Region Conservation's (TRCA). The watershed covers 27 square kilometres including lands in Pickering, Markham and Toronto. The watercourse flows 49 kilometres south, from its headwaters on the south slope of the Oak Ridges Moraine, outletting into Lake Ontario at the Petticoat Creek Conservation Area.

Based on an on-line search of the regulation mapping on the TRCA website, the subject site is located within an area that is regulated by the TRCA. A permit is therefore required from their office under Ontario Regulation 166/06. A copy of the Watershed mapping and Regulation mapping is provided in **Appendix "D"**.

In accordance with City standards, a major / minor system storm conveyance concept has been incorporated into the functional servicing design for the subject development. The following sections provide a brief summary of the storm drainage components:

4.1 Minor System Design

As per the City engineering design criteria, the proposed development is to be serviced with a minor storm sewer system that is designed to convey runoff from the 5 year storm event. The rainfall intensity values, *I*, are calculated in accordance with the City standards as follows:

$$I_5 = \frac{1082.901}{(t + 6.007)^{0.837}} \qquad I_{100} = \frac{2096.425}{(t + 6.485)^{0.863}}$$

The peak flows are calculated using the following formula:

 $Q = R \times A \times I \times 2.778$ where: Q = peak flow (L/s) A = area in hectares (Ha) I = rainfall intensity (mm/hr)R = composite runoff coefficient

t = time of concentration (min)

Based on the topographic survey, the subject site currently drains in the form of sheet flow towards Nature Haven Crescent and Finch Avenue. The proposed development will be serviced by the existing storm sewers located on Nature Haven Crescent and Finch Avenue across the frontages of the subject site.

The location of the existing storm sewers and the proposed storm service connections are illustrated on the **Preliminary Servicing Plan**. The City of Pickering rainfall intensity duration frequency (IDF) curve data as well as a preliminary storm sewer design sheet is included in **Appendix "D"**.

4.2 Major System Design

The major system will generally be comprised of an overland flow route along the municipal roads to direct drainage to a safe outlet. This major system will convey flows



which are in excess of the capacity of the storm sewer system. The major system flow route is illustrated on the **Preliminary Grading Plan**.

4.3 Foundation Drainage

The proposed detached dwellings will have basements that will require weeping tile at the footing level. In order to drain the weeping tile, each lot will have a storm service connection. In order to protect the basements, and in accordance with City standards, the underside of basement slab elevations are to be a minimum of 300 mm above the 100 year HGL. The 100 year HGL elevations obtained from the plan & profile drawings for the existing municipal roads have been indicated on the **Preliminary Grading Plan** together with the proposed basement floor elevations. Based on the elevations, the underside of the proposed basement floors will be at least 300mm above the 100 year HGL. The plan & profile drawings are included in **Appendix "D"**.

4.4 Roof Drainage

The proposed detached dwelling will have a conventional peaked roof with eaves troughs and downspouts. The house downspouts are to discharge to grade over splash pads. The downspouts at the rear of the houses are to be directed to soak-away pits as indicated in Section 5.3 of this report.

4.5 Flood Plain

Based on an on-line search of the regulation mapping on the TRCA website, the subject site is not located in the flood plain of the Petticoat Creek. Based on the foregoing, no flood protection measures are necessary.

Based on the Finch Avenue & Altona Road Floodplain Spill 2D Modelling Analysis (April 29, 2022) completed by the TRCA, the proposed development has safe access to Finch Avenue and Nature Haven Crescent.

The TRCA mapping and Floodplain Spill Analysis is included in Appendix "D".

5.0 STORMWATER MANAGEMENT

In accordance with the requirements of the City of Pickering and the TRCA the following stormwater management criteria will be implemented:

- Quantity Control is to be provided such that the post-development peak flows will be controlled to the pre-development rates for rainfall events up to and including the 100 year storm.
- Level 1 (Enhanced) stormwater quality treatment is to be provided to achieve 80% TSS removal.
- Water Balance to retain the 5mm rainfall event.



Based on the foregoing, the following is a summary of the stormwater mitigation measures that are to be incorporated into the design of the subject site.

5.1 Quantity Control

Stormwater quantity control is typically implemented to minimize the potential for downstream flooding, stream bank erosion and overflows of infrastructure. Of particular concern is the 0.214 Ha area of the subject site which drains to nature Haven Crescent given that the storm sewer on this street was not sized for the subject lands. The impact of the proposed development has been analyzed as follows:

5.1.1 Pre-Development Flow

Pre-development surfaces consist primarily of grassed areas, which indicates that the existing site condition is relatively pervious with a 2 year runoff coefficient of 0.25. The pre-development surface conditions are illustrated in **Figure 2.**

Pre-development peak flow calculations were generated using the City's rainfall IDF data in accordance to the municipal standards. The calculation of the pre-development 2 year and 100 year peak flows are provided on **Table E1** contained in **Appendix "E"** and summarized in first row of **Table 4.**

Runoff Coefficient Peak Flows (L/s) Condition 2 Year 100 Year 2 Year 100 Year Pre-Development 0.25 0.25 27.5 82.7 0.62 0.62 8.2 14.4 Post-Development

Table 4: Storm Drainage Peak Flows

5.1.2 Post-Development Flow: Un-Mitigated

Based on a review of the architect's site plan, the post-development surface conditions for this site are illustrated in **Figure 3.** The surfaces comprise mainly of grassed yards, roof areas and driveway areas. Based on these surfaces, the proposed development is more impervious than the existing site condition and the composite runoff coefficient increases from 0.25 to 0.62.

5.1.3 Post Development Peak Flow: Mitigated

As Illustrated in **Figure 3**, 0.214 hectares of the proposed site will drain to the existing Nature Haven Crescent storm sewer which was not sized to accommodate flow from the subject site. Based on the foregoing, a stormwater detention system will be provided on Nature Have Crescent to capture and control flow and discharge it to the existing Finch Avenue Storm sewer.



Based on the analysis, the site will be served by a 74mm orifice plate at the outlet of the proposed box culvert. This box culvert will provide the required detention volume of 45m³ which will outlet to the existing 750 mm diameter sewer along Finch Ave.

5.2 Quality Control

Based on the City of Pickering criteria, storm water quality control for the subject site is to be designed to achieve "Enhanced" protection level (Level 1 treatment) which entails 80% total suspended solids (TSS) removal.

The subject site will drain to the existing municipal storm sewers on Finch Avenue which directs flow to an existing oil / grit separator located on Finch Avenue, east of the subject site, as identified on the **Functional Servicing Plan**.

Oil / grit separators are designed to provide stormwater quality treatment and are typically in the form of a pre-cast concrete maintenance hole with a deep sump with a special insert which diverts low flows to a lower chamber to capture and store oil and grit from the storm drainage discharge from the site. The insert diverts high flow away from the lower chamber to ensure that captured pollutants do not scour or re-suspend.

As summarized in section 3.2.1 of the ORC FSR contained in **Appendix "I"**, the existing STC-6000 oil / grit separator has sufficient capacity to provide the required stormwater quality treatment for the subject site resulting in an 82% TSS removal rate.

In addition to the existing oil / grit separator, LID measures in the form of soak-away pits are proposed as indicated in section 5.3 which will provide water quality bennefits. The detail for the existing STC-6000 oil / grit separator is included in **Appendix "F"**.

5.3 Water Balance

Based on the small size of the site, and in accordance with the City and TRCA criteria, a minimum of a 5 mm rainfall depth is to be retained on site and either infiltrated or reused. The objective of this criteria is to capture and manage annual rainfall on-site to preserve the pre-development hydrology.

The runoff volume is calculated based on the site area and is calculated as follows:

Runoff Volume =
$$A \times (D)$$

where:
 $V = \text{runoff volume (m}^3)$
 $A = \text{area (m}^2)$
 $D = \text{rainfall depth}$
 $V = 5,100 \text{ m}^2 \times 0.005 \text{ m}$
 $V = 25.48 \text{ m}^3$

Based on the above and site area, the volume required to achieve water balance is 25.48 cu.m. A review of the architect's site plan indicates that there is an opportunity to



incorporate soak-away pits to address water balance. These soak-away pits will be located in the rear yard of each lot and will receive roof runoff from the downspouts.

The size of the soak-away pits necessary to infiltrate the required volume depends on the percolation rate of the native site soils. The geotechnical investigation report indicates that the native soils are clayey silt and that the ground water level is at least 5.5m below existing grade. Based on the geotechnical investigation report, infiltration rates of 12mm/hr and 50mm/hr were used based on the permeability of the various soil types.

The calculations for the volume to be retained is provided in **Table G1** and **Table G2** which are included in **Appendix "G"** together with the geotechnical investigation report and the infiltration testing report and a detail of the soak-away pit. The location of the proposed soak-away pits are indicated on the **Functional Grading Plan** and **Functional Servicing Plan** together with the base elevation and the groundwater elevation to demonstrate that there is at least 1.0m separation.

Table 5. Water Balance Summary

	Volume (cu.m.)
Volume to be Retained:	25.48
Soak-Away Pit Volume Provided:	25.93

6.0 VEHICULAR & PEDESTRIAN ACCESS

The site plan has been developed with consideration for efficient and safe access and circulation of both vehicular and pedestrian traffic.

6.1 Driveways & Parking

The subject site has frontage on Finch Avenue and on Nature Haven Crescent which are two lane local roads under the jurisdiction of the City of Pickering. No new municipal roads are required to accommodate the subject development. Nature Haven Crescent has curb and gutter whereas Finch Avenue only has curb and gutter on the south side of the road. The curb and gutter on the north side of Finch Avenue will be constructed in conjunction with the subject development. With respect to parking, each dwelling will have a two car garage and a double driveway.

6.2 Sidewalks

Pedestrian access will be provided by the existing municipal sidewalk located along the west side of Nature Haven Crescent. The site's frontage along Finch Ave will be urbanized through the widening of the pavement to match the existing urbanized section of Finch Ave to the west of Nature Haven Crescent. A 1.5-meter-wide sidewalk will be constructed along Finch Avenue across the frontage of the subject site.



7.0 GRADING

Based on a topographic survey of the site completed on August 4, 2024, the property slopes from the northwest corner at an elevation of approximately 141.90m, down to the southeast corner of the site, at an elevation of approximately 138.30m. This fall of approximately 3.60m equates to an overall average slope of approximately 2.8% which is considered to be relatively flat. A copy of the topographic survey prepared by Ertl Surveyors is included in **Appendix "H"**.

The subject site is to be graded in accordance with the municipal grading criteria which dictates that lot grades from 2.0% to 5.0%. For large grade differentials, a maximum slope 3H: 1V can be used for sodded embankments. In areas where space is limited, retaining walls can be utilized to accommodate grade differentials.

Based on the **Functional Grading Plan**, no major difficulties are anticipated in achieving the municipal grading design criteria. A detailed grading plan is to be prepared at the site plan application stage.

8.0 EROSION & SEDIMENT CONTROL DURING CONSTRUCTION

Construction activity, especially operations involving the handling of earthen material, dramatically increases the availability of particulate matter for erosion and transport by surface drainage. In order to mitigate the adverse environmental impacts caused by the release of silt-laden stormwater runoff into receiving watercourses, measures for erosion and sediment control (ESC) are required for construction sites.

The impact of construction on the environment is recognized by the Greater Golden Horseshoe Area Conservation Authorities. Their document titled "Erosion & Sediment Control Guidelines for Urban Construction" (2019) provides guidance for the preparation of effective erosion and sediment control plans.

Control measures must be selected that are appropriate for the erosion potential of the site and it is important that they be implemented and modified on a staged basis to reflect the site activities. Furthermore, their effectiveness decreases with sediment loading and therefore inspection and maintenance is required. The selection, implementation, inspection and maintenance of the control features are summarized as follows:

8.1 Control Measures

On relatively small sized sites, measures for erosion and sediment control typically include the use of silt fencing, a mud mat and sediment traps. The following is a description of the sediment controls to be implemented on the subject site:

- **Silt Fences** are to be installed adjacent to all property limits subject to drainage from the development area prior to topsoil stripping and in other locations, such as at the bases of topsoil stockpiles.
- **Mud Mat** is to be installed at the construction entrance prior to commencing earthworks to minimize the tracking of mud onto municipal roads.



• **Sediment Traps** are to be installed at all catchbasin and area drain locations once the storm sewer system has been constructed to prevent silt laden runoff from entering the municipal storm sewer system.

8.2 Construction Sequencing

The following is the scheduling of construction activities with respect to sediment controls:

- 1. Install the silt fences prior to any other activities on the site.
- 2. Construct temporary mud mat for construction access.
- 3. Install sediment traps on the existing street catchbasins.
- 4. Install the service connections.
- 5. Excavate, constructed the house basements and back fill.
- 6. Construct the house superstructure.
- 7. Restore all disturbed areas with final landscape plantings and paving materials.
- 8. Upon stabilization of all disturbed areas, remove sediment controls.

8.3 ESC Inspection & Maintenance

In order to ensure that the erosion and sediment control measures operate effectively, they are to be regularly monitored and they will require periodic cleaning (e.g., removal of accumulated silt), maintenance and/or re-construction.

Inspections of all of the erosion and sediment controls on the construction site should be undertaken with the following frequency:

- On a weekly basis
- After every rainfall event
- After significant snow melt events
- Prior to forecasted rainfall events

If damaged control measures are found they should be repaired and/or replaced within 48 hours. Site inspection staff and construction managers should refer to the Erosion and Sediment Control Inspection Guide (2008) prepared by the Greater Golden Horseshoe Area Conservation Authorities. This Inspection Guide provides information related to the inspection reporting, problem response and proper installation techniques.



9.0 SUMMARY

Based on the discussions contained herein, the proposed development can be adequately serviced with full municipal services (watermain, sanitary and storm) in accordance with the standards of the City of Pickering, Region of Durham and the Toronto & Region Conservation Authority (TRCA) as follows:

Water

- The proposed detached dwellings will be serviced by 25mm diameter service connections to the existing 150mm diameter Nature Haven Crescent watermain and the existing 250mm diameter Finch Avenue watermain.
- The detached dwellings will have water meters located in the basements.
- The existing street fire hydrants will be within 90m of the principle entrance of the dwellings and therefore they provide sufficient coverage for fire protection.
- The subject development will require a maximum day plus fire flow of 100.2 L/s at 140 kPa.

Waste Water

- The proposed detached dwellings will be serviced by 100mm diameter service connections to the existing 200mm diameter Nature Haven Crescent sanitary sewer and the existing 200mm diameter Finch Avenue sanitary sewer.
- The subject development will generate a peak wastewater flow of 0.58 L/s.

Storm Drainage

- In accordance with City of Pickering criteria, the subject site will be serviced by storm service connections to the existing municipal storm sewers located on Finch Avenue.
- Based on the 100 year hydraulic grade line (HGL) in the storm sewers, the underside of the proposed basement floors will be located at least 300mm above the HGL.
- The major system is comprised of an overland flow route in the form of the existing municipal roads which will convey runoff from rainfall events in excess of the capacity of the municipal storm sewer to a safe outlet
- Based on the Finch Avenue & Altona Road Floodplain Spill 2D Modelling Analysis (April 29, 2022) completed by the TRCA, the proposed development is not located within the floodplain and has safe access to Finch Avenue and Nature Haven Crescent.

Stormwater Management

- Based on the City of Pickering and TRCA requirements the following stormwater management measures are to be implemented:
 - The portion of the subject site draining to Nature Haven Crescent will have stormwater controlled with the use of a box culvert for detention and an orifice to control the release rate. This stormwater management system will discharge directly to the existing Finch Avenue storm sewer.
 - Stormwater quality treatment for the subject site will be provided by an existing STC-6000 oil / grit separator located on Finch Avenue, east of the subject site



- February 2025 File: **17149**
- which will provide an 82% TSS removal rate. In addition to the existing oil / grit separator, LID measures in the form of soak-away pits are proposed which will provide water quality benefits.
- Based on the small size of the site, water balance will be addressed by infiltrating
 the 5mm rainfall event through the use of a soak-way pit to be located in the rear
 yard of each lot which will receive roof runoff.

Vehicular & Pedestrian Access

- The subject site has frontage on Finch Avenue and on Nature Haven Crescent which are two lane local roads under the jurisdiction of the City of Pickering. No new municipal roads are required to accommodate the subject development. Nature Haven Crescent has curb and gutter whereas Finch Avenue only has curb and gutter on the south side of the road. The curb and gutter on the north side of Finch Avenue will be constructed in conjunction with the subject development. With respect to parking, each dwelling will have a two car garage and a double driveway.
- Pedestrian access will be provided by the existing municipal sidewalk along Nature Haven Crescent. A 1.5 m wide sidewalk will be constructed along Finch Avenue across the frontage of the subject site.

Grading

• Based on the Functional Grading Plan no major difficulty is anticipated in achieving the municipal grading design criteria.

Erosion & Sediment Control During Construction

 Erosion and sediment controls are to be implemented during construction to prevent silt laden runoff from leaving the site in accordance with the "Erosion & Sediment Control Guidelines for Urban Construction" (2019).

Detailed Engineering Design

Detailed engineering design for the proposed subdivision is to be prepared upon receipt
of draft plan approval. This detailed design is to include detailed servicing and grading
designs based on the criteria established in this Functional Servicing Report.



10.0 REFERENCES & BIBLIOGRAPHY

- City of Pickering, **Stormwater Management Guidelines**, January 2020.
- Region of Durham, Design & Construction Specifications for Regional Services, April 2013.
- Ministry of Environment, Stormwater Management Planning & Design Manual, March 2003.
- Greater Golden Horseshoe Area Conservation Authorities, **Erosion & Sediment Control Guidelines for Urban Construction**, December 2006.
- Fire Underwriters Survey, Water Supply for Public Fire Protection, 1999.
- Ministry of Municipal Affairs & Housing, Ontario Building Code, 2012.
- Sabourin Kimble & Associates Ltd., Functional Servicing Report for ORC Altona Road Lands, February 2010.
- Toronto & Region Conservation Authority, Finch Avenue & Altona Road Floodplain Spill 2D Modelling Analysis, April 29, 2022.
- Soil Engineers Ltd., Geotechnical Investigation Report, February 13, 2020.

Respectfully Submitted,

VALDOR ENGINEERING INC.





David Giugovaz, P.Eng., LEED® AP Senior Project Manager


905-264-0054 x 224 dgiugovaz@valdor-engineering.com

This report was prepared by Valdor Engineering Inc. for the account of the Highglen Homes Limited. The comments, recommendations and material in this report reflect Valdor Engineering Inc.'s best judgment in light of the information available to it at the time of preparation. Any use of which a third party makes of this report, or any reliance on, or decisions made based on it, are the responsibility of such third parties. Valdor Engineering Inc. accepts no responsibility whatsoever for any damages, if any, suffered by any third party as a result of decisions made or actions based on this report.



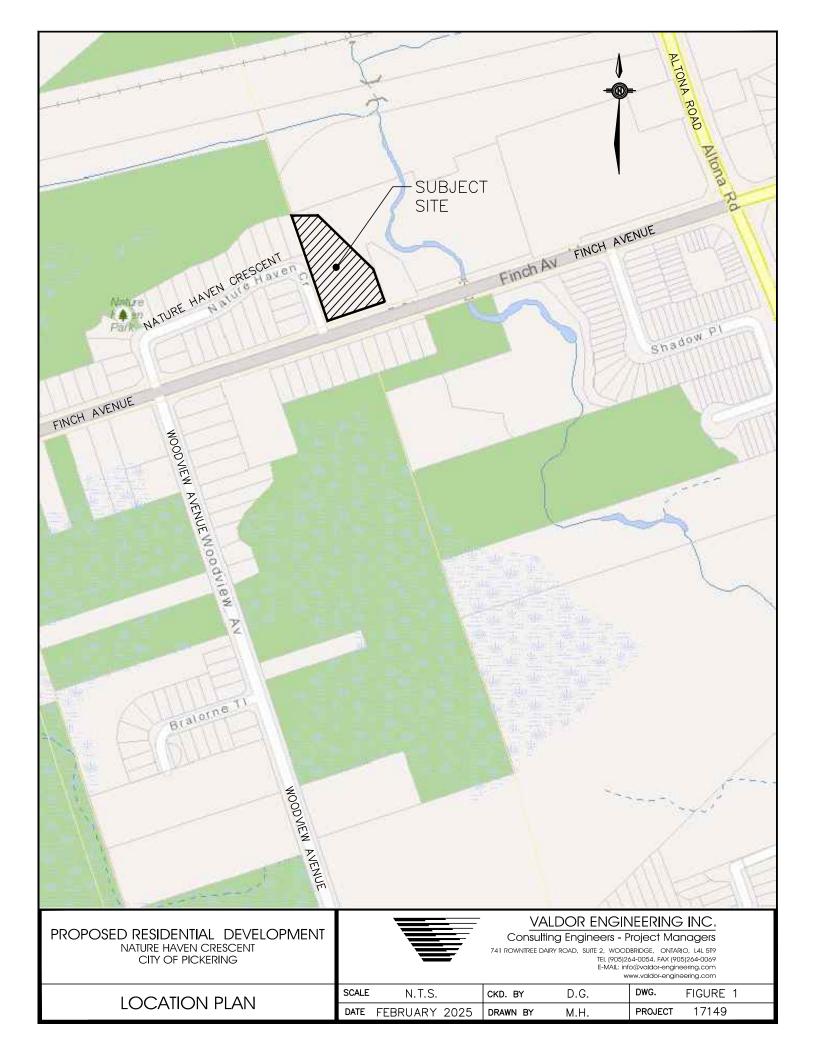

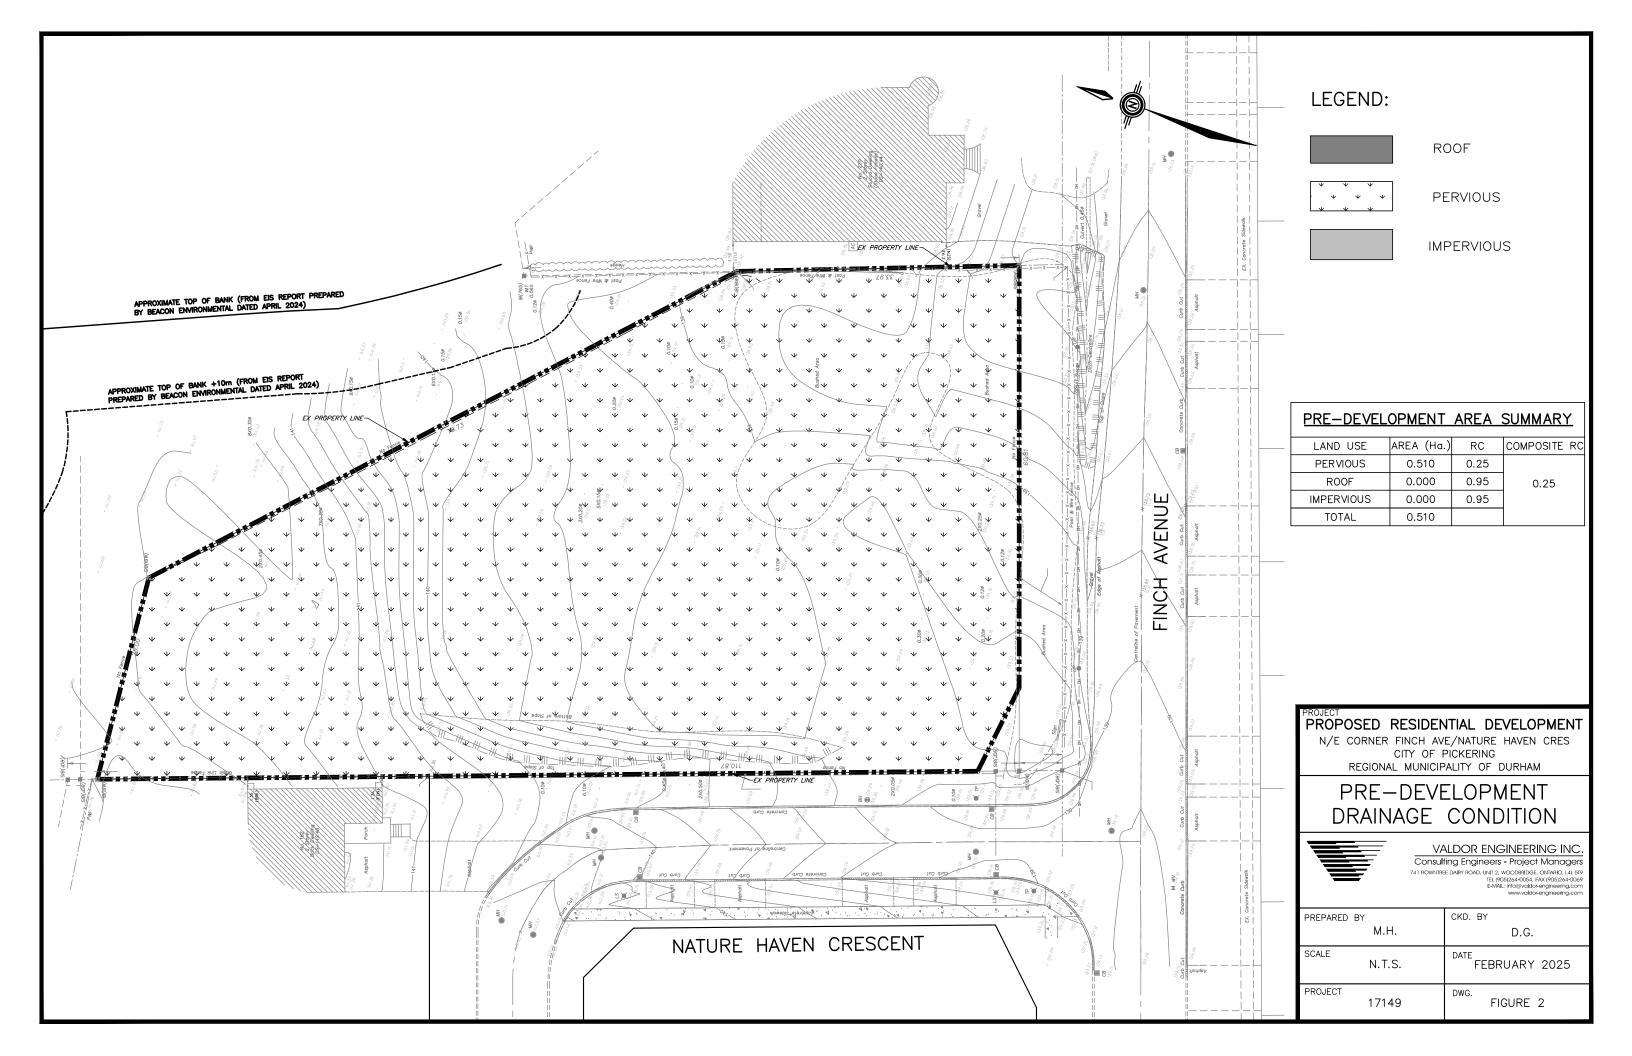


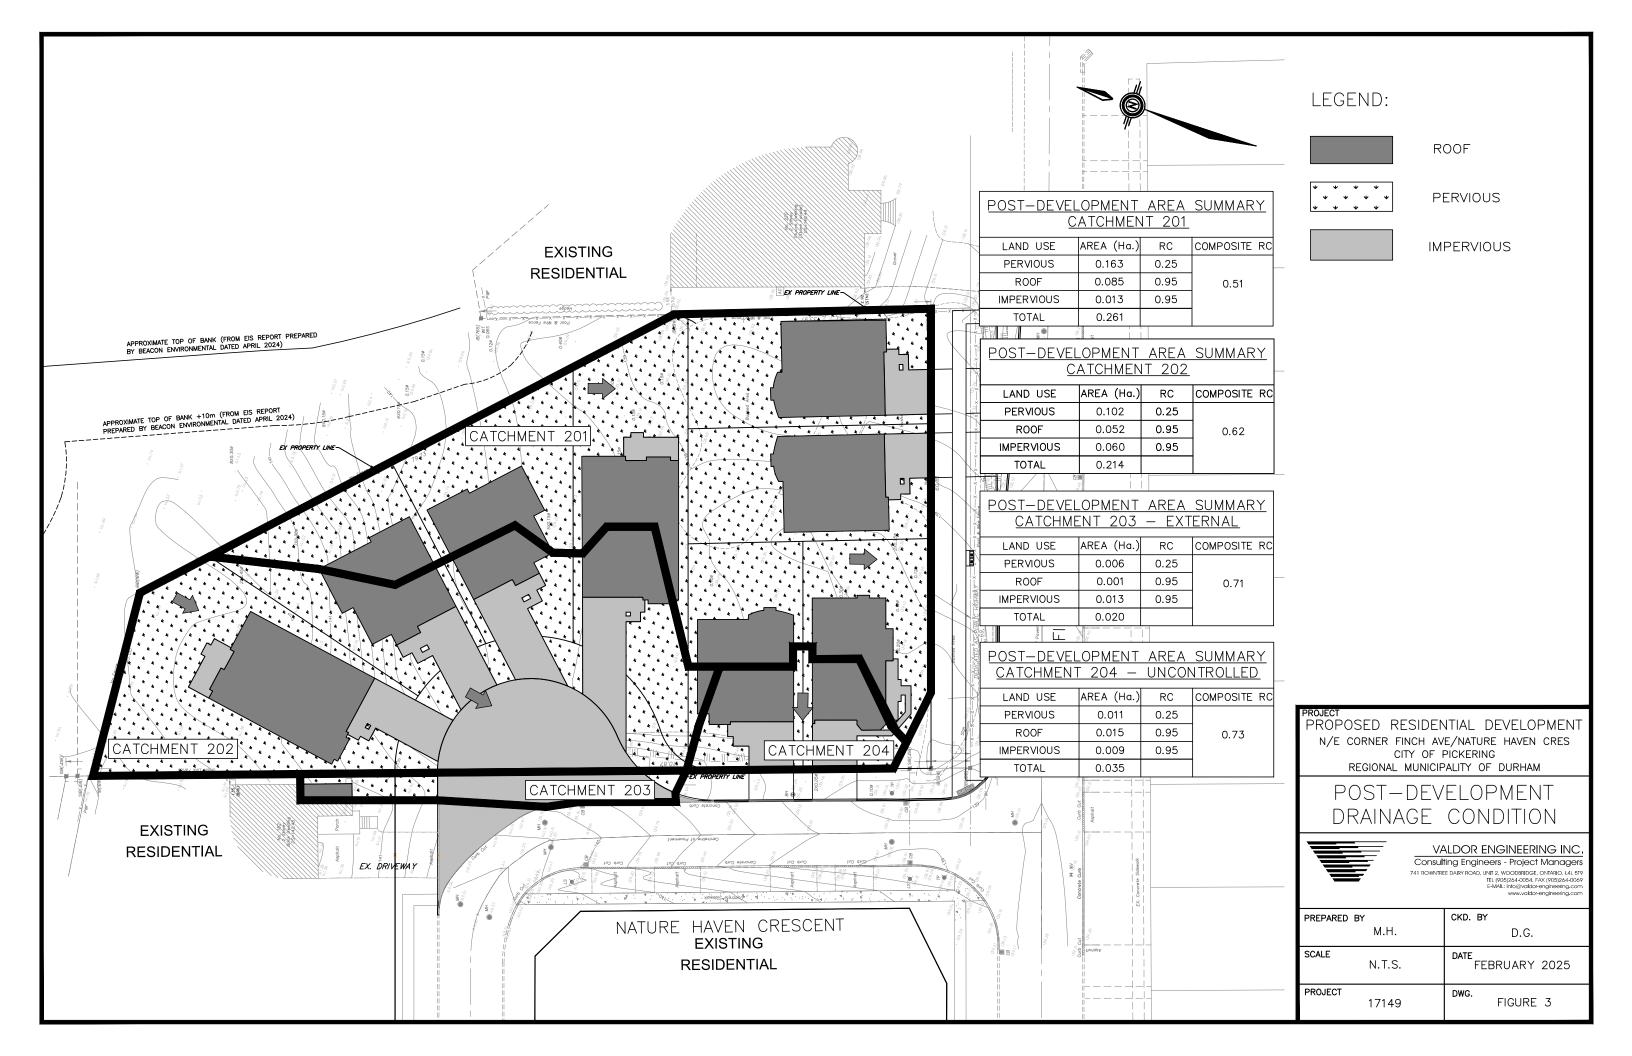


APPENDIX "A"

Draft Plan, Site Plan & Equivalent Population Calculation



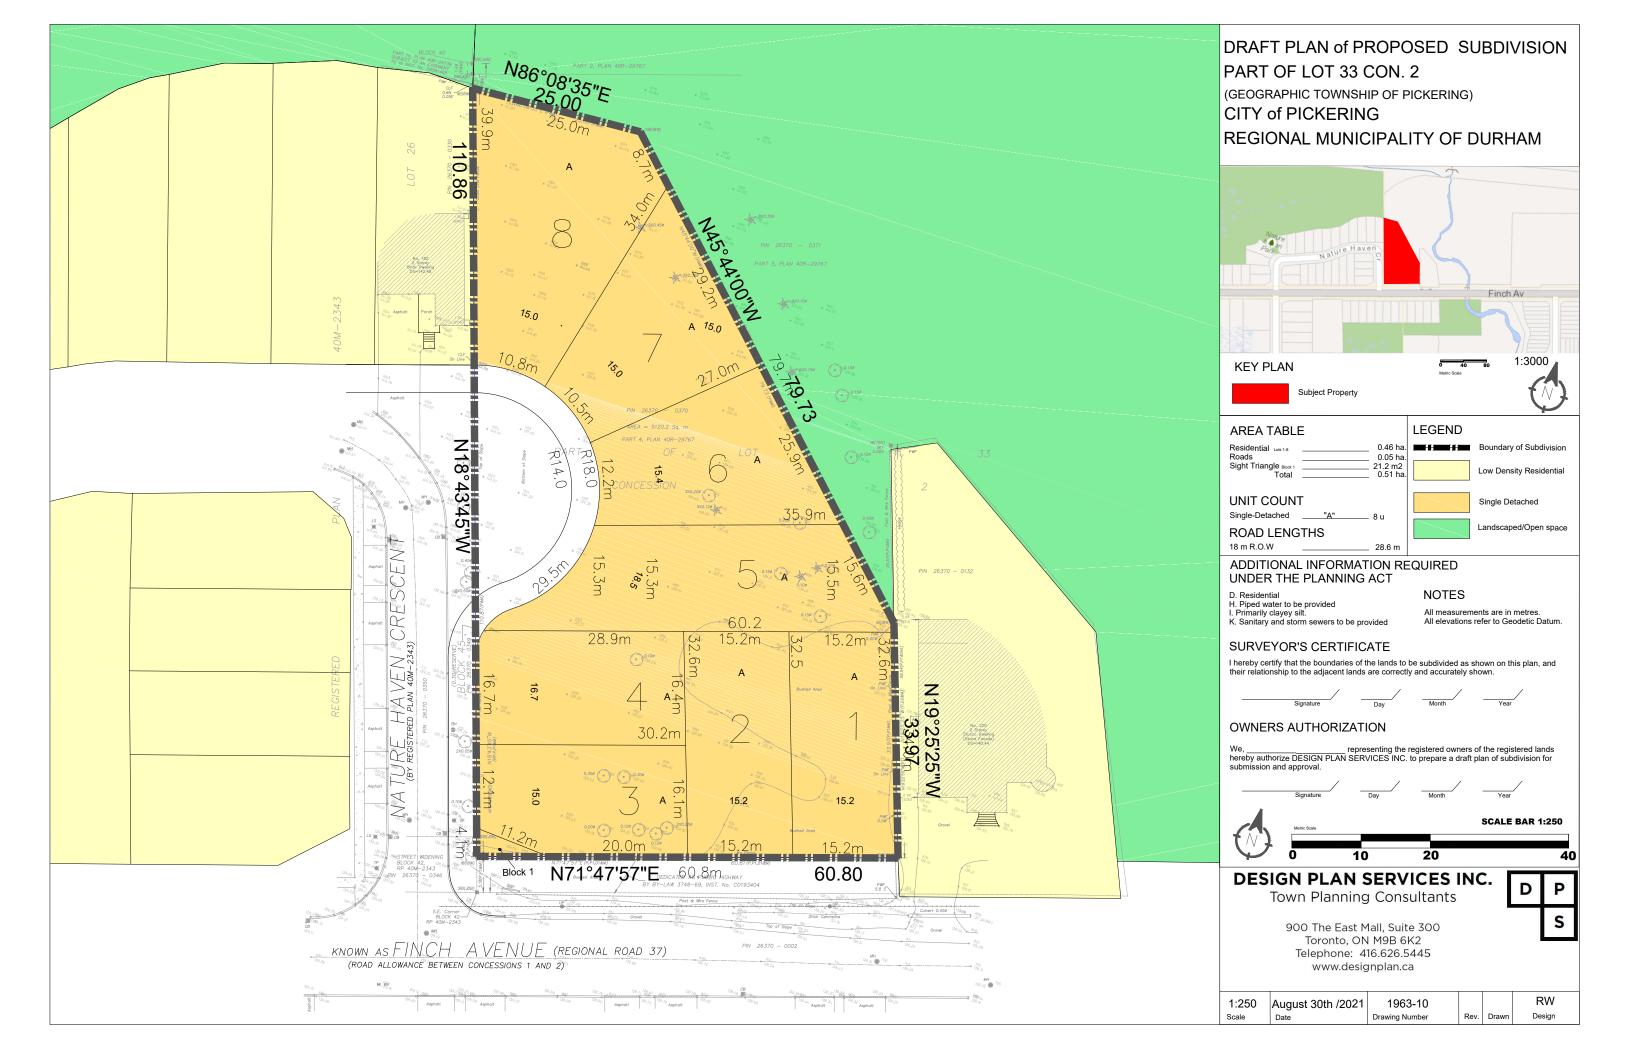



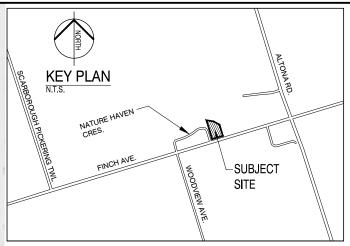

ROAD I	<i>NIDENING</i>			515.18					
BLOCK	1						24.	97	
NET LO	T AREA (A	IINUS ROAD	WIDENING &	BLOCK 1 A	AREA)		4581	1.16	
TOTAL	AREA :						5121.	31m2	
RESIDEN	ITIAL ZONE:					BASED ON "S	3-7 ZONE"		
TOTAL	UNITS					8	SINGLE D	ETACHED	
(MAX U.I	P.H. 0.46379	ha / 8 = 17.2	5)						
LOT No.	MODEL TYPE	LOT AREA (m²)	LOT FRONTAGE (m)	BUILDING HEIGHT (m) 9.0m MAX.	UNIT G.F.A. (m²)	COVERAGE W/ PORCH (m²) 38% MAX.	COVERAGE PERCENTAGE %	LANDSCAPE AREA (m²)	LANDSCAPI PERCENTAGE %
1	MODEL-A	488.78	15.20	9.00	0.000	185.72	38.00	0.000	0.00
2	MODEL-A	488.78	15.20	9.00	0.000	185.72	38.00	0.000	0.00
3	MODEL-C	488.16	15.69	9.00	0.000	185.50	38.00	0.000	0.00
4	MODEL-A	456.32	15.20	9.00	0.000	173.40	38.00	0.000	0.00
5	MODEL-B	711.63	15.05	9.00	0.000	270.41	38.00	000.0	0.00
6	MODEL-D	570.96	15.05	9.00	0.000	216.96	38.00	000.0	0.00
7	MODEL-D	539.49	15.05	9.00	0.000	205.00	38.00	0.000	0.00
8	MODEL-B	837.28	15.09	9.00	0.000	318.16	38.00	0.000	0.00
TOTAL: 3204.63 m2 91.39 m 9.00 m 0.00 m2					1217.71 m2	38.0 m2	0.00 m2	0.0 m2	

NOTES:

ELEVATIONS ARE GEODETIC AND REFERRED TO CITY OF PICKERING B.M. NO. 1-090, ELEVATION = 140.969 M


LEGAL SURVEY INFORMATION AND LOT DIMENSIONS SHOWN ON THIS PLAN ARE TAKEN FROM A PLAN PREPARED BY. ERIL SURVEYORS ONTARIO LAND SURVEYORS WINE-SOLS COM 1250 REID STREET, UNIT 10, RICHMOND HILL LIS 101 TELEPHONE (805) 731-7834 FAX (805) 731-7825 EMAIL INFO@BES-OLS COM DATED. FEB. 23 2018 WHICH MAY NOT BE FINAL AND ARE NOT GUARANTEED. THE FINAL REGISTERED PLAN OF SUBDINISION SHALL BE REFERRED TO FOR CONFIRMATION OF THE DATE.

OF THE DATA

230 Finch Ave-Nature Haven Cres.

GROSS SITE AREA: 5121.31 m²/ 1.265 Ac/ 0.512 Ha



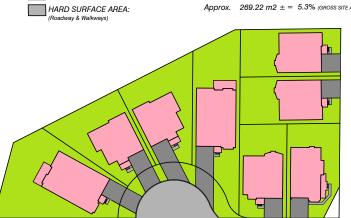

STORM CONNECTION SANITARY CONNECTION WATER CONNECTION HYDRO CONNECTION DOUBLE CATCH BASIN CATCH BASIN STREET LIGHT TRANSFORMER CABLE TV PEDESTAL BELL PEDESTAL ENTRANCE DOOR LOCATION GARAGE DOOR LOCATION COMMUNITY MAILBOX ENGINEERED FILL LOT VALVE AND CHAMBER SANITARY MANHOLE STORM MANHOLE PROPOSED GRADE EXISTING GRADE PROPOSED SWALE GRADE ESTABLISHED GRADE DOWNSPOUT LOCATION SUMP PUMP PROPOSED BERM SWALE DIRECTION © 10 F.FLR. T/WALL F.SLAB HYDRO METER GAS METER MUNICIPAL ADDRESS FINISHED FLOOR ELEVATION TOP OF FOUNDATION WALL FIN. BASEMENT FLOOR SLAB UNDERSIDE FOOTING ELEVATION U/FTG. TPZ FENCE PROPERTY BOUNDRY PRICAST CONCRETE UNIT PAVERS PRECAST CONCRETE PATIO SLABS CHAINLINK FENCE WOOD PRIVACY FENCE / SCREEN SNOW STORAGE AREA

LEGEND


PRELIMINARY

CONTRACTOR SHALL CHECK AND VERFY ALL ENVENIONS AND CONCITIONS ON SITE BEFORE DEEDING WITH CONSTRUCTION. ANY DISCREPANCES SHALL BE REPORTED TO JAPON DESIGN PRICE TO CONVENIONALIZATION OF WINDS.

N DESIGN GROUP INC, HAS NOT BEEN RETAINED TO CARRY OUT GENERAL REMEM OF THE WOR WES NO RESPONSELTLY FOR THE FALLIRE OF THE CONTRACTOR OR SUB-CONTRACTOR TO CO THE WORK IN ACCORDIANCE WITH THE CONTRACT DOCUMENTS.

ORWANG IS AN INSTRUMENT OF SERMOS. IS PROVIDED BY AND IS THE PROPERTY OF JARDIN DESI UPING, THIS DRAINNG IS NOT TO BE SCALED.

NOT TO BE USED FOR CONSTRUCTION





e undersigned has reviewed and takes responsibility for sign and has the qualifications and meets the requireme t out in the Ontario Building Code to be a designer

Valter Botter SIGNATURE CONTEXT SITE PLAN

230 Finch Ave-Nature Haven Cres. (PICKERING)

BILD'

1:250 20-34 A-01

TABLE: A1



571 Chrislea Road, Unit 2, Woodbridge, ON L4L 8A2
Tel: 905-264-0054 Fax: 905-264-0069 info@valdor-engineering.com
www.valdor-engineering.com

EQUIVALENT POPULATION

Project Name: Proposed Residential Development, City of Pickering

File: 17149

Date: February 2025

Unit Type	Population Density Residential Units		Commercial Floor Area (sq.m)	Equivalent Population	
Detached Dwelling	3.5 persons per unit	8		28.0	
Total:		8	0.00	28.0	

APPENDIX "B"

Water System Calculations & Details



VALDOR ENGINEERING INC.
571 Chrislea Road, Unit 4, Woodbridge, ON L4L 8A2
Tel: 905-264-0054 Fax: 905-264-0069 info@valdor-engineering.com www.valdor-engineering.com

WATER DEMAND CALCULATION

TABLE: B1

Project Name: Propsoed Residential Development, City of Pickering

File: 17149

Date: February 2025

Critera:

Eqv. Population Base Dema				Peaking Factors		
				Max Day	2.00	
Residential	28.0	364	L/capita/day	Peak Hour	3.00	

Demand:

	Average Day (L/day)	Average Day (L/min)	Max Day (L/min)	Peak Hour (L/min)	
Residential	10,192	7.1	14.2	21.2	
Total	10,192	7.1	14.2	21.2	

File: 17149 February 2025

CALCULATION OF REQUIRED FIRE FLOW

TABLE: B2

In accordance to Water Supply for Public Fire Protection, Fire Underwriters Survey 1999


Project Name: Proposed Resident	ial Development, City o	f Pickering	Notes: L	ot 4
File: 17149	• • •		_	Detached Dwelling
Date: December 2021			_	
Type of Construction -	Ordinary Construction		_	
C =	1.0		_	
Total Floor Area:	3,186	sq.ft.	_	
Total Floor Area:	296.0	sq.m	_	
A =	296.0	sq.m		
(Total Floor Area include	es all storeys, but excludes b	asements at le	east 50 percent	below grade)
F =	$220 C \sqrt{A}$			
F =	107/22/2019	L/min		
F =			1,000 Lmin)	
Occupancy Factor		Charge		
• •	Limited Combustible	-15%		
21	$f_I =$			
Sprinkler Credit				
		Charge		
NFPA 13 Sprinkler Standard:	NO	0%		
Standard Water Supply:	NO	0%		
Fully Supervised System:	NO	0%		
Total Charge to Fire Flow:	$f_2 =$	0%		
F' =	$F \times (1+f_1) \times (1+f_2)$			
F' =	3,400	L/min		
Exposure Factor		Charge		
North Side - Distance to Building (m):	3.1 to 10m	20%		
East Side - Distance to Building (m):	10.1 to 20m	15%		
South Side - Distance to Building (m):	0 to 3m	25%		
West Side - Distance to Building (m):	30.1 to 45m	5%		
	$f_3 =$	65%	(maximum o	of 75%)
F'' =	$F' \times (1+f_3)$			
F'' =	5,610	L/min		


REQUIRED FIRE FLOW

F'' = 6,000 L/min (to nearest 1,000 L/min)



Regional Municipality of Durham Works Department Municipal Drinking Water Supply System (DWS)

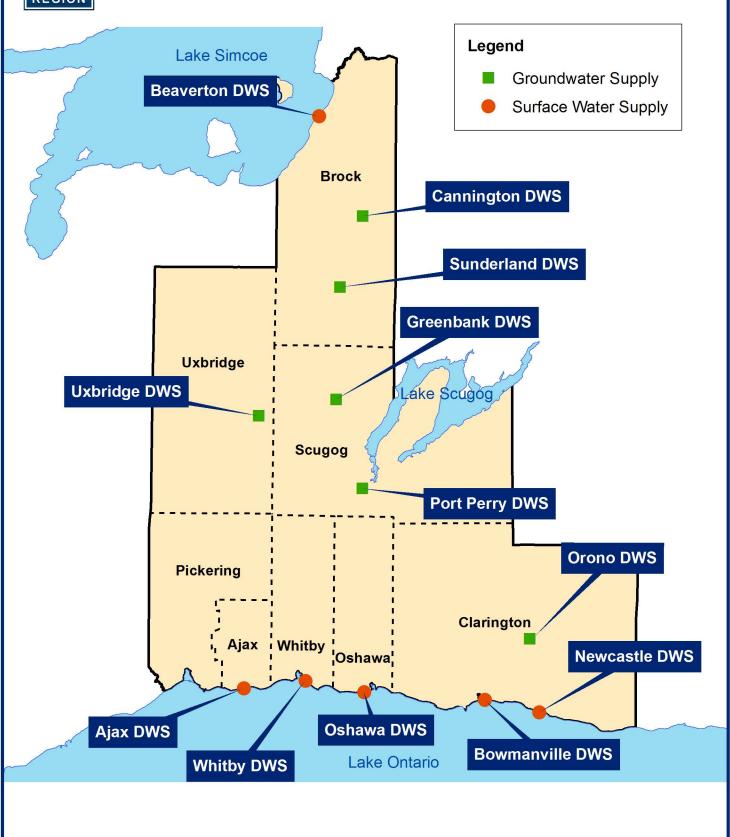

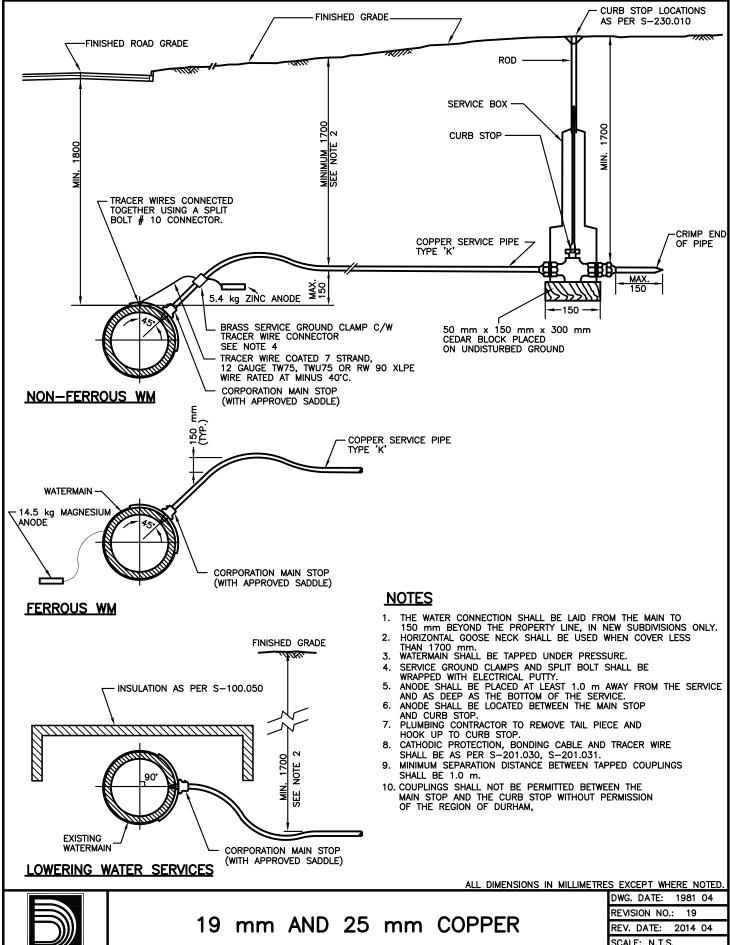


DURHAM WORKS DEPARTMENT


WATER SERVICE

SCALE: N.T.S.

S-230.020

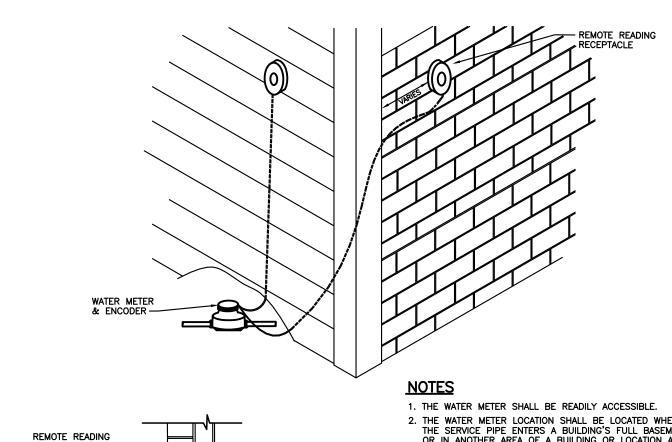

- 2. THE WATER METER LOCATION SHALL BE LOCATED WHERE THE SERVICE PIPE ENTERS A BUILDING'S FULL BASEMENT OR IN ANOTHER AREA OF A BUILDING OR LOCATION APPROVED BY THE REGION OF DURHAM.
- 3. WATER METERS SHALL BE INSTALLED, SEALED, REPLACED MAINTAINED, REPAIRED, TESTED, INSPECTED AND REMOVED ONLY BY EMPLOYEES OR AGENTS OF THE REGION OF DURHAM.
- A FULL PORT, STOP AND WASTE CORPORATION VALVE (GATE OR BALL TYPE) ON THE INLET SIDE OF A WATER METER SHALL BE INSTALLED.
- 5. SELECT A LOCATION FOR THE RECEPTACLE WHICH IS AS CLOSE AS POSSIBLE TO THE METER AND WHICH PROVIDES A SUITABLE POINT FOR A DRILLED HOLE. LOCATION OF RECEPTACLE SHOULD BE ACCESSIBLE, PREFERABLY BESIDE AN ELECTRIC OR GAS METER ON THE DRIVEWAY SIDE OF THE BUILDING.
- 6. IF THE 2 WIRE RECEPTICAL—TO—ENCODER CABLE RUNS NEAR OR INTO THE GROUND, PROTECT IT FROM LAWN MAINTENANCE EQUIPMENT BY PLACING THE WIRE INSIDE A PIECE OF PVC PIPE. ANCHOR THE PIPE INTO THE GROUND AND STRAP IT TO THE MOUNTING SURFACE.
- 7. PROVIDE 1.0 m EXCESS WIRE AT EACH END FOR SUBSEQUENT HOOKUP AT RECEPTACLE AND AT METER.
- -22 GAUGE 8. STEEL PIPE OF ANY TYPE SHALL NOT BE USED AS A SPACER PRIOR TO THE WATER METER BEING INSTALLED.

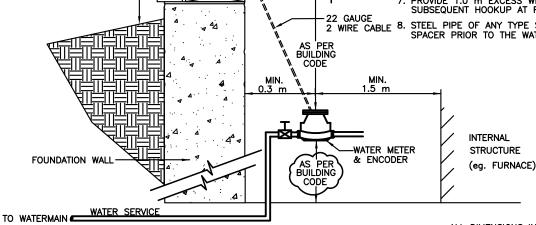

ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED



RECEPTACLE

DRILL 5 mm HOLE WITH UPWARD SLANT TO BE SEALED WITH SILICONE

l٤ 1.2

> METER, VALVE, PRO READ ARB RECEPTACLE AND WIRE INSTALLATION

DWG. DATE: 1995 02 REVISION NO.: REV. DATE: 2013 04 SCALE: N.T.S.

S-240.010

APPENDIX "C"

Wastewater Calculations & Details



/ALDOR ENGINEERING INC.



571 Chrislea Road, Unit 4, Woodbridge, ON L4L 8A2 Tel: 905-264-0054 Fax: 905-264-0069 info@valdor-engineering.com www.valdor-engineering.com

WASTEWATER LOADING CALCULATION

Project Name: Proposed Residential Development, City of Pickering

File: 17149

Date: February 2025

Criteria:

Peak flow design parameters


Avg. Flow Rate (Residential): 364 L/person/day


Infiltration Rate: 0.26 L/s/ha

Residential Peaking Factor: $1 + (14 / (4+(P/1000)^{\circ}0.5))$ where P is population in thousands


(Min = 1.5, Max = 3.8)

		Residential					
	Site	Equivalent	Average	Peaking	Peak	Infiltration	Total
	Area	Population	Flow	Factor	Flow		Peak
							Flow
	(ha.)		(L/s)		(L/s)	(L/s)	(L/s)
	0.510	28.0	0.118	3.80	0.45	0.133	0.58
TOTAL	0.510	28.0					0.58

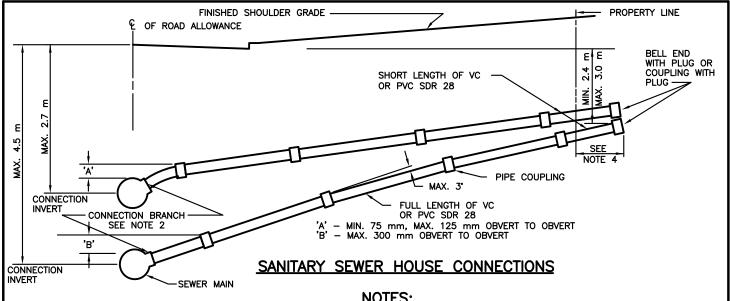


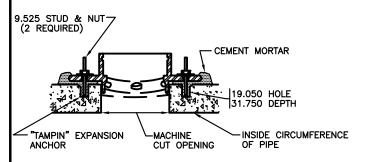

MORTAR-ON SADDLES FOR CONCRETE MAINS OVER 450 mm DIAMETER








CAST-IRON SADDLE BRANCH FOR CONNECTION TO EXISTING MAINS OTHER THAN PVC

NOTES:

- IN NEW SUBDIVISIONS THE SANITARY SEWER AND WATER SERVICE CONNECTIONS SHALL BE INSTALLED IN SEPARATE TRENCHES. IN CASES WHERE THE SEPARATE TRENCH INSTALLATION IS
- IN CASES WHERE THE SEPARATE TRENCH INSTALLATION IS NOT PRACTICAL, SANITARY SEWER AND WATER SERVICE CONNECTIONS MAY BE INSTALLED IN A COMMON TRENCH AS PER DETAIL 'A'. IN NEW SUBDIVISIONS ALL CONNECTIONS TO THE SEWERS ARE TO BE MADE WITH A FACTORY MANUFACTURED 'T'. FOR CONNECTIONS TO EXISTING SANITARY SEWERS, OTHER THAN PVC A SADDLE CONNECTION MAY BE USED. MORTAR—ON SADDLES SHALL BE USED ON CONCRETE PIPE GREATER THAN 450 mm DIAMETER. CONNECTIONS TO EXISTING PVC SEWERS SHALL BE MADE WITH A FACTORY MANUFACTURED TEE OR AN APPROVED SADDLE. CONNECTIONS TO EXISTING A.B.S. TRUSS PIPE SHALL BE MADE WITH A SOLVENT WELDED SADDLE. A FACTORY MANUFACTURED THE OR AN APPROVED SADDLE SHALL BE USED IN THE FIRST UPSTREAM LEG FOR ALL SEWER CONNECTIONS.
- 45° STRAP ON SADDLE SHALL BE USED ON SEWERS OTHER THAN PIPE, WHEN LATERAL INTERSECTS SEWER MAIN AT AN ACUTE ANGLE
- THE SEWER CONNECTION SHALL BE LAID FROM THE MAIN TO 1.5 m BEYOND THE PROPERTY LINE IN NEW SUBDIVISIONS ONLY.
- THE END OF ALL SEWER PIPE SHALL BE MACHINED. ALL CUTTING AND MACHINE SHALL BE DONE BY CONTRACTOR.
 A COUPLING SHALL BE INSTALLED AT DEAD END AND SHALL BE
- PLUGGED USING A WATER TICHT PLUG.
 DEFLECTIONS OF PIPE AT JOINTS IS NOT TO EXCEED 75 mm
 I.E.: 150 mm MAXIMUM DEFLECTION FOR A 3 m LENGTH OF ASBESTOS CEMENT PIPE 75 mm MAXIMUM DEFLECTION FOR 1.8 m LENGTH OF VETRIFIED CLAY PIPE
- PIPE COUPLING SHALL BE 'RING-TITE' OR EQUIVALENT. PVC SHALL BE BELL AND SPIGOT JOINT.
- REFER TO STD. S-200.010 FOR BEDDING REQUIREMENTS.
- WHEN MORTAR-ON SADDLES ARE USED, A MACHINE CUT OPENING SHALL BE MADE IN THE SANITARY SEWER WITH A CORING MACHINE. 10.
- 2% MIN. GRADE TO 10% MAX. GRADE FOR 100 mm DIA. PIPE.
- 1% MIN. GRADE TO 10% MAX. GRADE FOR 150 mm DIA. PIPE.



MIN. 75 mm, DEPTH OF BEDDING BELOW PIPE. OUTSIDE DIAMETER MINIMM WIDTH OF

Bd

TRENCH Bc + 600 mm WITH MIN. OF 900 mm OR Bc + WIDTH OF SHORING + 600 mm

COMMON TRENCH DETAIL

ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED



SANITARY SEWER HOUSE CONNECTIONS AND SADDLES (100 mm & 150 mm PIPE)

DWG. DATE: 1981 04 REVISION NO.: REV. DATE: 2013 04 SCALE: N.T.S.


S-100.010

APPENDIX "D"

Watershed Map, Regulation Map & IDF Data



WATERSHED MAP

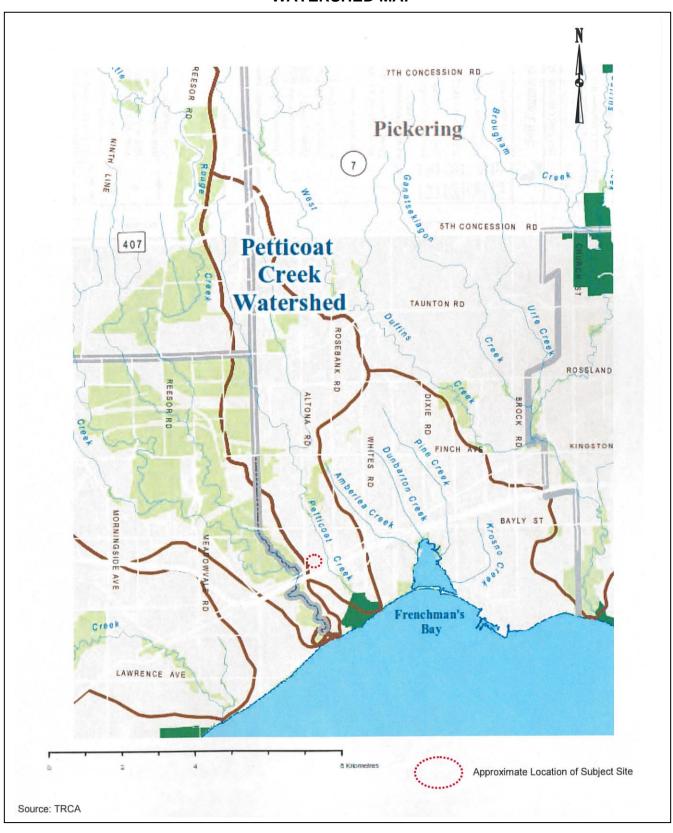

TRCA REGULATION MAPPING



City of Pickering IDF Curve Parameters

Darameter	Return Period							
Parameter	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year		
Α	715.076	1082.901	1313.979	1581.718	1828.009	2096.425		
В	5.262	6.007	6.026	6.007	6.193	6.485		
С	0.815	0.837	0.845	0.848	0.856	0.863		

Rainfall Intensity, I (mm/hr) = A/(t+B)^C, where t is time duration in minutes IDF Data Source: Toronto City (1940-2007)

City of Pickering Rainfall Intensity


Rainfall Intensity (mm/hr)


Return	Duration (min)								
Period	5	10	15	30	60	120	360	720	1440
2 Year	109.2	76.1	61.7	39.1	23.8	14.0	5.7	3.4	1.9
5 Year	151.9	101.6	85.0	54.6	32.6	18.7	7.6	4.4	2.5
10 Year	180.1	118.5	100.5	64.9	38.5	21.8	8.9	5.1	2.8
25 Year	215.8	139.8	120.1	77.9	45.9	25.7	10.4	6.0	3.3
50 Year	242.3	155.7	134.6	87.5	51.4	28.7	11.6	6.6	3.6
100 Year	268.5	171.4	148.9	97.0	56.8	31.6	12.8	7.2	3.9

City of Pickering Rainfall Depth

Rainfall Depth (mm)

						<u> </u>			
Return	Duration (min)								
Period	5	10	15	30	60	120	360	720	1440
2 Year	9.1	12.7	15.4	19.5	23.8	27.9	34.5	41.1	45.9
5 Year	12.7	16.9	21.3	27.3	32.6	37.4	45.8	53.2	59.0
10 Year	15.0	19.7	25.1	32.4	38.5	43.6	53.2	61.3	67.6
25 Year	18.0	23.3	30.0	38.9	45.9	51.5	62.7	71.4	78.5
50 Year	20.2	25.9	33.6	43.7	51.4	57.3	69.7	79.0	86.7
100 Year	22.4	28.6	37.2	48.5	56.8	63.1	76.6	86.5	94.7

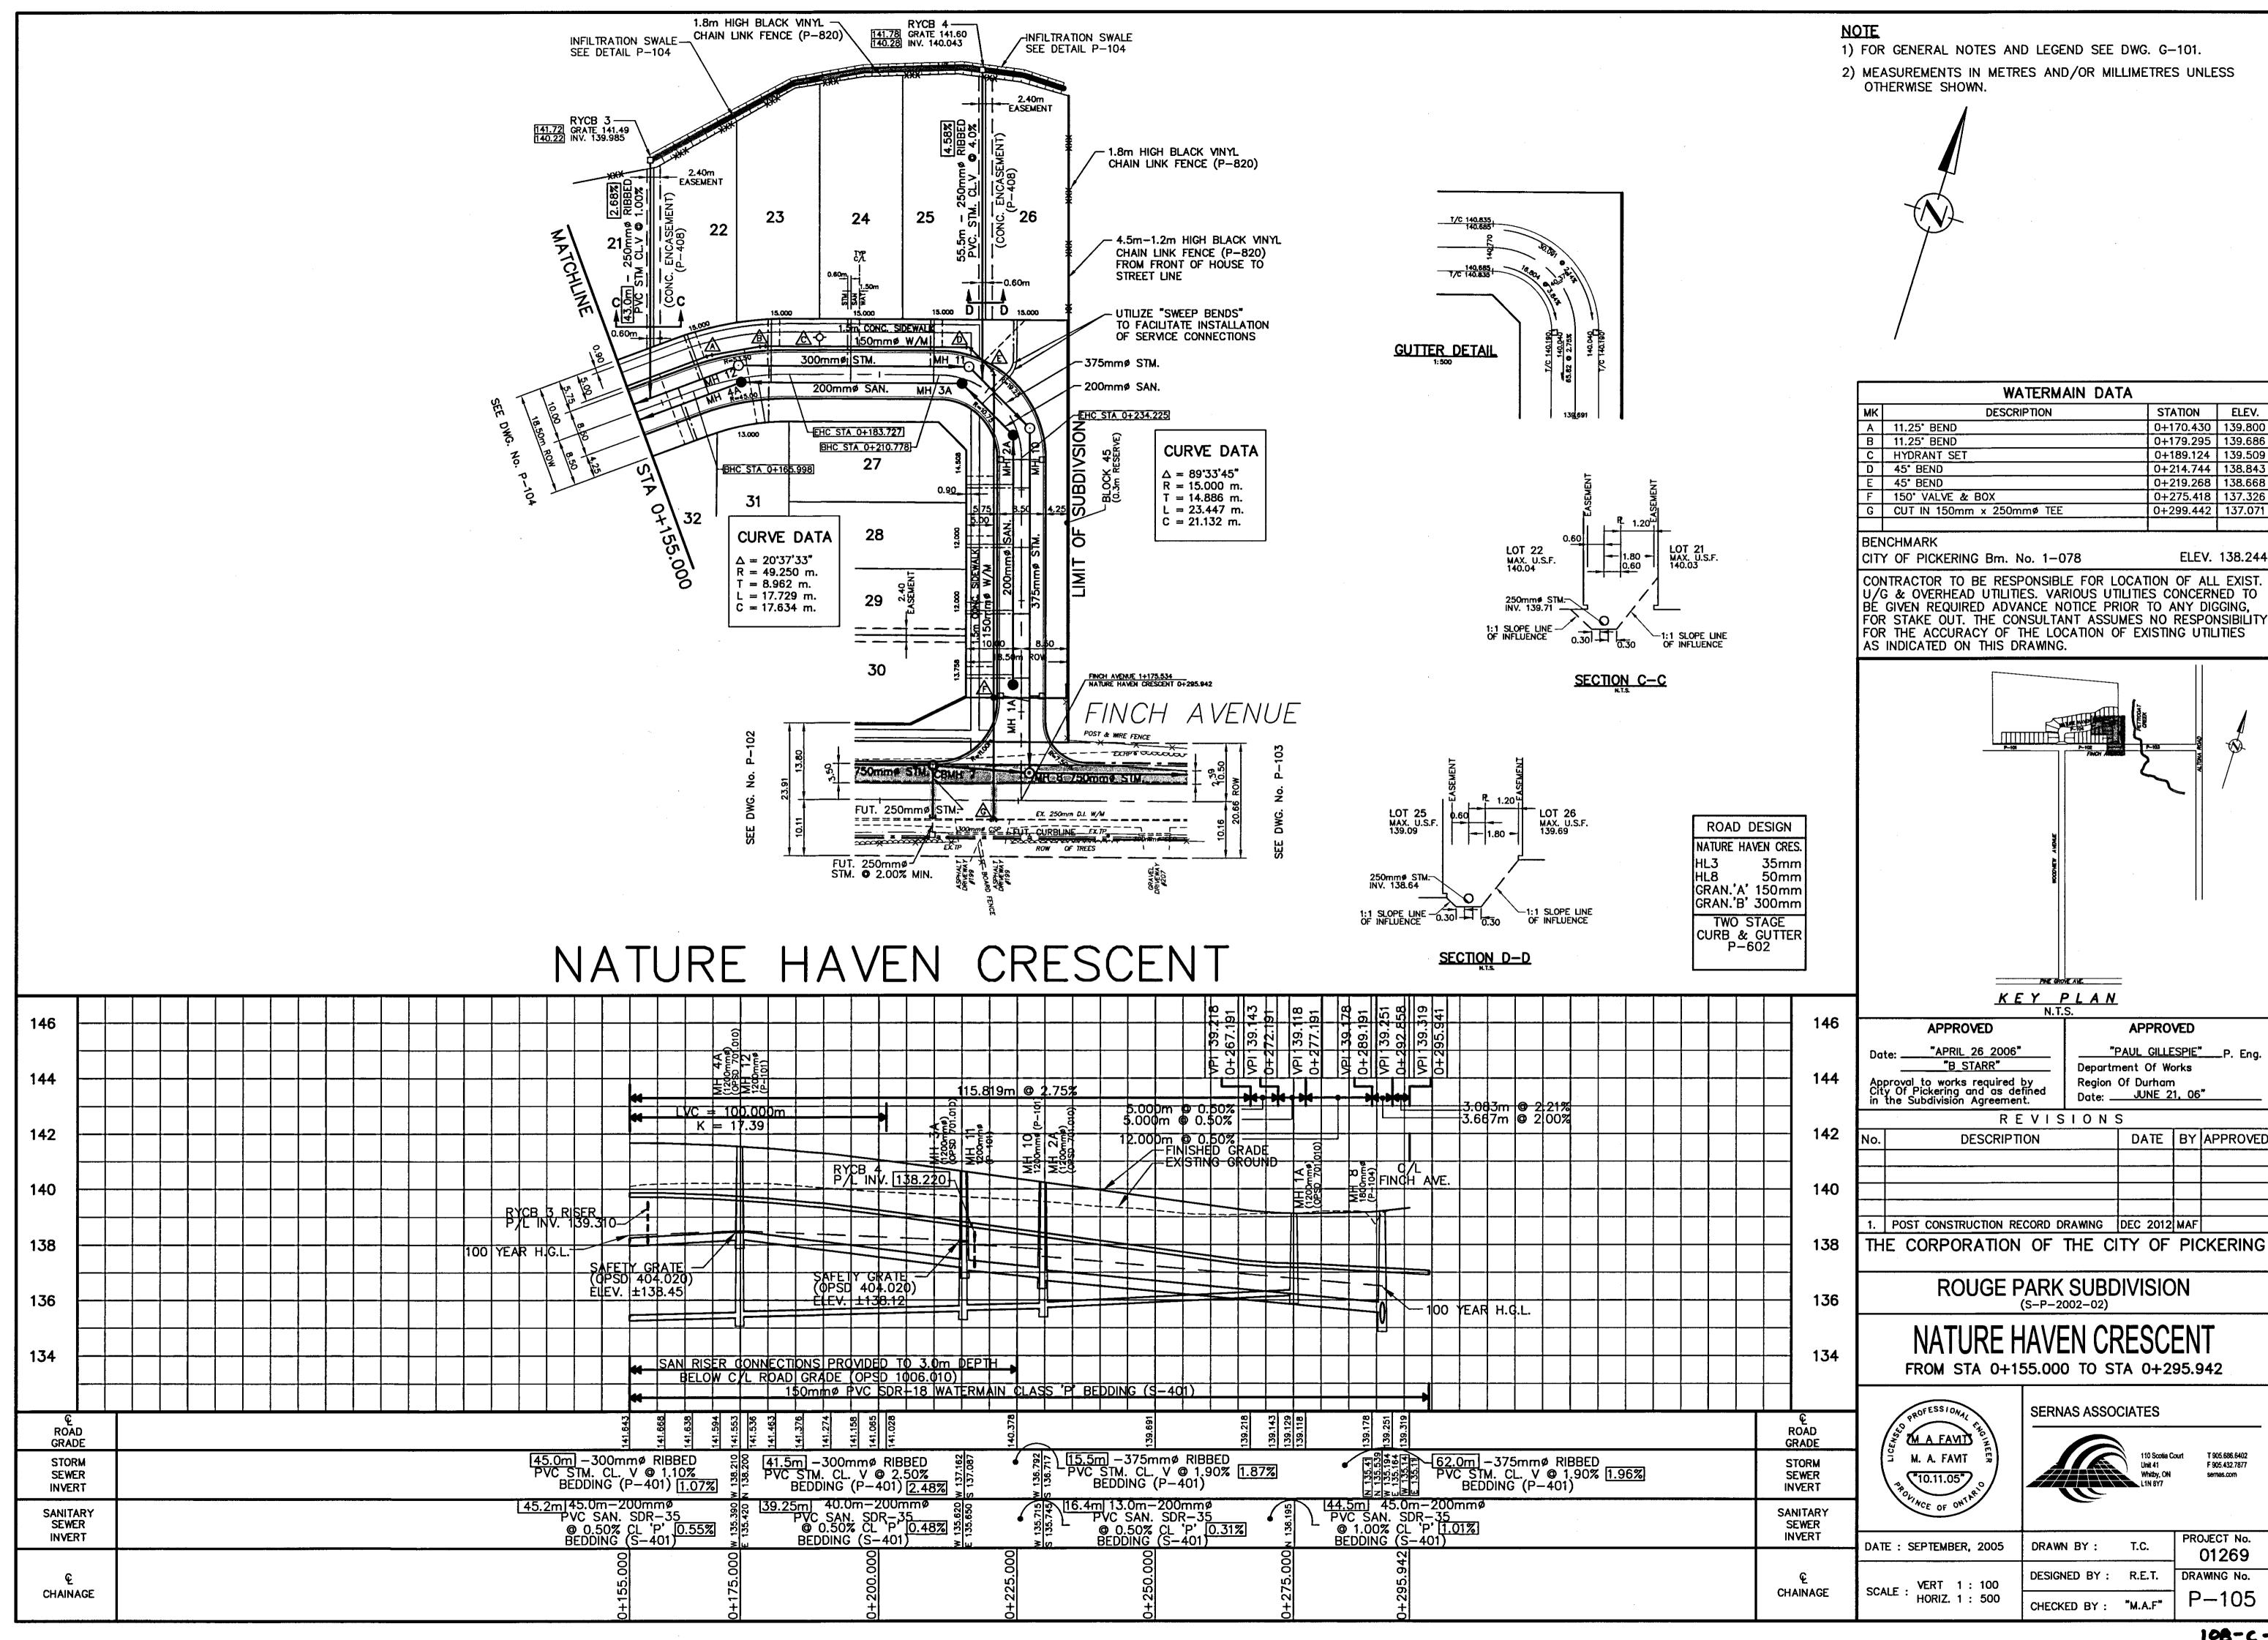

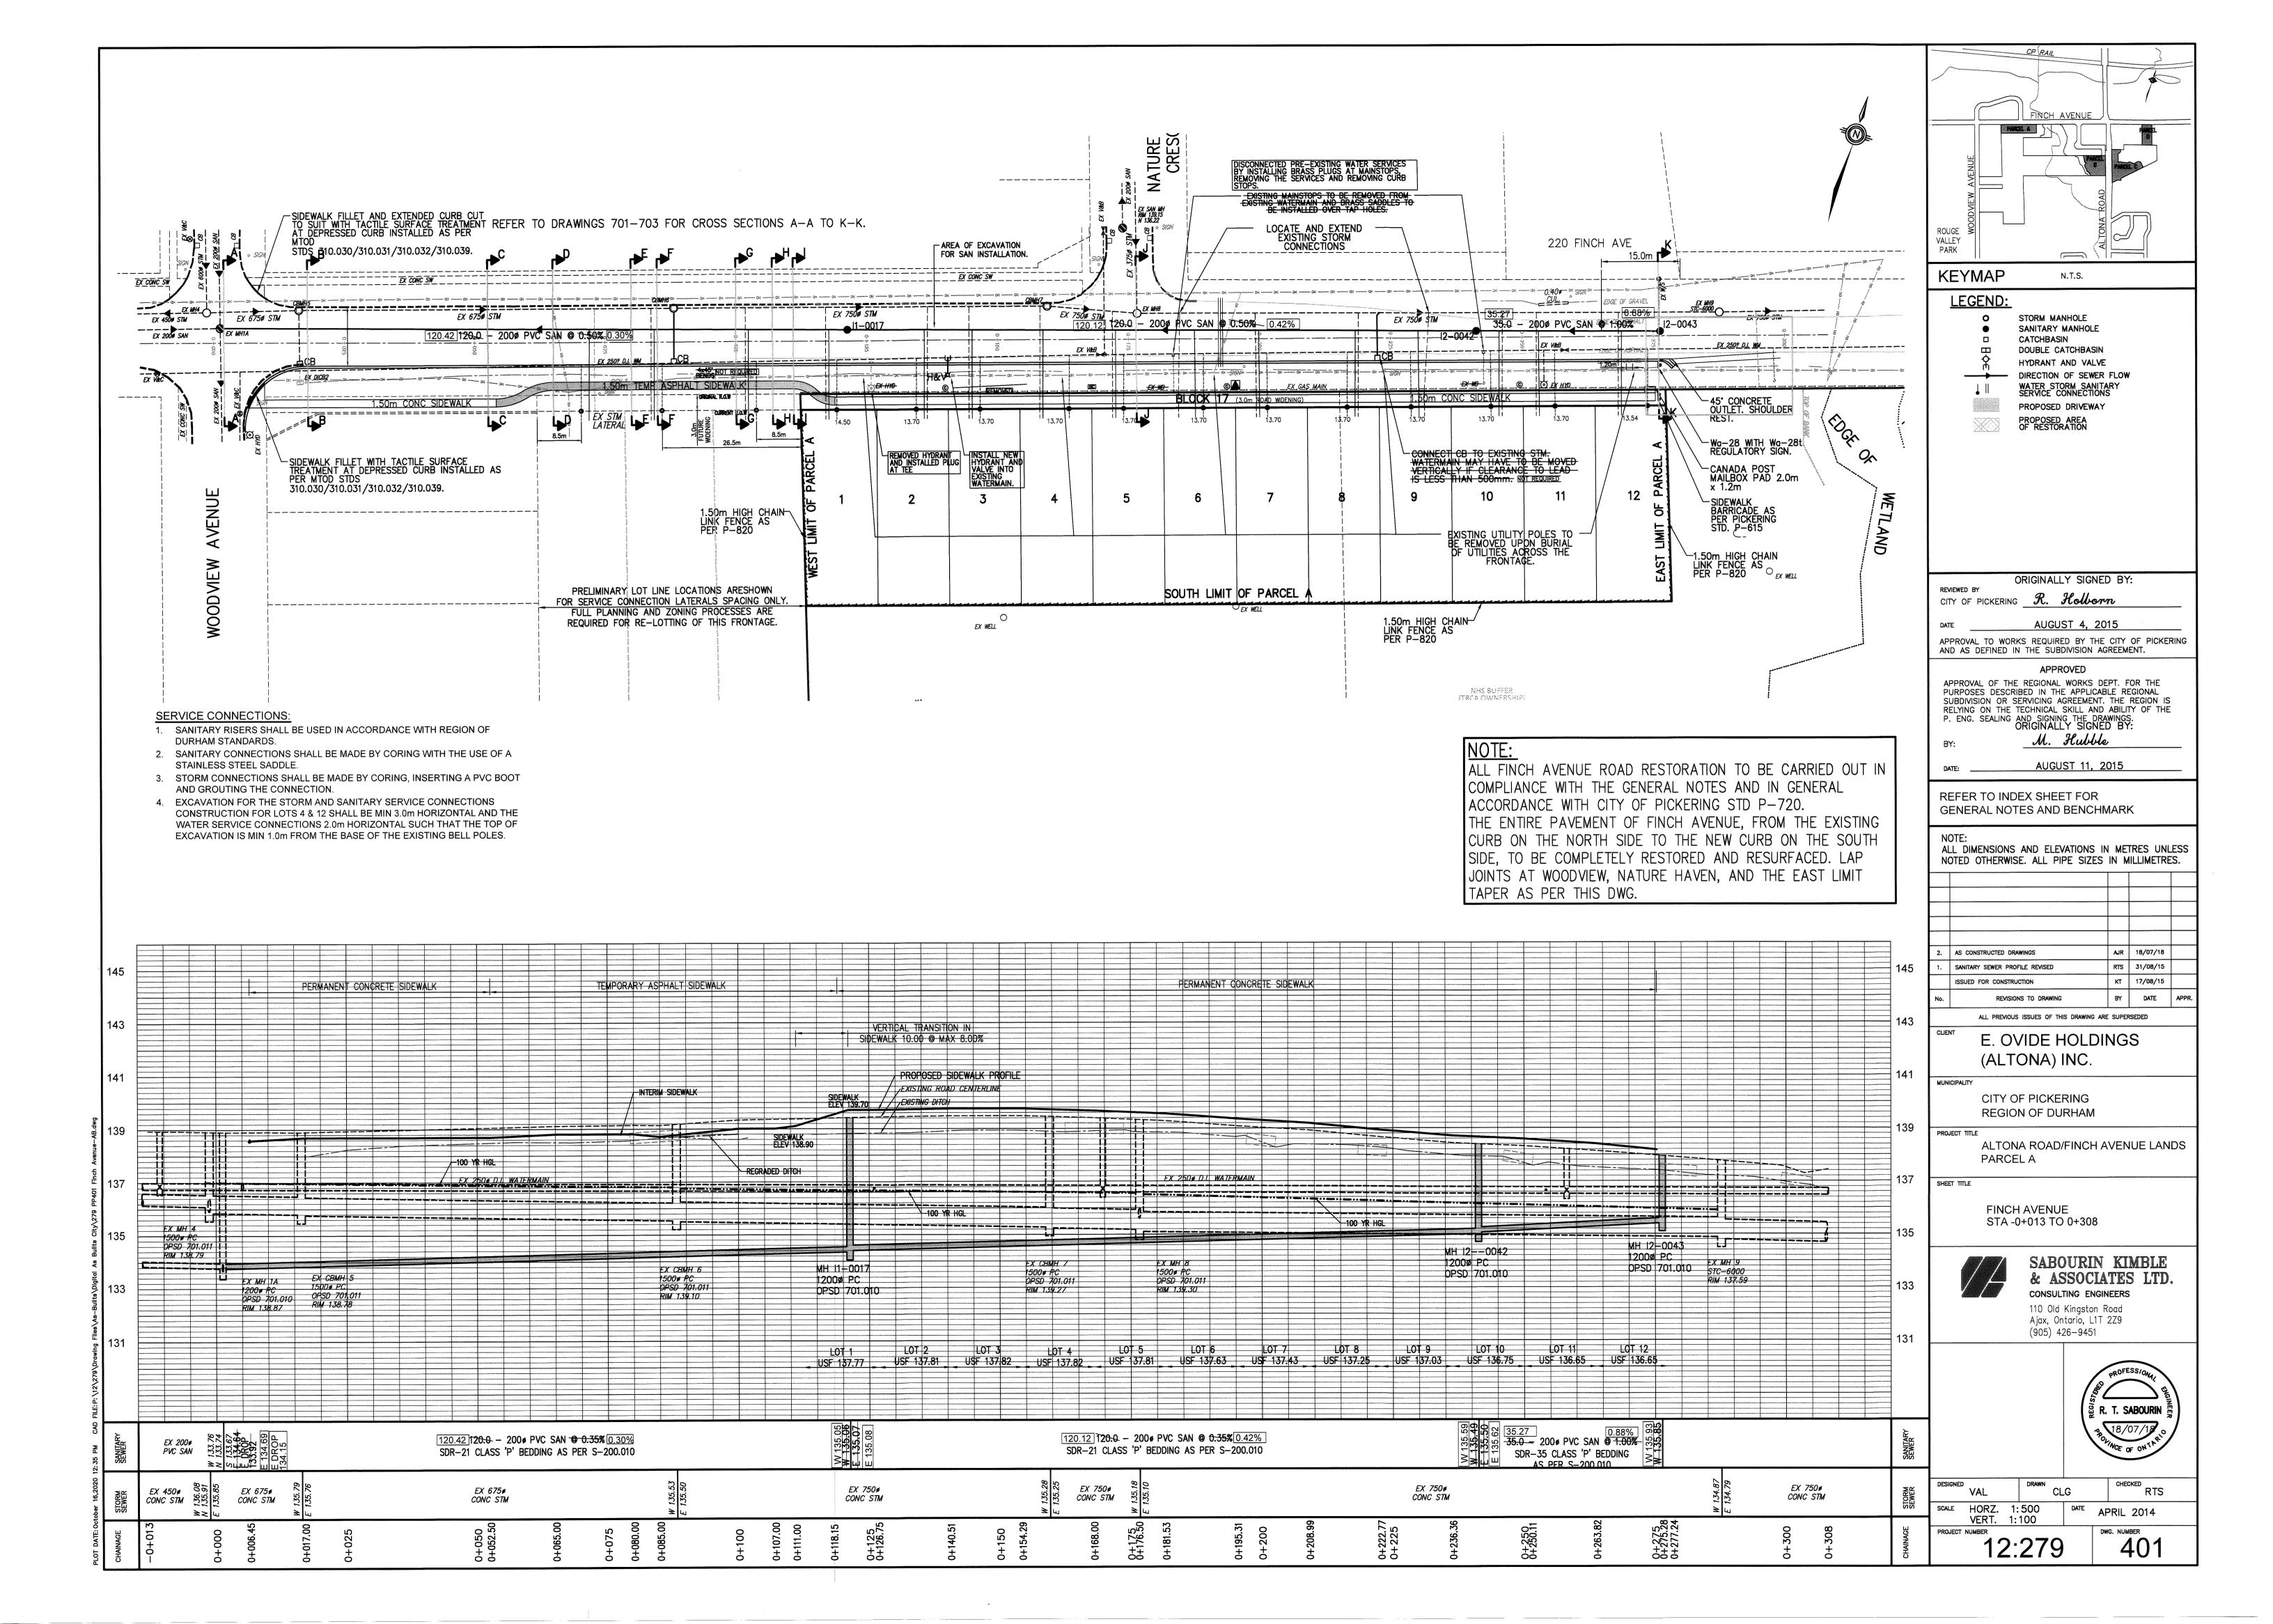



MEMORANDUM

TO:	Nick Lorrain	DATE:	April 29, 2022		
FROM:	Qiao Ying	CFN:			
RE:	City of Pickering – Finch Ave and Altona Rd spill 2D Modelling				
CC:					

1.0 Introduction

The following presents the Pickering Finch Ave/Altona Rd 2D modelling analysis completed in support of NDMP Intake 6 TRCA jurisdiction-wide spill analysis. The subject study area is located between Finch Ave and Sheppard Rd in Petticoat Creek within City of Pickering as shown in **Figure 1**.



Figure 1 Subject study area in City of Pickering

April 29, 2022 Page 2 of 25

1.1 Background

A floodplain mapping study was completed for this area as part of Petticoat Creek FPM in September 2006 by Planning & Engineering Initiatives Ltd., and four spills were identified within study area (see **Figure 2**). Based on the latest topographic data, spills may go multiple directions, given this 1D HEC-RAS model is not applicable and a 2D modelling approach is more suitable to capture the spill and characterize flood conditions within the study area.



Figure 2 Location of identified spills in the Hwy 400/Hwy 7 study area

2.0 Additional Background Information

Since last update, TRCA has obtained two sets of jurisdiction-wide Lidar data, i.e., 2015 Lidar (leaf-off) and 2019 Lidar (leaf-on) data. In addition to these two data sets several new information was collected for this study including:

- TRCA Survey Data
 - TRCA conducted survey in the study area as part of Amos Pond Turtle Study in August 2014 (see **Figure 3**), and this survey data includes ground elevation survey within the wetlands and at few locations on Finch Ave./Woodview Ave. along with crossing information (i.e. dimension, invert and obvert elevations) on West Branch of Petticoat Creek.
 - This survey data was compared to both 2015 Lidar and 2019 Lidar (see **Figure 4**), and it was found that the 2015 Lidar data matches better with TRCA survey data. Also considering 2015 Lidar data was obtain during leaf-off season, and it would capture ground elevation better in the vegetation covered area than 2019 Lidar data. Given this, the decision on topographic data for this study was to use 2015 Lidar as base and then splice in any grading changes since 2015 within study area. **Figure 5** shows the

Page 3 of 25

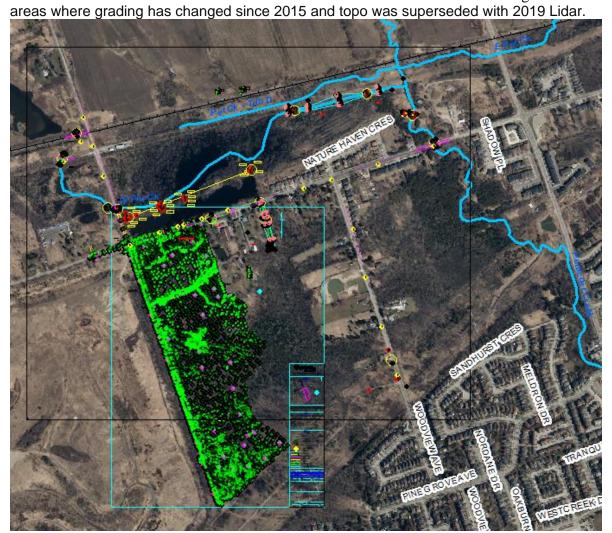


Figure 3 TRCA Survey - Amos Pond Turtle Study in August 2014

Comparison of TRCA Survey and 2015 Lidar

Comparison of TRCA Survey and 2019 Lidar

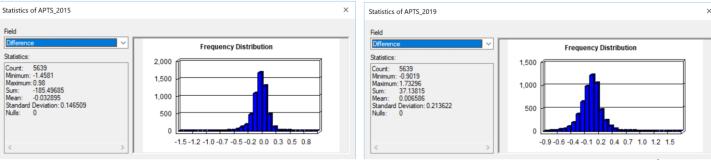


Figure 4 Comparison of TRCA Survey with both 2015 Lidar and 2019 Lidar at Amos Pond in City of Pickering

April 29, 2022 Page 4 of 25



Figure 5 2019 Lidar Spliced Areas

New crossing data on Altona Rd cross East Branch of Petticoat Creek
 A new relief box-culvert was installed on Altona Road in addition to the existing pipe arch CSP pipe (see Figure 6) with a dimension of 2.4m by 1.5m.



Figure 6- Location of a new relief box-culvert on Altona Road

Grading change - Forest District by Icon Homes
 On north-west corner of Finch Ave./Altona Rd, grading has changed due to a townhouse development.
 A CAD drawing with ground elevations were obtained (see Figure 7) which was used to derived a surface and then supersede 2015 Lidar within the site.



Figure 7 – Location of Forest District and CAD drawing with ground elevations

Grading change – 1999 & 1985 Altona Rd
 On south-east corner of Finch Ave./Altona Rd, a new development application has been approved but
 not yet constructed. A CAD drawing with ground elevations were obtained (see Figure 8) which was
 used to derive a surface and then supersede 2015 Lidar within the site.

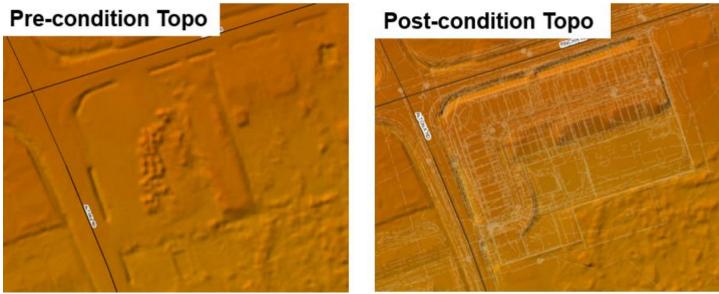


Figure 8 – Location of 1999&1985 Altona Rd and CAD drawing with ground elevations

April 29, 2022 Page 6 of 25

3.0 Model Setup

The study area was modelled using the MIKE Flood interface that features the dynamic coupling of the MIKE HYDRO and MIKE 21 hydrodynamic modules. River reaches and all crossings were handled using the 1D MIKE HYDRO modelling routine, with overland surfaces being modelled using the 2D MIKE 21 modelling routine. MIKE Flood integrates these two models into a single dynamically coupled model.

Figure 9 shows the Finch/Altona 2D model domain. The downstream boundary was set as a Q-H relation that was taken from cross-section 2869.24 located on Reach 3 of Petticoat Creek from the HEC-RAS model developed by TRCA as part of the 2021 Petticoat Creek Floodplain Mapping Update.



Figure 9 Finch Ave./Altona Rd 2D Model Domain

3.1 MIKE HYDRO 1D River Model

Six river reaches are modeled using the MIKE HYDRO 1D hydrodynamic (HD) module, and **Table 1** summarizes the list of modeled reaches and respective length.

Table 1 List of Branches Included in 1D Model

No.	Reach Name	Length (m)
1	East Petticoat – Trib A	410.31
2	East Petticoat – Trib C	1592.15
3	East Petticoat – Trib D	716.74
4	East Petticoat	1995.36
5	West Petticoat	1306.73
6	Petticoat Creek	5145.57

Cross-sections are cut in 10-20m spacing from 1-m 2015 LiDAR spliced with 2019 Lidar for grading change areas and only cover the main channel, i.e., upto top of bank as overbank areas are modeled in 2D domain. High density of spacing of cross-sections allows better capturing details of riverbanks where lateral exchange flows with 2D domain occur. In total thirteen (13) crossings were included in 1D model, and crossing was coded as a composite structure. i.e., crossing opening was coded as Culvert structure and road deck was coded as Weir structure. **Figure 10** uses Railway crossing on Petticoat Creek to show an example how a crossing is coded in 1D model, and **Figure 11** shows cross-sections and location of structures included in the 1D MIKE HYDRO model.

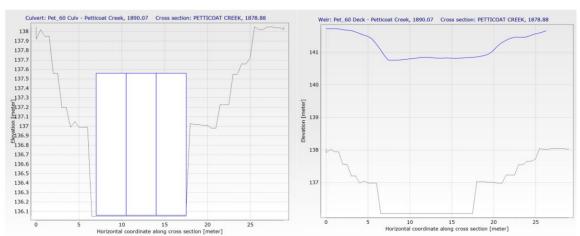


Figure 10 - Example of a composite structure of a Culvert Structure and a Weir Structure

April 29, 2022 Page 8 of 25

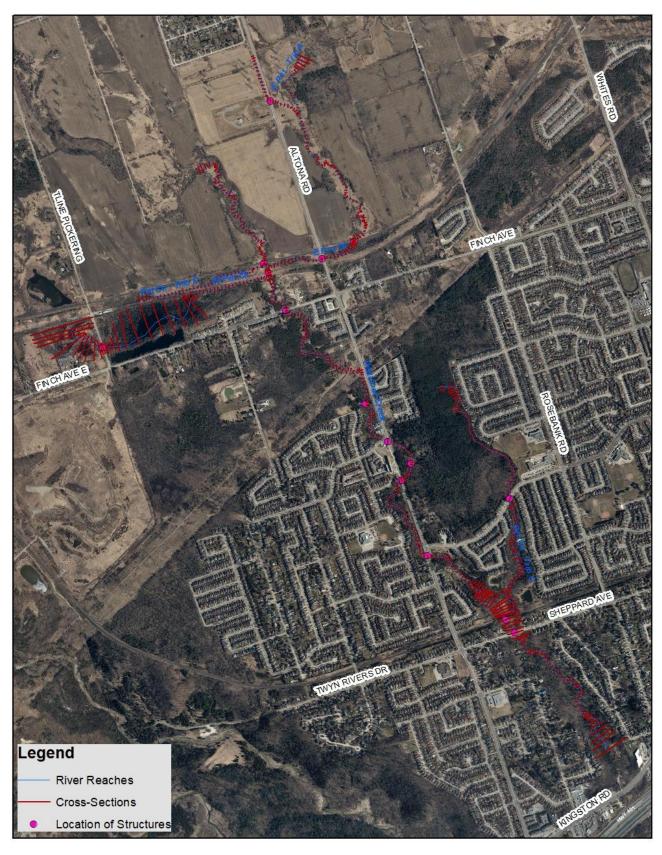


Figure 11 Location of 1D cross-sections and structures

Boundary Condition

All inflows are handled in 1D model, and total flows are entered at the beginning of 6 reaches, and incremental flows are entered as a point source along the reaches and the steady peak flows were ramped for 1hr and then kept constant for 13hrs (see **Figure 12**). Downstream boundary is a Q-H boundary that was extracted from 2021 Petticoat Creek HEC-RAS model as mentioned above. **Table 2** summarizes boundaries and their types, and **Figure 13** shows the location of flow nodes.

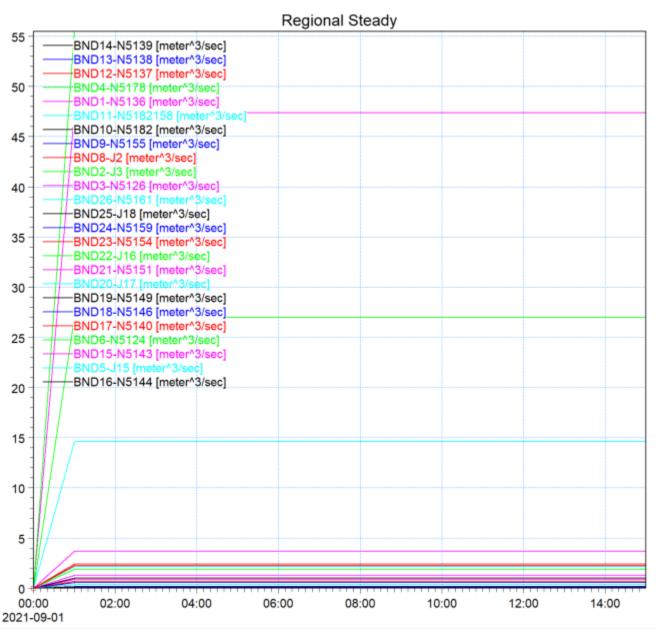


Figure 12 Regional peak flows applied in the 1D MIKE HYDRO model

April 29, 2022 Page 10 of 25

Table 2 Boundary Conditions in 1D Model

Boundary ID	Flow Nodes	Boundary Type	Branch Name	Chainage (m)
Boundary 1	N5136	Total Inflow	E Pet - Trib A	12.25
Boundary 2	J3	Total Inflow	Pet Ck - Trib C	0
Boundary 3	N5126	Total Inflow	Pet Ck - Trib D	0.21
Boundary 4	N5178	Total Inflow	E Pet Ck	14.12
Boundary 5	J15	Total Inflow	W Pet Ck	398.11
Boundary 6	N5124	Total Inflow	Petticoat Creek	871.94
Boundary 7		Q-H	Petticoat Creek	6017.51
Boundary 8	J2	Point source	Pet Ck - Trib C	220
Boundary 9	N5155	Point source	Pet Ck - Trib C	660
Boundary 10	N5182	Point source	Pet Ck - Trib C	891.61
Boundary 12	N5137	Point source	E Pet Ck	457.53
Boundary 13	N5138	Point source	E Pet Ck	1475.2
Boundary 14	N5139	Point source	E Pet Ck	1695.4
Boundary 15	N5143	Point source	W Pet Ck	674.85
Boundary 16	N5144	Point source	W Pet Ck	1365.18
Boundary 17	N5140	Point source	Petticoat Creek	1867.9
Boundary 18	N5146	Point source	Petticoat Creek	1922.2
Boundary 19	N5149	Point source	Petticoat Creek	2172.12
Boundary 20	J17	Point source	Petticoat Creek	2869.03
Boundary 21	N5151	Point source	Petticoat Creek	3424.27
Boundary 22	J16	Point source	Petticoat Creek	3740.25
Boundary 23	N5154	Point source	Petticoat Creek	4303.04
Boundary 24	N5159	Point source	Petticoat Creek	4877.65
Boundary 25	J18	Point source	Petticoat Creek	5018.05
Boundary 26	N5161	Point source	Petticoat Creek	5629.03

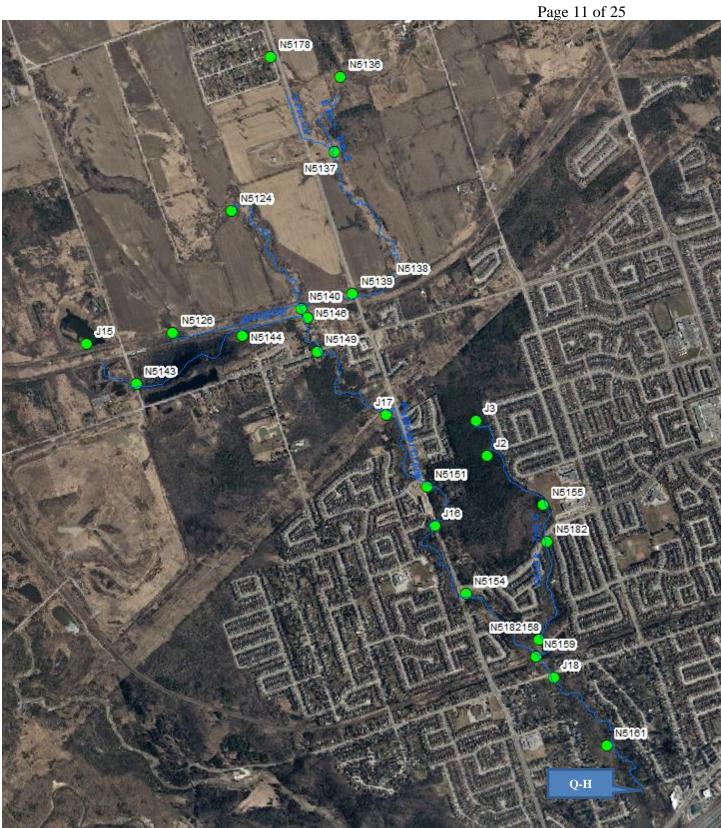


Figure 13 Location of Flow Nodes and Water Level Boundaries

April 29, 2022 Page 12 of 25

3.2 MIKE 21 2D Overland Model

The overland area was modelled using MIKE 21 Flexible Mesh (FM) HD, which is a fully dynamic modelling system for 2D free-surface flows. The MIKE 21 editors were used to construct and store various basic and hydrodynamic data layers. The following are the main elements of the MIKE 21 model setup:

- Mesh Generation
- · Roughness parameters
- Boundary conditions
- Model settings

Mesh Generation

MIKE 21 FM model uses a mesh-based bathymetry for hydrodynamic computations. The details and the desired accuracy of the model results depends on how the mesh has been designed. In addition, the mesh resolution has a significant impact on the accuracy of the results. A high-resolution mesh is required to retain higher variability of the ground elevation surface. High resolution also required to represent in detail topographic features (such as channels, buildings, paved roads, walkways, retaining walls, flood walls, etc.). As such, the mesh was designed as follows:

- A high-resolution mesh size of 10m² was used along the roads as floodwater tends to follow the roads.
- A high-resolution mesh size of 16m² was used in the potential flood extent.
- A mesh size of 50m² was used in the rest of model area.

The building polygons were excluded from the mesh generation to avoid computational mesh triangulation from occurring within these polygons, and River reaches covered by cross-sections were also excluded from the mesh to avoid double-accounting for the conveyance, and finally 1m LiDAR data was interpolated to each mesh node (see **Figure 14** below)

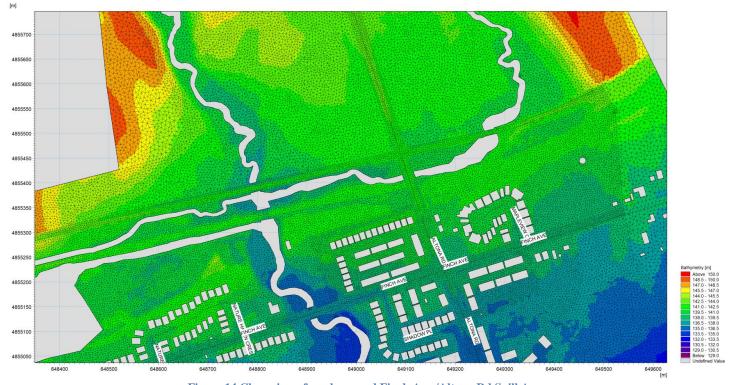


Figure 14 Close view of mesh around Finch Ave./Altona Rd Spill Area

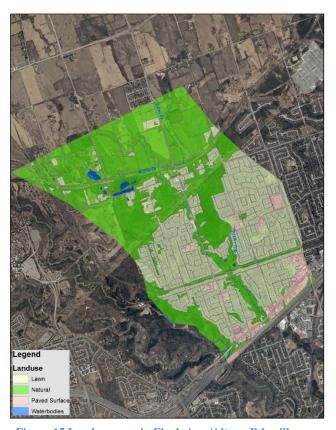


Figure 15 Landuse map in Finch Ave./Altona Rd spill area

Roughness Parameters

MIKE 21 uses roughness parameters for each mesh when completing computations. The land use map (see **Figure 15**) prepared using the TRCA's available land use/land cover information was converted into a MIKE 21 roughness map. In MIKE 21, the roughness was defined in terms of the MIKE system's Manning's resistance number (M), which is the inverse of the Manning's n roughness coefficient value (*i.e.*, 1/n). The Manning's resistance number (M-value) map was prepared based on the TRCA's standard roughness values; the corresponding Resistance numbers used in MIKE 21 are:

- Natural areas: 0.08 (M = 12.50)
- Roads and large parking areas: 0.025 (M = 40)
- Urban large pervious areas: 0.05 (M = 20)
- Streams/Waterbodies: 0.035 (M = 28.57)

Boundary Conditions

Boundary conditions for the MIKE 21 model define how the flow and water levels will be controlled at the peripheral edges of the 2D model domain defined by the bathymetry limits. Since all inflows were handled in 1D model, there is no inflow boundaries defined in 2D model. Also, the outflows

on two river reaches were handled in 1D model using water level boundary, so the only two downstream boundaries defined in 2D model are the low points at CPR railway track junction with Whites Rd and at Kingston Rd towards Rouge River which were defined as Free outflow boundaries, this is to allow floodwater leaving system without pile-up along the edge of 2D domain.

Model Settings

The MIKE 21 FM Flow Model setup contains descriptions of several parameters. The key parameters are simulation period, start and end time, time step interval, flooding and drying depths, output saving duration and saving interval details.

A 12-hour simulation period for both regional and design storms was used for the steady peak inflow hydrograph simulation. The simulation period was entered using an arbitrary start and end date and time with a specified total number of time steps and time step interval. In this case, the total number of time steps was 108,000 for 2yr to 100yr with a time step interval of 0.5 seconds.

The drying and flooding depths used were 0.01m and 0.02m, respectively.

The dynamic outputs were saved with time interval of 1200 (i.e., 10min interval).

- The saving output variables were surface elevation, total water depth, U velocity (x-direction), V velocity (y-direction), and current speed.
- The dynamic output file type used was "2D (horizontal)" while the output format was selected as "Area Series" with only real wet areas that ensures the saving of specified information at every computational point.

April 29, 2022 Page 14 of 25

3.3 1D and 2D Coupled Model

The final step for model setup was the integration of the 1D MIKE HYDRO model with the 2D MIKE 21 model using the MIKE Flood model interface. Lateral links were used to connect the branches in the 1D MIKE HYDRO model with the corresponding mesh elements of the 2D MIKE 21 model. A lateral link enables the coupling of the models at the left and right banks of the 1D channel with the 2D area. This integration in MIKE Flood allows a seamless flow exchange between the 1D branches and the 2D area, thereby enabling the space and time-dependent dynamic simulation of flows as they would physically occur in real-world hydraulic systems.

Figure 16 (below) shows the bathymetry of 1D and 2D coupled model, where the building areas are represented (blocked white cells) and the lateral link lines between the 1D and 2D models is shown as a series of red lines.

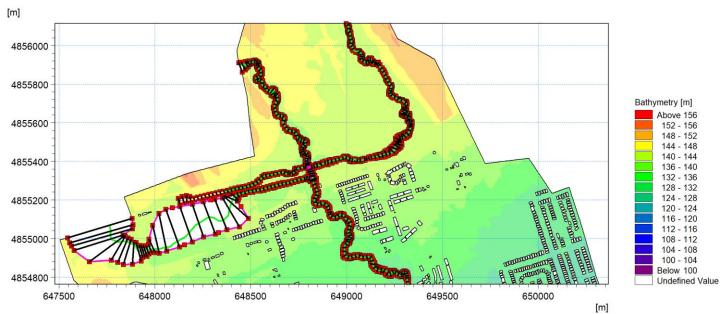


Figure 16 Lateral links used to connect 1D branch to 2D area

3.4 Model Results

Based on 2D model results, spills occur at four major locations: 1) Finch Ave. near West Petticoat Creek, 2) Finch Ave. near East Petticoat Creek, 3) Altona Rd about 1km north of Finch Ave. from East Petticoat Creek, and 4) Altona Rd near Sparrow Cir about 600m south of Finch Ave. from Petticoat Creek, and the following gives the details about spill travelling routes.

Figure 17 shows the spill locations and flow directions and following gives details on each spill:

- Spill#1: Spill at Finch Ave. from West Petticoat Creek
 Spill starts from 5yr storm event, and the regional spill amount is over 14m³/s (about 90% of total flow)
 with a spill width of 175m and spill depth of 0.15m, which is mainly due to a low point on Finch Ave. The
 spill would travel southwards about 120m where it splits into two paths as follows:
 - 1) less than 1 m³/s flow would travel south-east and eventually get into main Petticoat Creek along Altona Rd with depth of flow less than 0.3m.
 - 2) over 13 m³/s flow would cross hydro-corridor and get into residential area at Woodview Ave. where depth of flow is ranging between 0.3 and 1m, and then spill would continue southwards along Woodview Ave. where depth of flow is over 0.5m and then get onto Oakburn St. and continue its way southwards along Oakburn St. where depth of flow is over 0.5m and then spill would spread out into depressions at Castle St/Lawson St where depth of flow is ranging from

0.5m and 2m before splitting into two paths, i.e.

- a) over 9 m³/s flow would travel westwards along CPR railway track ditch and eventually half of flow get into main Petticoat Creek at CPR railway crossing and remaining would continue eastwards along CPR railway track ditch until 300m west of Rosebank Rd it splits into two paths, i.e. one path would continue eastwards along CPR railway track ditch and cross Whites Rd and then continues its way which is out of study area; and another path would cross over Sheppard Ave. and travel southwards along Edmund Dr until drain into Petticoat Creek Trib A1 at about 60m south of Steeple Hill. Depth of flow along this route is mostly over 0.5m due to well defined ditch along railway track.
- b) about 2 m³/s flow would cross Sheppard Ave. and continues southwards along Hoover Dr/Fawndale Rd/Altona and then eventually hit Kingston Rd and drain into Rouge River at Kingston Rd crossing which is out of study area. Depth of flow along this route is mostly under 0.3m.

• Spill#2: Spill at Finch Ave. from East Petticoat Creek

The spill only occurs during Regional event. Regional spill amount is about 30 m³/s (about 40% of total flow) due to undersized crossing at Altona Rd and low point on south bank of the creek near Altona Rd. and the spill splits into two paths:

- 1) More than 27m³/s of the spill would travel southwards along Altona with depth of flow ranging from 0.15m to 0.5m and eventually drain into Petticoat Creek near hydro corridor, and along its way on Altona Rd over 3m³/s of spill would travel westwards away from Altona Rd route and eventually drain into Petticoat Creek at various locations, and the depth of flow along this route is mostly between 0.15m and 0.5m.
- 2) Less than 1m³/s of the spill (about 300m east of Altona Rd) would travel southwards into green space and depth of flow at spill point is less than 0.1m, then hit Finch Ave. and this route would join some of the spill about 1.8 m³/s coming from the spill along Altona Rd. After that it would continue its way south-eastwards and cross green space into Bramalea sub-division at Wildflower Dr. and then it would carry on along Wildflower Dr./Charnwood Crt./Dencourt Dr. and get into Highbush Public School, and from there majority of the spill would travel south along Braeburn Cres. and it splits into two paths, one path would cross Foxwood Trail and get to depression on Gardenview Sq.; another path would turn eastwards along Foxwood Trail and eventually get to depression on Weyburn Sq. The depth of flow along this route is mostly under 0.3m, but except for three depressions where depth of flow would be between 0.5m and 1.5m.
- Spill#3: Spill at Altona Rd about 1km north of Finch Ave. from East Petticoat Creek
 The spill only occurs during Regional event. The spill amount is over 7.2m³/s which is about 30% of
 total peak flow. The spill starts right at the beginning of the East Petticoat Creek (1D reach), and then
 splits into two:
 - part of the flow would spill over Altona Rd into farm field on the east side of the road with depth of flow under 0.3m and then join the flow from both East Petticoat Creek and East Petticoat Creek Trib A;
 - another part of the spill would travel southwards along west side of the Altona Rd for about 1km and eventually get into East Petticoat Creek at CPR railway track. The depth of flow along this route is mostly between 0.3m and 1m.

Spill#4: Spill at Altona Rd near Sparrow Cir about 600m south of Finch Ave. from Petticoat Creek

The spill only occurs during Regional event. The spill would travel south-eastwards into residential area along Sparrow Cir/Chickadee Crt where depth flow is ranging from 0.15m and 0.5m, and then continue its way into forest cover area and eventually get into Petticoat Creek Trib C at various locations.

Figure 18 shows the steady Regional maximum water depth, **Figure 19** shows the steady Regional maximum water surface elevation and **Figure 20** shows the steady Regional maximum velocity.

April 29, 2022 Page 16 of 25

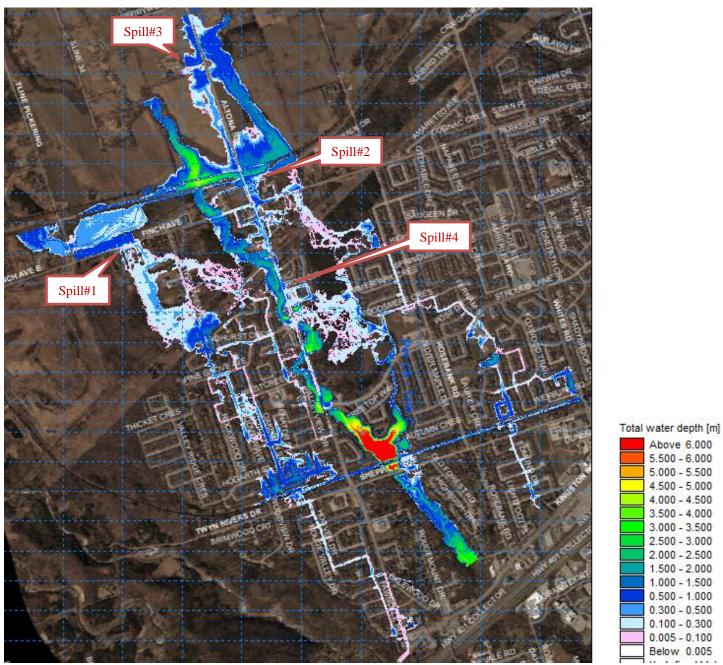


Figure 17- Spill locations and flood depth

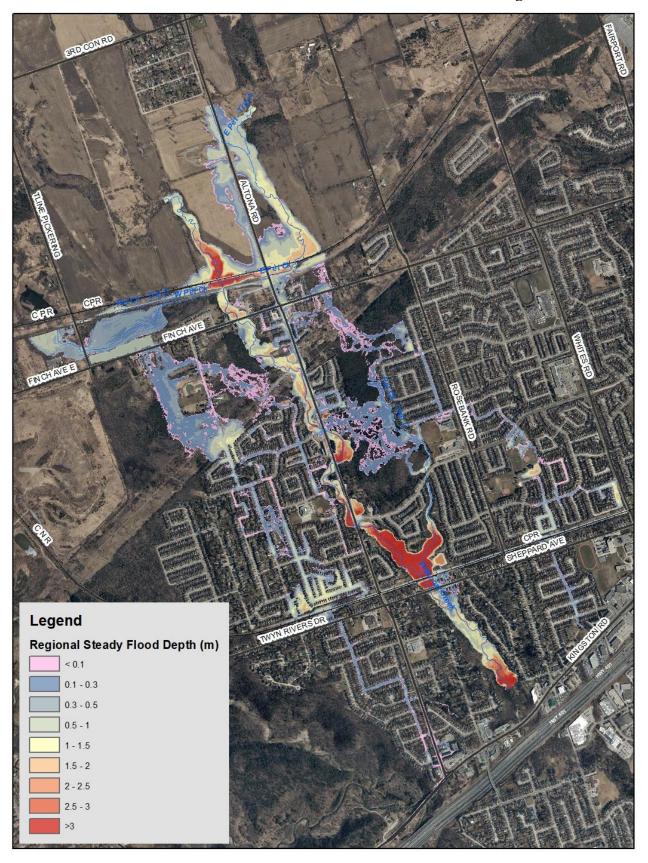


Figure 18– Steady Regional, maximum water depth

April 29, 2022 Page 18 of 25

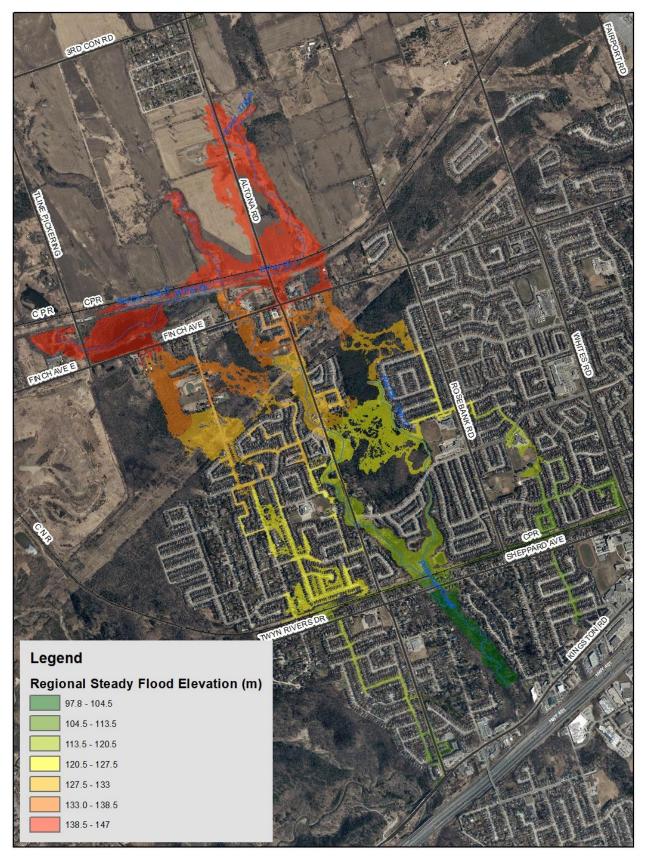


Figure 19 – Steady Regional, maximum water surface elevation

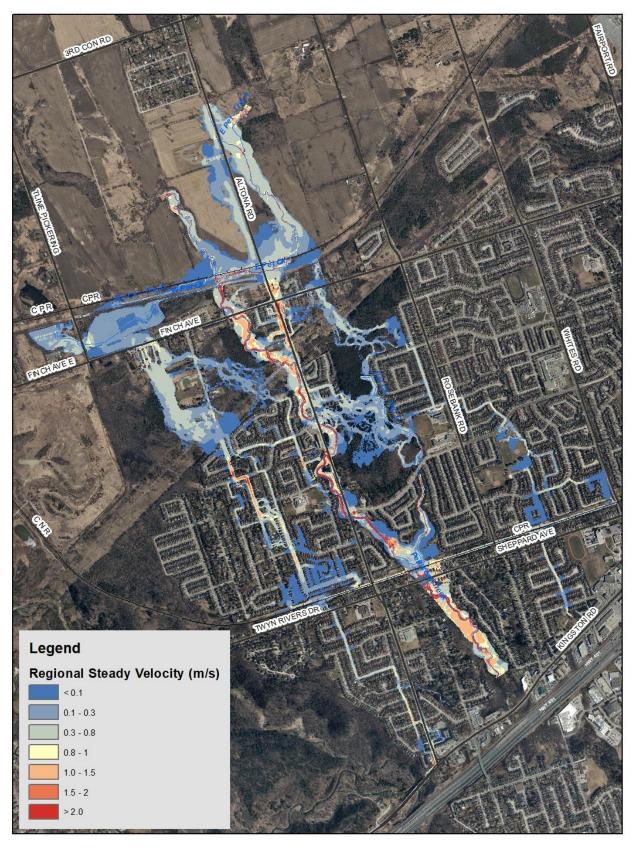


Figure 20 – Steady Regional, maximum velocity

April 29, 2022 Page 20 of 25

4.0 Flood Risk Mapping

In terms of flood risk analysis, the criteria provided in the *Technical Guide River and Stream Systems: Flooding Hazard Limit* prepared by the Ontario Ministry of Natural Resources (MNR) in 2002 along with the frequency of flooding are typically used in defining and assessing flood risk. Based on work completed recently in other SPA's, the TRCA has revised the flood risk categories and how they are calculated. The revised flood risk categories are divided into low, moderate and high risk and are defined as follows:

- Low Risk Vehicular and Pedestrian Access/Egress is Available (depth < 0.3m),
- Moderate Risk Pedestrian Access/Egress ONLY Available (Product Depth and Velocity <0.37m²/s, Depth <0.8m and Velocity <1.7m/s,
- High Risk Depth-velocity product > 0.37 m²/s or Depth >0.8m or Velocity >1.7m/s.


Figure 21 illustrates the distribution of Low-, Moderate- and High-risk flood areas within the domain; High-risk areas are generally confined to the channel except at four areas that lie in High-risk flood areas.

Figure 22 shows the distribution of Low-, Moderate- and High-risk flood areas along Woodview Ave. before Prohill St. Low points in hydro corridor at the edge of residential area, and backyards of few residential houses and section of Woodview Ave. lie in High-risk flood areas.

Figure 23 shows the distribution of Low-, Moderate- and High-risk flood areas between Prohill St and CPR railway track. Section of Oakburn St. and low points along Lawson St./Castle St. lies in high-risk flood area.

Figure 24 shows the distribution of Low-, Moderate- and High-risk flood areas Finch Ave./Altona near East Petticoat Creek. The high-risk flood areas lie on section of Altona Rd due to deep depth of flooding and high velocity spilling from the East Petticoat Creek.

Figure 25 shows the distribution of Low-, Moderate- and High-risk flood areas in Highbush P.S. and along Gardenview Sq./Weyburn Sq. area. The high-risk flood areas lie in depressions within Highbush P.S. where few catch basins are located and also in depressions along Gardenview Sq. and Weyburn Sq.

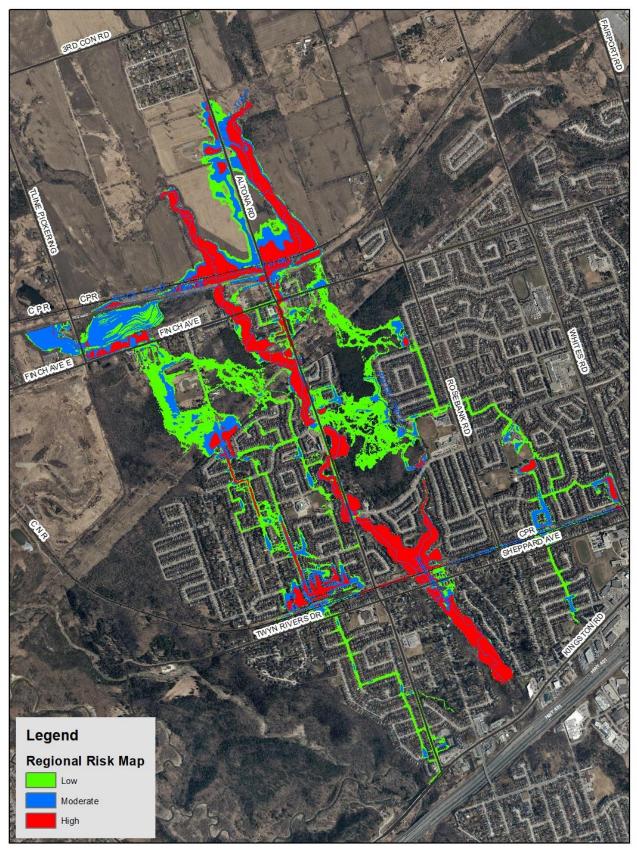

 $Figure\ 21-Distribution\ of\ low-\ moderate-\ and\ high-risk\ flood\ areas$

April 29, 2022 Page 22 of 25



Figure 22 – Distribution of low- moderate- and high-risk flood along Woodview Ave. before Prohill St.



Figure 23 – Distribution of low-moderate- and high-risk flood between Prohill St and CPR railway track.

April 29, 2022 Page 24 of 25

Figure 24 – Distribution of low- moderate- and high-risk flood on Finch Ave./Altona near East Petticoat Creek.



Figure 25 - Distribution of low-moderate- and high-risk flood in Highbush P.S. and along Gardenview Sq./Weyburn Sq. area.

5.0 Conclusions

Petticoat Creek FPM update was last updated in September 2006, which identified four spills from Petticoat Creek, West Petticoat Creek and East Petticoat Creek. Amount of two major spills from West Petticoat Creek and East Petticoat Creek are over 40% of total peak flows on each creek, which would travel long way further south along different flow paths. Given this, a 2D model is more appropriate to define the spill and model shallow overland flow. Therefore, a coupled 1D and 2D MIKE Flood model was built that incorporated all crossings, TRCA 1-m 2015 LiDAR data spliced with 2019 Lidars where grading has changed and updated flow data. The results from the coupled model clearly show the extent of the spill and its flow paths. For floodplain mapping purposes, flood depth and flood extent from the coupled MIKE model should be updated for reach sections of the Petticoat Creek and its tributaries upto main Petticoat Creek at Rouge Hill Crt. about 200m north of Kingston Rd.

APPENDIX "E"

Storm Peak Flow Calculations



File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

STORAGE AND DISCHARGE SUMMARY

				ORIFICE			PRE-		
	DRAINAGE	STORAGE				RELEASE	DEVELOPMENT	STORAGE	STORAGE
CONDITION	AREA (ha)	HWL (m)	LOCATION	INVERT (m)	DIAMETER (mm)	RATE (L/s)	RELEASE RATE (L/S)	REQUIRED (cu.m.)	PROVIDED (cu.m.)
2-Year	0.214	136.50	SWM Tank	135.97	74	8.2	14.6	15.0	15.9
100-Year	0.214	137.54	SVVIVI TATIK	133.91	74	14.4	43.9	42.4	45.0

TABLE E1

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

PRE-DEVELOPMENT PEAK FLOW CALCULATION (Unmitigated)

Surface Type Pervious Gravel	Area (ha.) Runot 0.510 0.2 0.000 0.7	25
TOTAL AREA	0.510 0.2	25
2 Year Pre-Development Flow		
$I = A / (t_c + B)^C$		
I = Rainfall Rate (mm/hr) Ca = 1 T = 10 minutes I = 77.6 mm/hr R = 0.25 N = 2.78	A = B = C =	715.076 5.262 0.815
Q = R x A x I x N	2 year Q =	27.5 L/s
100 Year Pre-Development Flow		
I = Rainfall Rate (mm/hr) Ca = 1.25 T = 10 minutes I = 186.7 mm/hr R = 0.25 N = 2.78	A = B = C =	2096.425 6.485 0.863
Q = R x A x I x N x Ca	100 year Q =	82.7 L/s

 $Q = R \times A \times I \times N \times Ca$

TABLE E2

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

ALLOWABLE (TOTAL CONTROLLED AREA FROM CATCHMENT 202 AND 203)

Surface Type Pervious Gravel		Area (ha.) 0.214 0.000	Runof 0.2 <u>0.7</u>	
TOTAL AREA		0.214	0.2	25
2 Year Pre-Development $I = A / (t_c + B)^C$	<u>Flow</u>			
I = Rainfall Rate (mm/hr) Ca = 1 T = 10	minutes mm/hr		A = B = C =	715.076 5.262 0.815
$Q = R \times A \times I \times N$		2 year Q =		11.5 L/s
100 Year Pre-Developme	ent Flow			
_	minutes mm/hr		A = B = C =	2096.425 6.485 0.863

100 year Q =

34.7 L/s

TABLE E3-1

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

POST-DEVELOPMENT PEAK FLOW CALCULATION (Catchment 201)

Surface Type	<u>Area (ha.)</u>	Runoff Coefficient
Pervious	0.163	0.25
Roof	0.085	0.95
Impervious	0.013	0.95
TOTAL AREA	0.261	0.51

2 Year Post-Development Flow

 $I = A / (t_c + B)^C$

 I = Rainfall Rate (mm/hr)
 A =
 715.076

 Ca =
 1
 B =
 5.262

 T =
 10 minutes
 C =
 0.815

 I =
 77.6 mm/hr

2 yr R = 0.51 (composite)

N = 2.78

 $Q = R \times A \times I \times N \times Ca$ 2 year Q = 28.8 L/s

100 Year Post-Development Flow

 $I = A / (t_c + B)^C$

I = Rainfall Rate (mm/hr) A = 2096.425

Ca = 1.25 B = 6.485 T = 10 minutes C = 0.863

I = 186.7 mm/hr

100 yr R = 0.51 N = 2.78

 $Q = R \times A \times I \times N \times Ca$ 100 year Q = 86.7 L/s

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

POST-DEVELOPMENT PEAK FLOW CALCULATION (Catchment 202)

Surface Type	<u>Area (ha.)</u>	Runoff Coefficient
Pervious	0.102	0.25
Roof	0.052	0.95
Impervious	0.060	0.95
TOTAL AREA	0.214	0.62

2 Year Post-Development Flow

 $I = A / (t_c + B)^C$

I = Rainfall Rate (mm/hr) A = 715.076 B = Ca = 1 5.262 T = 10 minutes C = 0.815 **| =** 77.6 mm/hr

0.62 (composite) 2 yr R =

N = 2.78

 $Q = R \times A \times I \times N \times Ca$ 2 year Q = 28.5 L/s

100 Year Post-Development Flow

 $I = A / (t_c + B)^C$

I = Rainfall Rate (mm/hr) A = 2096.425 Ca = 1.25 B = 6.485 T = 10 minutes C = 0.863

186.7 mm/hr |=

100 yr R = 0.62 2.78 N =

 $Q = R \times A \times I \times N \times Ca$ 85.7 L/s 100 year Q =

TABLE E3-3

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

POST-DEVELOPMENT PEAK FLOW CALCULATION (Catchment 203-External)

Surface Type	<u>Area (ha.)</u>	Runoff Coefficient
Pervious	0.006	0.25
Roof	0.001	0.95
Impervious	0.013	0.90
TOTAL AREA	0.020	0.71

2 Year Post-Development Flow

 $I = A / (t_c + B)^C$

I = Rainfall Rate (mm/hr)			A =	715.076
Ca =	1		B =	5.262
T =	10	minutes	C =	0.815
l =	77.6	mm/hr		
2 yr R =	0.71	(composite)		
		• • •		

N = 2.78

 $Q = R \times A \times I \times N \times Ca$ 2 year Q = 3.1 L/s

100 Year Post-Development Flow

$$I = A / (t_c + B)^C$$

I = 186.7 mm/hr

100 yr R = 0.71 N = 2.78

 $Q = R \times A \times I \times N \times Ca$ 100 year Q = 9.2 L/s

TABLE E3-4

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

POST-DEVELOPMENT PEAK FLOW CALCULATION (Catchment 204)

Surface Type	<u>Area (ha.)</u>	Runoff Coeffic	<u>ient</u>
Pervious	0.011	0.25	
Roof	0.015	0.95	
Impervious	0.009	0.95	
TOTAL AREA	0.035	0.73	

2 Year Post-Development Flow

 $I = A / (t_c + B)^C$

 I = Rainfall Rate (mm/hr)
 A =
 715.076

 Ca =
 1
 B =
 5.262

 T =
 10 minutes
 C =
 0.815

 I =
 77.6 mm/hr

 $\begin{array}{ccc}
1 &=& 77.6 & \text{mm/nr} \\
2 &\text{yr R} &=& 0.73 & \text{(composite)}
\end{array}$

N = 2.78

 $Q = R \times A \times I \times N \times Ca$ 2 year Q = 5.5 L/s

100 Year Post-Development Flow

 $I = A / (t_c + B)^C$

I = Rainfall Rate (mm/hr) A = 2096.425 Ca = 1.25 B = 6.485

T = 10 minutes C = 0.863

I = 186.7 mm/hr

100 yr R = 0.73 N = 2.78

 $Q = R \times A \times I \times N \times Ca$ 100 year Q = 16.5 L/s

VALDOR ENGINEERING INC.

Table E4-1

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

CONTROL ORIFICE DESIGN

2 YEAR STORM

	2 Year High Water Level	=	136.50	m
Orifice				(-)
	Orifice Coefficient (C)	=	0.61	(Plate)
	Acceleration due to gravity (g)	=	9.81	m/s/s
	Orifice Invert Elevation	=	135.97	m
	Orifice Diameter	=	74	mm
	Orifice Springline Elevation		136.01	m
	Cross section area of orifice (A)	=	0.0043	sq.m.
	Head (H)	=	0.49	m
	Actual Discharge (Q) (C x A x (2 x g x H)^0.5)	=	8.2	L/s

VALDOR ENGINEERING INC.

Table E4-2

File: 17149 February 2025

Project: Nature Haven Crescent, City of Pickering

CONTROL ORIFICE DESIGN

100 YEAR STORM

	100 Year High Water Level	=	137.54	m
<u>Orifice</u>				(-)
	Orifice Coefficient (C)	=	0.61	(Plate)
	Acceleration due to gravity (g)	=	9.81	m/s/s
	Orifice Invert Elevation	=	135.97	m
	Orifice Diameter	=	74	mm
	Orifice Springline Elevation		136.01	m
	Cross section area of orifice (A)	=	0.0043	sq.m.
	Head (H)	=	1.53	m
	Actual Discharge (Q) (C x A x (2 x g x H)^0.5)	=	14.4	L/s

File: 17149 **TABLE E5-1**

February 2025

Storage Volume Calculations - Rational Method 2-year Storm - City of Pickering

Project: Nature Haven Crescent, City of Pickering

Area of Catchment 202 + Catchment 203	Total Area (ha) Runoff Coefficient Maximum Discharge Through Orifice (L/s)	0.234 0.62 8.2	(Total area from Catchments
(External Drainage)	Discharged Volume per 5 min Interval (cu.m)	2.4	

Time (min)	Intensity (mm/hr)	Runoff Volume (cu.m)	Discharged Volume (cu.m)	Storage Volume (cu.m)
0	0.0	0.000	0.000	0.000
5	2.3	0.279	0.279	0.000
10	2.5	0.305	0.305	0.000
15	2.8	0.336	0.336	0.000
20	3.1	0.376	0.376	0.000
25	3.6	0.427	0.427	0.000
30	4.1	0.497	0.497	0.000
35	5.0	0.597	0.597	0.000
40	6.2	0.751	0.751	0.000
45	8.5	1.024	1.024	0.000
50	13.5	1.625	1.625	0.000
55	32.9	3.954	2.448	1.506
60	107.2	12.900	2.448	10.452
65	42.8	5.149	2.448	2.701
70	22.9	2.760	2.448	0.312
75	15.4	1.857	1.857	0.000
80	11.6	1.394	1.394	0.000
85	9.3	1.116	1.116	0.000
90	7.7	0.931	0.931	0.000
95	6.7	0.800	0.800	0.000
100	5.8	0.703	0.703	0.000
105	5.2	0.627	0.627	0.000
110	4.7	0.567	0.567	0.000
115	4.3	0.518	0.518	0.000
120	4.0	0.477	0.477	0.000
125	3.7	0.442	0.442	0.000
130	3.4	0.413	0.413	0.000
135	3.2	0.387	0.387	0.000
140	3.0	0.365	0.365	0.000
145	2.9	0.345	0.345	0.000
150	2.7	0.327	0.327	0.000
155	2.6	0.312	0.312	0.000
160	2.5	0.297	0.297	0.000
165	2.4	0.285	0.285	0.000
170	2.3	0.273	0.273	0.000
175	2.2	0.262	0.262	0.000
180	2.1	0.252	0.252	0.000

Total Storage Volume Required (cu.m)

15.0

File: 17149 February 2025

Storage Volume Calculations - Rational Method 100-year Storm - City of Pickering

Project: Nature Haven Crescent, City of Pickering

Area of	Total Area (ha)	0.234
Catchment 202 +	Runoff Coefficient	0.62
Catchment 203 (External	Maximum Discharge Through Orifice (L/s)	14.4
Drainage)	Discharged Volume per 5 min Interval (cu.m)	4.3

Time (min)	Intensity (mm/hr)	Runoff Volume (cu.m)	Discharged Volume (cu.m)	Storage Volume (cu.m)
0	0.0	0.000	0.000	0.000
5	4.3	0.513	0.513	0.000
10	4.7	0.567	0.567	0.000
15	5.3	0.633	0.633	0.000
20	6.0	0.718	0.718	0.000
25	6.9	0.831	0.831	0.000
30	8.2	0.986	0.986	0.000
35	10.1	1.213	1.213	0.000
40	13.1	1.576	1.576	0.000
45	18.6	2.234	2.234	0.000
50	31.1	3.742	3.742	0.000
55	80.3	9.666	4.316	5.350
60	255.0	30.689	4.316	26.372
65	105.4	12.688	4.316	8.372
70	55.2	6.644	4.316	2.328
75	36.0	4.329	4.316	0.013
80	26.2	3.155	3.155	0.000
85	20.4	2.461	2.461	0.000
90	16.7	2.008	2.008	0.000
95	14.1	1.692	1.692	0.000
100	12.1	1.460	1.460	0.000
105	10.7	1.283	1.283	0.000
110	9.5	1.144	1.144	0.000
115	8.6	1.032	1.032	0.000
120	7.8	0.940	0.940	0.000
125	7.2	0.863	0.863	0.000
130	6.6	0.798	0.798	0.000
135	6.2	0.743	0.743	0.000
140	5.8	0.694	0.694	0.000
145	5.4	0.652	0.652	0.000
150	5.1	0.615	0.615	0.000
155	4.8	0.582	0.582	0.000
160	4.6	0.552	0.552	0.000
165	4.4	0.525	0.525	0.000
170	4.2	0.501	0.501	0.000
175	4.0	0.479	0.479	0.000
180	3.8	0.459	0.459	0.000

Total Storage Volume Required (cu.m)

42.4

VALDOR ENGINEERING INC.

File: 17149 February 2025

TABLE: E6-1

AVAILABLE STORAGE - 2 YEAR

UNDERGROUND STORAGE - BOX

					Area (sq.m)	Height (m)	VOLUME (cu.m)
Underground Detenti	ion Tank						
Tank Inv: 13	35.97	HWL:	136.50		30.00	0.53	15.9
TOTAL							15.9

2 YEAR STORAGE PROVIDED:	15.9	
	-	
2 YEAR STORAGE REQUIRED:	15.0	\neg

VALDOR ENGINEERING INC.

File: 17149

February 2025 TABLE: E6-2

AVAILABLE STORAGE - 100 YEAR

UNDERGROUND STORAGE - Detention Tank

		Length (m)	Diameter (mm)	Area (sq.m)	Height (m)	VOLUME (cu.m)
Underground Detention Tank						
Tank Inv: 135.97	HWL: 137.54			30.00	1.50	45.0
TOTAL						45.0

100 YEAR STORAGE PROVIDED:	45.0
100 YEAR STORAGE REQUIRED:	42.4

APPENDIX "F"

Stormwater Quality Treatment



DRAWING NOT TO BE USED FOR CONSTRUCTION

THE STORMCEPTOR SYSTEM IS PROTECTED BY ONE OR MORE OF THE FOLLOWING PATENTS: United States Patent No. 5,753,115 • 5,849,181 • 6,068,765 • 6,371,690 • 7,582,216 • 7,666,303 | Australia Patent No. 693,164 • 707,133 • 729,096 • 779,401 • 289,647 • 2008,279,378 • 2008,288,900 | Canadian Patent No. 2,009,280 • 2,137,942 • 2,175,277 • 2,180,305 • 2,180,383 • 2,206,338 • 2,327,768 | Indonesian Patent No. 007058 | Japan Patent No. 3581233 • 9-11476 | Korea Patent No. 10-1451593 • 0519212 | Malaysia Patent No. 118987 | New Zealand Patent No. 314,646 • 583,583 • 583,008 | South African Patent No. 2010/00683 • 2010/01796 | SAFETY GRATE TO BE INSTALLED OVER RISER PIPE NO ORIFICE ACCESS OPENING TO BE ORIENTED OVER OIL CLEANOUT RECESSED TROUGH COLLECTS STANDING WATER ON-TOP OF INSERT 152Ø PORT AND RISER PIPE PLAN VIEW FRAME AND COVER EMBOSSED "STORMCEPTOR" GRADE ADJUSTERS 305 TO SUIT FINISHED GRADE 1829 1520 OIL CLEANOUT PORT **FINISHED** TO BE RAISED TO ELEVATION AS CLOSE TO THE UNDERSIDE GRADE (TRANSITION TÒ 1200 mm OF THE FLAT CAP AS REQUIRED) NNI FT OUTLET 635± OUTLET PIPE, SIZE BASED ON SEWER DESIGN. FLEXIBLE BOOT OR GROUTED TO CONCRETE 305 RISER SECTION 3988 -600¢ RISER PIPE 300¢ DROP TEE 914 CONCRETE RISER AND SLAB COMPONENTS C/W RUBBER GASKETS FOR JOINTS. 44 4 4 305 MANUFACTURED TO CSA AND OPS STANDARDS. -3658 SECTION VIEW **Storm**ceptor• DATE SHEET STC 6000 NUMBER STANDARD MODEL #### OF1 407 FAIRVIEW DRIVE, WHITBY, ON L1N 3A9

DATE:####### SCALE: 60

PROJECT No.: #####

DRAWN:###

CHECKED: ###

APPENDIX "G"

Water Balance Calculations



VALDOR ENGINEERING INC.

File: 17149 February 2025

PROJECT: **Proposed Residential Development, City of Pickering**

WATER BALANCE CALCULATIONS

1. INITIAL ABSTRACTION

	Area	Init. Abstract.
Surface Type	(Ha)	(mm)
Landscape Area	0.276	0.0
Roof Area	0.152	0.0
Impervious Area	0.082	0.0
Total	0.510	0.000

TABLE: G1

2. STORAGE VOLUME REQUIRED

Total Area of Site (A) = 5095 sq.m. Target Retention Depth (D) = 0.005 (m) Overall Initial Abstractions (I) = 0.000000 (m)

Storage Volume Required = $V = A \times (D - I) = \int_{A}^{B} V(D - I) dI$ 25.48 (cu.m.)

3. SOAK-AWAY PIT SIZE

Rear of Lot 1

Percolation Rate (P) = 12 mm/hr Maximum Retention Time (T) = 48 hours Max Trench Height Allowable (D) = (PT/(1000*S)) = 0.58 m

*MOE recommend max depth of 1.5m

Clear Stone Trench

Total Length of Trench (L) = 7.00 m Width (w) =2.20 m Height (d) = 0.30 m Void Ratio = 0.40 Volume = 1.85 cu.m.

Rear of Lot 2

Percolation Rate (P) = 12 mm/hr Maximum Retention Time (T) = 48 hours Max Trench Height Allowable (D) = (PT/(1000*S)) = 0.58 m *MOE recommend max depth of 1.5m

Clear Stone Trench

Total Length of Trench (L) = 7.00 m Width (w) =2.20 m Height (d) = 0.45 m Void Ratio = 0.40 Volume = 2.77 cu.m.

Rear of Lot 4

Percolation Rate (P) =	50 mm/hr
Maximum Retention Time (T) =	48 hours
Max Trench Height Allowable (D) = (PT/(1000*S)) =	2.40 m
*MOE recommend ma	x depth of 1.5m

Clear Stone Trench

Total Length of Trench (L) =	4.50 m
Width (w) =	3.00 m
Height (d) =	0.65 m
Void Ratio =	0.40
Volume =	3.51 cu.m.

Rear of Lot 5

Percolation Rate (P) =	12 mm/hr
Maximum Retention Time (T) =	48 hours
Max Trench Height Allowable (D) = (PT/(1000*S)) =	0.58 m
*MOE recommend	max depth of 1.5m

Clear Stone Trench

Total Length of Trench (L) =	7.00 m
Width (w) =	2.20 m
Height (d) =	0.58 m
Void Ratio =	0.40
Volume =	3.57 cu.m.

Front of Lot 5

Percolation Rate (P) =	50 mm/hr
Maximum Retention Time (T) =	48 hours
Max Trench Height Allowable (D) = (PT/(1000*S)) =	2.40 m
*MOE recommend	max depth of 1.5m

Clear Stone Trench

Total Length of Trench (L) =	4.20 m
Width (w) =	2.60 m
Height (d) =	0.30 m
Void Ratio =	0.40
Volume =	1.31 cu m

Rear of Lot 6

Percolation Rate (P) =	12 mm/hr
Maximum Retention Time (T) =	48 hours
Max Trench Height Allowable (D) = (PT/(1000*S)) =	0.58 m
*MOE recommend ma:	x depth of 1.5m

Clear Stone Trench

Total Length of Trench (L) =	10.00 m
Width (w) =	2.20 m
Height (d) =	0.30 m
Void Ratio =	0.40
Volume =	2.64 cu.m.

Rear of Lot 7

Percolation Rate (P) = 12 mm/hr
Maximum Retention Time (T) = 48 hours

Max Trench Height Allowable (D) = (PT/(1000*S)) = 0.58 m

*MOE recommend max depth of 1.5m

Clear Stone Trench

Rear of Lot 8

Percolation Rate (P) = 12 mm/hr
Maximum Retention Time (T) = 48 hours

Max Trench Height Allowable (D) = (PT/(1000*S)) = 0.58 m

*MOE recommend max depth of 1.5m

Clear Stone Trench

Total Storage Volume Provided = 25.67 (cu.m.)

VALDOR ENGINEERING INC.

File: 17149 December 2021

PROJECT: Proposed Residential Development, City of Pickering

PERCOLATION RATE CALCULATIONS

Source: Geotechnical Investigation Report (Feb 13, 2020.) prepared by Soil Engineers Ltd.


TABLE: G2

Approximate relationships between hydraulic conductivity, percolation time and infiltration rate

Hydraulic Conductivity, K _{fs} (centimetres/second)	Percolation Time, T (minutes/centimetre)	Infiltration Rate, 1/T (millimetres/hour)
0.1	2	300
0.01	4	150
0.001	8	75
0.0001	12	50
0.00001	20	30
0.000001	50	12

Source: Ontario Ministry of Municipal Affairs and Housing (OMMAH). 1997. Supplementary Guidelines to the Ontario Building Code 1997. SG-6 Percolation Time and Soil Descriptions. Toronto, Ontario.

Lot 1 Percolation Rate, P =	12 m/cm
Lot 2 Percolation Rate, P =	12 m/cm
Lot 3 Percolation Rate, P =	50 m/cm
Lot 4 Percolation Rate, P =	50 m/cm
Lot 5 Percolation Rate, P =	12 m/cm
Lot 6 Percolation Rate, P =	12 m/cm
Lot 7 Percolation Rate, P =	12 m/cm
Lot 8 Percolation Rate, P =	12 m/cm

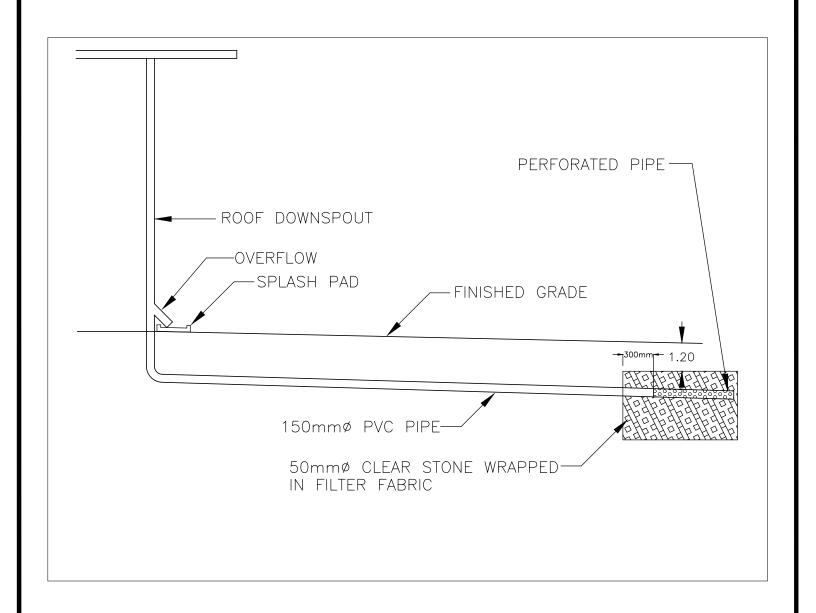

PROJECT

PROPOSED RESIDENTIAL DEVELOPMENT NATURE HAVEN CRESCENT

CITY OF PICKERING

TITLE

ROOF DRAINAGE SOAK AWAY PIT DETAIL



VALDOR ENGINEERING INC.

Consulting Engineers - Project Managers

571 CHRISLEA ROAD, UNIT 4, WOODBRIDGE, ONTARIO, L4L 8A2 TEL (905)264-0054. FAX (905)264-0069 E-MAIL: info@valdor-engineering.com www.valdor-engineering.com

DRAWN BY	M.H.	CHECKED BY	D.G
SCALE	N.T.S.	DATE	APRIL 2024
PROJECT	17149	DWG.	FIGURE G-1



90 WEST BEAVER CREEK ROAD, SUITE 100, RICHMOND HILL, ONTARIO L4B 1E7 · TEL: (416) 754-8515 · FAX: (905) 881-8335

BARRIE TEL: (705) 721-7863 FAX: (705) 721-7864 MISSISSAUGA TEL: (905) 542-7605 FAX: (905) 542-2769 OSHAWA TEL: (905) 440-2040 FAX: (905) 725-1315 NEWMARKET TEL: (905) 853-0647 FAX: (905) 881-8335 GRAVENHURST TEL: (705) 684-4242 FAX: (705) 684-8522 HAMILTON TEL: (905) 777-7956 FAX: (905) 542-2769

A REPORT TO HIGHGLEN HOMES LIMITED

A GEOTECHNICAL INVESTIGATION FOR PROPOSED RESIDENTIAL DEVELOPMENT

230 FINCH AVENUE (PART 4, PLAN #40 R-29767)

CITY OF PICKERING

REFERENCE NO. 1911-S057

FEBRUARY 2020

DISTRIBUTION

3 Copies - Highglen Homes Limited

1 Copy - Soil Engineers Ltd. (Richmond Hill)





TABLE OF CONTENTS

1.0	NTRODUCTION				
2.0	SITE AND PROJECT DESCRIPTION 1				
3.0) FIELD WORK 1				
4.0	SUBSURFACE CONDITIONS				
	4.1 Topsoil 2 4.2 Disturbed/Weathered Soil 2 4.3 Sandy Silt 3 4.4 Silty Sand Till 4 4.5 Sands 5 4.6 Compaction Characteristics of the Revealed Soils 6				
5.0	GROUNDWATER CONDITIONS 8				
6.0	DISCUSSION AND RECOMMENDATIONS 8				
	6.1 Foundations 9 6.2 Engineered Fill 11 6.3 Slab-On-Grade 13 6.4 Underground Services 13 6.5 Trench Backfilling 14 6.6 Pavement Design 15 6.7 Soil Parameters 16 6.8 Excavation 17				
7.0	LIMITATIONS OF REPORT18				
TA	<u>BLES</u>				
Tab Tab Tab	le 1 - Estimated Water Content for Compaction				
<u>DI</u>	AGRAM_				
Dia	gram 1 - Frost Protection Measures (Foundations)11				
EN	CLOSURES				
Gra Bor	ehole Logs Figures 1 to 5 in Size Distribution Graphs Figures 6 to 9 ehole Location Plan Drawing No. 1 surface Profile Drawing No. 2				



1.0 INTRODUCTION

In accordance with written authorization dated November 11, 2019, from Mr. John Perciasepe, of Highglen Homes Limited, a geotechnical investigation was carried out at a parcel of land located at 230 Finch Avenue, in the City of Pickering, for a proposed Residential Development.

The purpose of this investigation was to reveal the subsurface conditions and determine the engineering properties of the disclosed soils for the design and construction of the proposed project.

The geotechnical findings and resulting recommendations are presented in this Report.

2.0 SITE AND PROJECT DESCRIPTION

The City of Pickering is situated on Iroquois (glacial lake) plain where, in places, the glacial till stratigraphy has been partly eroded by the water action of the glacial lake and filled with lacustrine sands, silts, clays and reworked till.

The subject site is an open field situated at the northwest sector of Finch Avenue and Altona Road, in the City of Pickering. The site area is weed covered and was snow covered at the time of field investigation. The area fronting Finch Avenue is treed. The ground surface is relatively flat and level, with the overall topography descending gently towards the south.

The proposed project consists of the construction of a new residential subdivision, which will be provided with municipal services and roadways meeting the municipal standards.

3.0 FIELD WORK

The field work, consisting of 5 boreholes to a depth of 6.6 m, was performed on December 12, 2019 at the locations shown on the Borehole Location Plan, Drawing No. 1. A total of 5 monitoring wells were also installed for hydrogeological assessment.

The holes were advanced at intervals to the sampling depths by a track-mounted, continuous-flight power-auger machine equipped for soil sampling. Standard Penetration Tests, using the procedures described on the enclosed "List of Abbreviations and Terms", were performed at the sampling depths. The test results are recorded as the Standard Penetration Resistance (or 'N' values) of the subsoil. The relative density of the granular



Reference No. 1911-S057

strata and the consistency of the cohesive strata are inferred from the 'N' values. Splitspoon samples were recovered for soil classification and laboratory testing.

The field work was supervised and the findings were recorded by a Geotechnical Technician.

The elevation at each of the borehole locations was determined from the spot elevations on the site plan provided by the client.

4.0 **SUBSURFACE CONDITIONS**

Detailed descriptions of the encountered subsurface conditions are presented on the Borehole Logs, comprising Figures 1 to 5, inclusive. The revealed stratigraphy is plotted on the Subsurface Profile, Drawing No. 2, and the engineering properties of the disclosed soils are discussed herein.

The investigation has disclosed that beneath a veneer of topsoil and a layer of earth fill, the site is underlain by strata of sandy silt, silty sand till and sands.

4.1 **Topsoil** (All Boreholes)

The revealed topsoil is 25 to 36 cm thick; it is dark brown in colour, indicating that it contains appreciable amounts of roots and humus. These materials are unstable and compressible under loads; therefore, the topsoil is considered to be void of engineering value. Due to its humus content, it will generate an offensive odour and may produce volatile gases under anaerobic conditions. Therefore, the topsoil must not be buried below any structures or deeper than 1.2 m below the finished grade so it will not have an adverse impact on the environmental well-being of the developed areas.

Since the topsoil is considered void of engineering value, it can only be used for general landscaping and landscape contouring purposes. A fertility analysis can be performed to determine the suitability of the topsoil as a planting material.

4.2 <u>Disturbed/Weathered Soil</u> (All Boreholes)

The disturbed/weathered soil encountered extends to depths of 0.7 m and 1.4 m from the prevailing ground surface. Sample examinations show that the soil contains sand, with gravel, cobbles and rock fragments.



The obtained 'N' values of the earth fill range from 3 to 22, with a median of 5 blows per 30 cm of penetration, indicating that the soil is generally loose.

The natural water content values of the soil are 6% and 18%, indicating that it is in a moist to wet condition.

A grain size analysis was performed on 1 representative sample of the soil and the result is plotted on Figure 6.

Due to the non-uniform and loose density, it is considered unsuitable for supporting structural loads. For structural use, the soil must be subexcavated, inspected, sorted free of any deleterious material, and properly compacted.

4.3 Sandy Silt (Borehole 5)

The sandy silt deposit was found below a layer of fine to coarse sand and it is embedded with seams and layers of silty clay and fine sand and contains a trace of clay. The laminated structure shows that the silt is a glaciolacustrine deposit.

The natural water content values of the sandy silt sample is 21%, indicating it is in a wet condition and is water bearing. The wet sample became highly dilatant under tactile examinations, showing the shear strength of the sandy silt will be subject to dynamic disturbance.

The obtained 'N' value is 6 blows per 30 cm of penetration, indicating that the relative density of the sandy silt is loose.

A grain size analysis was performed on the sandy silt sample and the result is plotted on Figure 7.

Based on the above findings, the engineering properties relating to the project are given below:

- Highly frost susceptible, with high soil-adfreezing potential.
- Highly water erodible; it is susceptible to migration through small openings under seepage pressure.
- Relatively pervious, with an estimated coefficient of permeability of 10⁻⁴ cm/sec, an estimated percolation rate of 20 min/cm, and runoff coefficients of:



α			_
> 1	O	n	ρ
\mathbf{v}	v	v	·

0% - 2%	0.07
2% - 6%	0.12
6% +	0.18

- The soil has a high capillarity and water retention capacity.
- A frictional soil, its shear strength is density dependent. Due to the dilatancy, the strength of the wet silt is susceptible to impact disturbance; i.e., the disturbance will induce a build-up of pore pressure within the soil mantle, resulting in soil dilation and a reduction in shear strength.
- In excavation, the moist silt will be stable in relatively steep cuts, while the wet silt will slough and run slowly with seepage bleeding from the cut face, and the bottom will boil under a piezometric head of 0.3 m.
- A poor pavement-supportive material, with an estimated California Bearing Ratio (CBR) value of 6%.
- Moderate corrosivity to buried metal, with an estimated electrical resistivity of 4500 ohm·cm.

4.4 Silty Sand Till (All Boreholes)

The silty sand till was encountered below the sand layer and extends to the maximum investigated depth at all boreholes. The till consists of a random mixture of soil particle sizes ranging from clay to gravel, with the sand being the dominant fraction. It is heterogeneous in structure, showing that it is a glacial deposit.

The obtained 'N' values range from 11 to 49, with a median of 30 blows per 30 cm of penetration, indicating that the relative density of the silty sand till is compact to dense, being generally compact.

Intermittent hard resistance to augering was encountered, indicating the presence of cobbles and boulders in the stratum.

The natural water content values of the samples were determined and the results are plotted on the Borehole Logs; the values range from 9% to 14%, with a median of 10%, indicating the till is in a moist to very moist condition.

A grain size analysis was performed on 1 representative sample of the silty sand till; the results are plotted on Figure 8.

Slana



Based on the above findings, the deduced engineering properties pertaining to the project are given below:

- High frost susceptibility and moderate water erodibility.
- Low permeability, with an estimated coefficient of permeability of 10⁻⁶ cm/sec and runoff coefficients of:

Slope	
0% - 2%	0.15
2% - 6%	0.20
6% +	0.28

- A frictional soil, its shear strength is primarily derived from internal friction and is augmented by cementation. Therefore, its strength is primarily soil density dependent.
- In steep cuts, it will be stable; however, under prolonged exposure, localized sheet collapse will occur, particularly in the zone where the wet sand layers are prevalent.
- A fair pavement-supportive material, with an estimated CBR value of 8%.
- Moderately low corrosivity to buried metal, with an estimated electrical resistivity of 5000 ohm·cm.

4.5 **Sands** (All Boreholes)

The sand deposit was encountered below the surficial disturbed soil a layer of earth fill and sample examinations show that it is non-cohesive, consisting of fine to coarse sand particles, gravelly in places, and with some silt to being silty. The laminated structure shows the deposit was derived from a lacustrine environment.

The obtained 'N' values range from 7 to 60, with a median of 28 blows per 30 cm of penetration. This shows the relative density of the sand is loose to very dense, being generally compact.

The natural water content was determined and the results are plotted on the Borehole Logs. The values range from 3% to 21%, with a median of 5%; show that the sand deposit is in a damp to wet condition. The wet samples are water bearing and displayed appreciable dilatancy when shaken by hand.

A grain size analysis was performed on one of the sand samples and the result is plotted on Figure 9.



Accordingly, the following engineering properties are deduced:

- The sand with high silt content is highly frost susceptible with high soil-adfreezing potential.
- Highly water erodible.

Clana

• Pervious, with an estimated coefficient of permeability of 10⁻³ cm/sec, an estimated percolation rate of 10 min/cm, and runoff coefficients of:

Stope	
0% - 2%	0.04
2% - 6%	0.09
6% +	0.13

- A frictional soil, its shear strength is derived from internal friction and is density dependent. Due to its dilatancy, the shear strength of the wet sand is susceptible to impact disturbance; i.e., the disturbance will induce a build-up of pore pressure within the soil mantle, resulting in soil dilation and a reduction of shear strength.
- In relatively steep cuts, the sand will be stable in a damp to moist condition, but will slough if it is wet and run with water seepage. The bottom will boil under a piezometric head of 0.3 m.
- A fair material to support pavement, with an estimated CBR value of at least 8%.
- Moderately low corrosivity to buried metal, with an estimated electrical resistivity of 5000 ohm·cm.


4.6 Compaction Characteristics of the Revealed Soils

The obtainable degree of compaction is primarily dependent on the soil moisture and, to a lesser extent, on the type of compactor used and the effort applied.

As a general guide, the typical water content values of the revealed soils for Standard Proctor compaction are presented in Table 1.

 Table 1 - Estimated Water Content for Compaction

	Determined Natural		ntent (%) for ctor Compaction				
Soil Type	Water Content (%)	100% (optimum)	Range for 95% or +				
Sandy Silt	21	12	8 to 16				
Silty Sand Till	9 to 14 (median 10)	11	7 to 16				
Sands	3 to 21 (median 5)	10	5 to 15				



Based on the above findings, a majority of the in situ soils are generally suitable for a 95% or + Standard Proctor compaction. However, the sandy silt and portions of the sands are too wet or on the wet side of the optimum. The wet soils will require prior aeration in dry, warm weather or mixing with drier inorganic soils for proper compaction.

The silty sand till should be compacted using a heavy-weight, kneading-type roller. The silt and sands can be compacted by a smooth roller with or without vibration, depending on the water content of the soil being compacted. The lifts for compaction should be limited to 20 cm, or to a suitable thickness as assessed by test strips performed by the equipment which will be used at the time of construction.

When compacting the dense silty sand till on the dry side of the optimum, the compactive energy will frequently bridge over the chunks in the soil and be transmitted laterally into the soil mantle. Therefore, the lifts of this soil must be limited to 20 cm or less (before compaction). It is difficult to monitor the lifts of backfill placed in deep trenches; therefore, it is preferable that the compaction of backfill at depths over 1.0 m below the pavement subgrade be carried out on the wet side of the optimum. This would allow a wider latitude of lift thickness.

One should be aware that with considerable effort, a 90%± Standard Proctor compaction of the wet silt and sands is achievable. Further densification is prevented by the pore pressure induced by the compactive effort; however, large random voids will have been expelled, and with time the pore pressure will dissipate and the percentage of compaction will increase. There are many cases on record where after a few months of rest, the density of the compacted mantle has increased to over 95% of its maximum Standard Proctor dry density.

If the compaction of the soils is carried out with the water content within the range for 95% Standard Proctor dry density but on the wet side of the optimum, the surface of the compacted soil mantle will roll under the dynamic compactive load. This is unsuitable for road construction since each component of the pavement structure is to be placed under dynamic conditions which will induce the rolling action of the subgrade surface and cause structural failure of the new pavement. The foundations or bedding of the sewer and slab-on-grade will be placed on a subgrade which will not be subjected to impact loads. Therefore, the structurally compacted soil mantle with the water content on the wet side or dry side of the optimum will provide adequate subgrade strength for the project construction.

The presence of boulders in the till will prevent transmission of the compactive energy into the underlying material to be compacted. If an appreciable amount of boulders over 15 cm



in size is mixed with the material, it must either be sorted or must not be used for structural backfill and/or construction of engineered fill.

5.0 **GROUNDWATER CONDITIONS**

Groundwater was detected at a depth of 5.5 m below the ground surface at Boreholes 4 and 5; all other boreholes remained dry upon completion of field work. The measured groundwater level is considered to represent the groundwater conditions at the site at the time of investigation. The groundwater level will fluctuate with the seasons.

The yield of groundwater from the silty sand till, due to its relatively low permeability, is expected to be slow to moderate and limited. The yield of groundwater, if encountered, from the sandy silt and sands will likely be moderate to appreciable and may be persistent.

6.0 DISCUSSION AND RECOMMENDATIONS

The investigation has disclosed that beneath a veneer of topsoil and a layer of disturbed/weathered soil, the site is underlain by strata of loose sandy silt, compact to dense, generally compact silty sand till and loose to very dense, generally compact sands.

Groundwater was detected at a depth of 5.5 m below the ground surface at Boreholes 4 and 5; all other boreholes remained dry upon completion of field work. The measured groundwater level is considered to represent the groundwater conditions at the site at the time of investigation. The groundwater level will fluctuate with the seasons.

The geotechnical findings which warrant special consideration are presented below:

- 1. The topsoil must be stripped for the project construction. This material is unsuitable for structural applications, and should only be placed in the landscaped areas. The topsoil should not be buried beneath the building envelope or deeper than 1.2 m below the finished grade.
- 2. The disturbed/weathered soil is not suitable for engineering applications. For structural use, it should be subexcavated, inspected, assessed, sorted free of organic matter and any deleterious materials, and properly compacted.
- 3. The natural soils are suitable for normal spread and strip footing construction. Due to the presence of topsoil and weathered soil, the footing subgrade must be inspected by a geotechnical engineer, or a geotechnical technician under the supervision of a geotechnical engineer, to ensure that its condition is compatible with the design of the foundation.



- 4. For slab-on-grade construction, any soft or loose soils should be subexcavated, aerated and properly compacted prior to the placement of the slab. Any new material for raising the grade should consist of organic-free soil compacted to at least 98% of its maximum Standard Proctor dry density. The slab should be constructed on a granular base, 20 cm thick, consisting of 20-mm Crusher-Run Limestone, or equivalent, compacted to its maximum Standard Proctor dry density.
- 5. A Class 'B' bedding, consisting of compacted 20-mm Crusher-Run Limestone, is recommended for the construction of the underground services. Where water-bearing silt and sands occur, the sewer joints should be leak-proof, or wrapped with an appropriate waterproof membrane, to prevent subgrade migration. Where extensive dewatering is required, a Class 'A' bedding can be considered.
- 6. Some of the revealed soils are highly frost susceptible with high soil-adfreezing potential. Where they are used to backfill against foundation walls, special measures must be incorporated into the building construction to prevent serious damage due to soil adfreezing.
- 7. The till contains occasional boulders and cobbles. Boulders over 15 cm in size must not be used for structural backfill and/or construction of engineered fill. Excavation into the till containing boulders will require extra effort and the use of a heavy-duty backhoe.

The recommendations appropriate for the project described in Section 2.0 are presented herein. One must be aware that the subsurface conditions may vary between boreholes. Should this become apparent during construction, a geotechnical engineer must be consulted to determine whether the following recommendations require revision.

6.1 Foundations

As a general guide for the design of house foundations, the recommended soil pressures and suitable founding levels, based on the borehole findings, are presented in Table 2.



Table 2 - Founding Levels

Recommended Maximum Allowable Soil Pressure (SLS)/ Factored Ultimate Soil Bearing Pressure (ULS) and Suitable Founding Level												
	75 kPa (SLS) 100 kPa (SLS) 200 kPa (SLS) 120 kPa (ULS) 160 kPa (ULS) 320 kPa (ULS)											
BH No.	Depth (m)	El. (m)	Depth (m)	El. (m)	Depth (m)	El. (m)						
1	-	-	-	-	1.6 or +	140.0 or -						
2	-	-	1.0 or +	140.5 or -	4.6 or +	136.9 or -						
3	-	-	1.0 or +	138.7 or -	4.6 or +	135.1 or -						
4	-	-	1.0 or +	138.1 or -	4.6 or +	134.5 or -						
5	1.0 or +	138.3 or -	-	-	4.6 or +	134.7 or -						

The recommended soil pressures (SLS) for normal foundations incorporate a safety factor of 3. The total and differential settlements of the foundations are estimated to be 25 mm and 15 mm, respectively.

Foundations exposed to weathering or in unheated areas should be protected against frost action by a minimum of 1.2 m of earth cover, or must be properly insulated.

The footing subgrade should be inspected by a geotechnical engineer, or a geotechnical technician under the supervision of a geotechnical engineer, to ensure that the revealed conditions are compatible with the foundation design requirements.

Perimeter subdrains and dampproofing of the basement walls will be required. All the subdrains must be encased in a fabric filter to protect them against blockage by silting, and they must be connected to a positive outlet.

The foundations must meet the requirements specified by the latest Ontario Building Code, and the buildings must be designed to resist a minimum earthquake force using Site Classification 'D' (stiff soil).

Some of the occurring soils are high in frost heave and soil-adfreezing potential. If these soils are to be used for the foundation backfill, the foundation walls should be shielded by a polyethylene slip-membrane for protection against soil adfreezing. The recommended measures are schematically illustrated in Diagram 1.









Diagram 1 - Frost Protection Measures (Foundations)

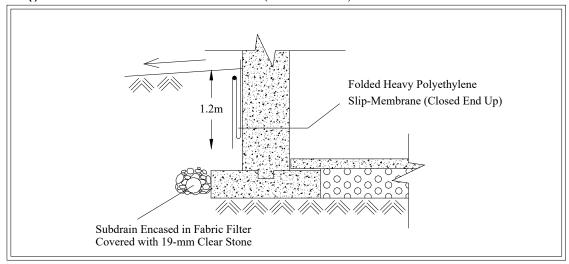


The necessity to implement the above recommendations should be further assessed by a geotechnical engineer at the time of construction.

6.2 **Engineered Fill**

Where earth fill is required to raise the site, the engineering requirements for a certifiable fill for road construction, municipal services, slab-on-grade, and footings designed with a Maximum Allowable Soil Pressure (SLS) of 100 kPa and a Factored Ultimate Soil Bearing Pressure (ULS) of 160 kPa for normal footings are presented below:

- The topsoil must be removed. The badly weathered soils must be inspected and proofrolled prior to any fill placement, in order to assess any subexcavation requirements.
 The stripped surface must be surface compacted. The wet silt and sands, if any,
 should be stabilized by gravel prior to surface compaction.
- 2. Inorganic soils must be used, and they must be uniformly compacted in lifts 20 cm thick to 98% or + of their maximum Standard Proctor dry density up to the proposed finished grade. The soil moisture must be properly controlled near the optimum. If the house foundations are to be built soon after the fill placement, the densification process for the engineered fill must be increased to 100% of the maximum Standard Proctor compaction.
- 3. If the engineered fill is compacted with the moisture content on the wet side of the optimum, the underground services and pavement construction should not begin until the pore pressure within the fill mantle has completely dissipated. This must be further assessed at the time of the engineered fill construction.





- 4. If imported fill is to be used, it should be inorganic soils, free of any deleterious material with environmental issue (contamination). Any potential imported earth fill from off site must be reviewed for geotechnical and environmental quality by the appropriate personnel as authorized by the developer or agency, before it is hauled to the site.
- 5. If the engineered fill is to be left over the winter months, adequate earth cover or equivalent must be provided for protection against frost action.
- 6. The engineered fill must extend over the entire graded area; the engineered fill envelope and finished elevations must be clearly and accurately defined in the field, and they must be precisely documented by qualified surveyors. Foundations partially on engineered fill must be reinforced by two 15-mm steel reinforcing bars in the footings and upper section of the foundation walls, or be designed by a structural engineer, to properly distribute the stress induced by the abrupt differential settlement (about 15 mm) between the natural soil and engineered fill.
- 7. The engineered fill must not be placed during the period from late November to early April when freezing ambient temperatures occur either persistently or intermittently. This is to ensure that the fill is free of frozen soils, ice and snow.
- 8. Where the fill is to be placed on a bank steeper than 1 vertical:3 horizontal, the face of the bank must be flattened to 3 + so that it is suitable for safe operation of the compactor and the required compaction can be obtained.
- 9. Where the ground is wet due to subsurface water seepage, an appropriate subdrain scheme must be implemented prior to the fill placement, particularly if it is to be carried out on sloping ground.
- 10. The fill operation must be inspected on a full-time basis by a technician under the direction of a geotechnical engineer.
- 11. The footing and underground services subgrade must be inspected by the geotechnical consulting firm that supervised the engineered fill placement. This is to ensure that the foundations are placed within the engineered fill envelope, and the integrity of the fill has not been compromised by interim construction, environmental degradation and/or disturbance by the footing excavation.
- 12. Any excavation carried out in certified engineered fill must be reported to the geotechnical consultant who supervised the fill placement in order to document the locations of excavation and/or to supervise reinstatement of the excavated areas to engineered fill status. If construction on the engineered fill does not commence within a period of 2 years from the date of certification, the condition of the engineered fill must be assessed for re-certification.
- 13. Despite stringent control in the placement of the engineered fill, variations in soil type and density may occur in the engineered fill. Therefore, the strip footings and the upper section of the foundation walls constructed on the engineered fill may require



continuous reinforcement with steel bars, depending on the uniformity of the soils in the engineered fill and the thickness of the engineered fill underlying the foundations. Should the footings and/or walls require reinforcement, the required number and size of reinforcing bars must be assessed by considering the uniformity as well as the thickness of the engineered fill beneath the foundations. In sewer construction, the engineered fill is considered to have the same structural proficiency as a natural inorganic soil.

6.3 Slab-On-Grade

For slab-on-grade construction, the subgrade must consist of sound natural soils, or properly compacted inorganic soils, compacted to at least 98% of its maximum Standard Proctor dry density. The slab should be constructed on a granular base, 20 cm thick, consisting of 20-mm Crusher-Run Limestone, or equivalent, compacted to its maximum Standard Proctor dry density.

The sound natural soils are suitable for slab-on-grade construction. The weathered soils should be aerated and surface compacted for slab-on-grade construction.

A Modulus of Subgrade Reaction of 25 MPa/m is recommended for the design of the floor slab on sound native soils or on engineered fill.

The ground around the buildings must be graded to direct water away from the structures to minimize the frost heave phenomenon generally associated with the disclosed soils.

6.4 <u>Underground Services</u>

The subgrade for the underground services should consist of natural soils or compacted organic-free earth fill. Where topsoil, earth fill and soft soil are encountered, these materials must be subexcavated and replaced with properly compacted bedding material.

A Class 'B bedding, consisting of compacted 20-mm Crusher-Run Limestone, is recommended for the construction of the underground services. The sewer joints should be leak-proof or wrapped with an appropriate waterproof membrane to prevent subgrade migration. Where extensive dewatering is required, a Class 'A' bedding can be considered.

In order to prevent pipe floatation when the sewer trench is deluged with water, a soil cover with a thickness equal to the diameter of the pipe should be in place at all times after completion of the pipe installation.



Openings to subdrains and catch basins should be shielded with a fabric filter to prevent blockage by silting.

6.5 Trench Backfilling

The on-site inorganic soils are suitable for trench backfill and the wet soils must be aerated before backfilling. In the zone within 1.0 m below the pavement subgrade, the backfill should be compacted to at least 98% of its maximum Standard Proctor dry density with the moisture content 2% to 3% drier than the optimum. In the lower zone, a 95% or + Standard Proctor compaction is considered to be adequate; however, the material should be compacted on the wet side of the optimum.

In normal underground services construction practice, the problem areas of road settlement largely occur adjacent to manholes, catch basins, services crossings, foundation walls and columns, and it is recommended that a sand backfill be used. The areas at the interface of the native soil and the sand backfill should preferably be flooded for several days.

The narrow trenches should be cut at 1 vertical:2 or + horizontal so that the backfill can be effectively compacted. Otherwise, soil arching will prevent the achievement of proper compaction. The lift of each backfill layer should either be limited to a thickness of 20 cm, or the thickness should be determined by test strips.

One must be aware of the possible consequences during trench backfilling and exercise caution as described below:

- When construction is carried out in freezing winter weather, allowance should be made for these following conditions. Despite stringent backfill monitoring, frozen soil layers may inadvertently be mixed with the structural trench backfill. Should the in situ soils have a water content on the dry side of the optimum, it would be impossible to wet the soils due to the freezing condition, rendering difficulties in obtaining uniform and proper compaction. Furthermore, the freezing condition will prevent flooding of the backfill when it is required, such as in a narrow vertical trench section, or when the trench box is removed. The above will invariably cause backfill settlement that may become evident within 1 to several years, depending on the depth of the trench which has been backfilled.
- In areas where the underground services construction is carried out during winter months, prolonged exposure of the trench walls will result in frost heave within the soil mantle of the walls. This may result in some settlement as the frost recedes, and



- repair costs will be incurred prior to final surfacing of the new pavement and the slabon-grade construction.
- To backfill a deep trench, one must be aware that future settlement is to be expected, unless the side of the cut is flattened to at least 1 vertical:1.5 + horizontal, and the lifts of the fill and its moisture content are stringently controlled; i.e., lifts should be no more than 20 cm (or less if the backfilling conditions dictate) and uniformly compacted to achieve at least 95% of the maximum Standard Proctor dry density, with the moisture content on the wet side of the optimum.
- It is often difficult to achieve uniform compaction of the backfill in the lower vertical section of deep trench which is an open cut or is stabilized by a trench box, particularly in the sector close to the trench walls or the sides of the box. These sectors must be backfilled with sand. In a trench stabilized by a trench box, the void left after the removal of the box will be filled by the backfill. It is necessary to backfill this sector with sand, and the compacted backfill must be flooded for 1 day, prior to the placement of the backfill above this sector, i.e., in the upper sloped trench section. This measure is necessary in order to prevent consolidation of inadvertent voids and loose backfill which will compromise the compaction of the backfill in the upper section. In areas where groundwater movement is expected in the sand fill mantle, anti-seepage collars should be provided.

6.6 Pavement Design

Based on the borehole findings, the recommended pavement design for local roads is presented in Table 3.

Table 3 - Pavement Design

Course	Thickness (mm)	OPS Specifications
Asphalt Surface	40	HL-3
Asphalt Binder	50	HL-8
Granular Base	150	Granular 'A' or equivalent
Granular Sub-base	300	Granular 'B' or equivalent

In preparation of the subgrade, the subgrade surface should be proof-rolled; any soft subgrade, organics and deleterious materials within 1.0 m below the underside of the granular sub-base should be subexcavated and replaced by properly compacted organic-free earth fill or granular material.



All the granular bases should be compacted to their maximum Standard Proctor dry density.

In the zone within 1.0 m below the pavement subgrade, the backfill should be compacted to at least 98% of its maximum Standard Proctor dry density, with the water content 2% to 3% drier than the optimum. In the lower zone, a 95% or + Standard Proctor compaction is considered adequate.

The road subgrade will suffer a strength regression if water is allowed to infiltrate prior to paving. The following measures should therefore be incorporated in the construction procedures and road design:

- If the road construction does not immediately follow the trench backfilling, the subgrade should be properly crowned and smooth-rolled to allow interim precipitation to be properly drained.
- Lot areas adjacent to the roads should be properly graded to prevent the ponding of large amounts of water during the interim construction period.
- Curb subdrains will be required. The subdrains should consist of filter-sleeved weepers to prevent blockage by silting.
- If the roads are to be constructed during the wet seasons and extensively soft subgrade occurs, the granular sub-base may require thickening. This can be assessed during construction.

6.7 **Soil Parameters**

The recommended soil parameters for the project design are given in Table 4.

Table 4 - Soil Parameters

Unit Weight and Bulk Factor			
	Unit Weight (kN/m³)		stimated ılk Factor
	Bulk	Loose	Compacted
Weathered Soil	20.5	1.20	0.95
Sound Till	22.0	1.33	1.03
Silt and Sands	20.5	1.20	0.98



Table 4 - Soil Parameters (cont'd)

Lateral Earth Pressure Coefficients			
	Active K _a	At Rest K ₀	Passive K _p
Sound Till	0.30	0.40	3.33
Silt and Sands	0.33	0.43	3.00

6.8 Excavation

Excavation should be carried out in accordance with Ontario Regulation 213/91.

Excavation into the till containing boulders will require extra effort and the use of a heavy-duty, properly equipped backhoe.

For excavation purposes, the types of soils are classified in Table 5.

Table 5 - Classification of Soils for Excavation

Material	Туре
Sound Till	2
Silt and Sands above groundwater	3
Silt and Sands below groundwater	4

The groundwater yield from the silty sand till, due to its relatively low permeability, will be small to moderate and limited and can be controlled by pumping from sumps. The yield of groundwater, if encountered in the silt and sands is expected to be moderate to appreciable and may be persistent, and the groundwater may be controllable by pumping from closely spaced sumps or, if necessary, by the use of a well-point dewatering system. The appropriate method of dewatering should be assessed by a hydrogeological study.

Prospective contractors must be asked to assess the in situ subsurface conditions for soil cuts by digging test pits to at least 0.5 m below the intended bottom of excavation. These test pits should be allowed to remain open for a period of at least 4 hours to assess the trenching conditions.



7.0 <u>LIMITATIONS OF REPORT</u>

This report was prepared by Soil Engineers Ltd. for the account of Highglen Homes Limited, and for review by their designated consultants and government agencies. Use of the report is subject to the conditions and limitations of the contractual agreement. The material in the report reflects the judgement of Frank Lee, P. Eng. and Bernard Lee, P.Eng., in light of the information available to it at the time of preparation. Any use which a Third Party makes of this report, or any reliance on decisions to be made based on it, are the responsibility of such Third Parties. Soil Engineers Ltd. accepts no responsibility for damages, if any, suffered by any Third Party as a result of decisions made or actions based on this report.

SOIL ENGINEERS LTD.

Frank Lee, P.Eng.

Bernard Lee, P.Eng. FL/BL:dd





LIST OF ABBREVIATIONS AND DESCRIPTION OF TERMS

The abbreviations and terms commonly employed on the borehole logs and figures, and in the text of the report, are as follows:

SAMPLE TYPES

AS Auger sample Chunk sample CS DO Drive open (split spoon) Denison type sample DS Foil sample FS Rock core (with size and percentage RC recovery) Slotted tube STTO Thin-walled, open TP Thin-walled, piston WS Wash sample

SOIL DESCRIPTION

Cohesionless Soils:

<u>/s/ft)</u>	Relative Density
4	very loose
10	loose
30	compact
50	dense
50	very dense
	4 10 30 50

Cohesive Soils:

Undrained Shear

less than 0.25

to

to

to 1.0

to 4.0

over 4.0

0.50

2.0

Strength (ksf)

0.25

0.50

1.0

2.0

PENETRATION RESISTANCE

Dynamic Cone Penetration Resistance:

A continuous profile showing the number of blows for each foot of penetration of a 2-inch diameter, 90° point cone driven by a 140-pound hammer falling 30 inches.

Plotted as '---'

Method of Determination of Undrained

Shear Strength of Cohesive Soils:

x 0.0 Field vane test in borehole; the number denotes the sensitivity to remoulding

 \triangle Laboratory vane test

☐ Compression test in laboratory

For a saturated cohesive soil, the undrained shear strength is taken as one half of the undrained compressive strength

'N' (blows/ft)

0 to 2

4 to 8

8 to 16

over 32

32

to 4

2

16 to

Consistency

very soft

very stiff

soft

firm

stiff

hard

Standard Penetration Resistance or 'N' Value:

The number of blows of a 140-pound hammer falling 30 inches required to advance a 2-inch O.D. drive open sampler one foot into undisturbed soil.

Plotted as 'O'

WH Sampler advanced by static weight
 PH Sampler advanced by hydraulic pressure
 PM Sampler advanced by manual pressure
 NP No penetration

METRIC CONVERSION FACTORS

1 ft = 0.3048 metres 1 inch = 25.4 mm 1lb = 0.454 kg 1ksf = 47.88 kPa



JOB NO.: 1911-S057 LOG OF BOREHOLE NO.: 1

FIGURE NO.:

1

PROJECT DESCRIPTION: Proposed Residential Development

METHOD OF BORING: Flight-Auger

DRILLING DATE: December 12, 2019

PROJECT LOCATION: 230 Finch Avenue

(Part 4, Plan #40 R-29767)

City of Pickering

SAMPLES SOIL DESCRIPTION SOIL DESCRIPTION DESC		City of Pickering																	
Fig.			SAMPLES				10 30 50 70 90						Atterbera Limits						
30 cm TOPSOIL	(m) Depth	SOIL DESCRIPTION	Number	Туре	N-Value	Depth Scale (m)	X Shear Strength (kN/m²) 50 100 150 200 Penetration Resistance (blows/30 cm)					PL LL Moisture Content (%)						WATER LEVEL	
30 cm TOPSOIL	141.6	Ground Surface																	
Brown DISTURBED/WEATHERED SOIL Sand with gravel and rock fragments 2 DO 22 1	0.0	30 cm TOPSOIL	\top			0 -	\top									22		T	
Sand with gravel and rock fragments 2 DO 22 1 DO DO DO DO DO DO			1	DO	9		0											- - -	
1.4 Brown, dense to very dense 3 DO 58 2 2 3 3 3 3 3 3 3 3	140.2	sand with gravel	2	DO	22	1 -		0					6					- - -	
138.7 Brown, dense	1.4	Brown, dense to very dense	┧				#								\Box			11	
A DO 48 A DO 48 Brown, dense MEDIUM TO COARSE SAND Some silt 137.6 4.0 Grey, compact to dense 6 DO 21 SILTY SAND TILL occ. wet sand and silt seams and layers cobbles and boulders 7 DO 49 135.0 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing			3	DO	58	2 -				0			5						
MEDIUM TO COARSE SAND Some silt 137.6 4.0 Grey, compact to dense 6 DO 21 Oc. wet sand and silt seams and layers cobbles and boulders 7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m Sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing		GRAVELLY SAND					$\pm \pm$			+					\vdash	++	++	-11	L L
MEDIUM TO COARSE SAND Some silt 137.6 4.0 Grey, compact to dense 6 DO 21 Oc. wet sand and silt seams and layers cobbles and boulders 7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m Sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing	400.7		4	DO	48				0)								_	completic
MEDIUM TO COARSE SAND Some silt 137.6 4.0 Grey, compact to dense 6 DO 21 Oc. wet sand and silt seams and layers cobbles and boulders 7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m Sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing	2.9	Brown, dense				3 -												_	Ou
37.6 4.0 Grey, compact to dense 6 DO 21 SILTY SAND TILL occ. wet sand and silt seams and layers cobbles and boulders 7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing			5	DO	46				0				5						Dry o
4.0 Grey, compact to dense 6 DO 21 Coc. wet sand and silt seams and layers cobbles and boulders 7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing	137.6	some silt																- - - -	1
SILTY SAND TILL occ. wet sand and silt seams and layers cobbles and boulders 7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing	4.0	Grey, compact to dense				4 -													
occ. wet sand and silt seams and layers cobbles and boulders 7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing		SILTY SAND TILL	6	DO	21	5 -	-	0					1	1					<u> </u>
7 DO 49 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing		silt seams and layers																	- - - - -
135.0 END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing						6 -							1	0					1
END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing	135.0		7	DO	49				d)				•					
	0.0	Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m				7 -													
						8									\Box				



Soil Engineers Ltd.

JOB NO.: 1911-S057 LOG OF BOREHOLE NO.: 2

METHOD OF BORING: Flight-Auger

FIGURE NO.:

2

PROJECT DESCRIPTION: Proposed Residential Development

DRILLING DATE: December 12, 2019

PROJECT LOCATION: 230 Finch Avenue

(Part 4, Plan #40 R-29767)

City of Pickering

	City of Pickering						
		Ś	SAMP	LES		Dynamic Cone (blows/30 cm) 30 50 70 90 Atterberg Limits	
EI. (m) Depth (m)	SOIL DESCRIPTION	Number	90	N-Value	Depth Scale (m)	X Shear Strength (kN/m²) 50 100 150 200 O Penetration Resistance (blows/30 cm) 10 30 50 70 90 10 20 30 40 PL LL W H Moisture Content (%)	
		N	Туре	-Z	Del	10 30 50 70 90 10 20 30 40	
141.5	Ground Surface						
0.0	36 cm TOPSOIL				0 -	32	
140.8	Brown DISTURBED/WEATHERED SOIL	1	DO	4	- - -	-0	
0.7	sand with gravel and cobbles Brown, compact to dense	2	DO	40	1 -	3	
	GRAVELLY SAND	3	DO	28	2 -		
139.4 2.1	Brown, compact				2 -		_
	FINE TO COARSE SAND	4	DO	28			Ury on completion
138.6	some silt				-	1	I COI
2.9	Compact to dense				3 -	11 11 5	y or
	SILTY SAND TILL occ. wet sand and — brown	5	DO	11	4 -		בֿ
	silt seams and layers cobbles and boulders	6	DO	22	5 -		
134.9		7	DO	32	6 -		
6.6	END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing				7 -		



Soil Engineers Ltd.

JOB NO.: 1911-S057 LOG OF BOREHOLE NO.: 3

FIGURE NO.:

3

PROJECT DESCRIPTION: Proposed Residential Development

METHOD OF BORING: Flight-Auger

DRILLING DATE: December 12, 2019

PROJECT LOCATION: 230 Finch Avenue

(Part 4, Plan #40 R-29767)

City of Pickering

	City of Pickering					
		(SAMP	LES		● Dynamic Cone (blows/30 cm) 10 30 50 70 90 Atterberg Limits
EI. (m) Depth (m)	SOIL DESCRIPTION	Number	Туре	N-Value	Depth Scale (m)	X Shear Strength (kN/m²) 50 100 150 200 O Penetration Resistance (blows/30 cm) ■ Moisture Content (%) 10 30 50 70 90 10 20 30 40
139.7	Ground Surface					
0.0	36 cm TOPSOIL				0	<u>-</u>
139.0	Brown DISTURBED/WEATHERED SOIL sand with gravel	1	DO	5		10 41
0.7	Brown, compact	2	DO	28	1 -	12 - O •
	FINE TO COARSE SAND some silt	3	DO	26	2 -	
		4	DO	19	_	o o ompletion
136.8 2.9	Brown, compact				3 -	o o
	SILTY FINE SAND	5	DO	11		10 O O O O O O O O O O O O O O O O O O O
135.7						
4.0	Compact to dense				4 -	
	SILTY SAND TILL	6	DO	25	5 -	
	occ. wet sand and silt seams and layers cobbles and boulders					
	<u>brown</u> grey	7	DO	36	6 -	
133.1 6.6	END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing	,			7 -	
	. ,				8	



Soil Engineers Ltd.

LOG OF BOREHOLE NO.: 4 JOB NO.: 1911-S057

METHOD OF BORING: Flight-Auger

PROJECT DESCRIPTION: Proposed Residential Development

DRILLING DATE: December 12, 2019

FIGURE NO.:

4

PROJECT LOCATION: 230 Finch Avenue

(Part 4, Plan #40 R-29767)

City of Pickering

	City of Pickering											
		Ç	SAMP	LES		Dynamic Cone (blow) 30 50	70 90	Atterberg				
EI. (m) Depth (m)	SOIL DESCRIPTION	Number	Туре	N-Value	Depth Scale (m)	Shear Strength (kl 50 100 150 1 1 1 1 1 Penetration Resist (blows/30 cm)	N/m²) 200 L L tance		Moisture Content (%)			
		ž	Ţ	ż	۵	30 50	70 90	10 20	30 40	WATER LEVEL		
139.1	Ground Surface											
0.0	30 cm TOPSOIL				0				32			
138.4	Brown DISTURBED/WEATHERED SOIL sand a trace of gravel	1	DO	3	- -					- -		
0.7	Brown, compact to dense	2	DO	44	1 -	0		16		-		
	FINE TO COARSE SAND some silt	3	DO	32	2 -	0		5		- - -		
		4	DO	20	-	Φ		6				
136.2 2.9	Brown, loose				3 -]		
	SILTY FINE SAND	5	DO	9				21		ompletion		
125.1												
135.1 4.0	Grey, dense				4 -					El. 133.6 m on completion		
	GRAVELLY SAND	6	DO	36	5 -	0		16		W.L. @ E		
133.6 5.5	Grey, dense				-							
	SILTY SAND TILL				6 -							
132.5 6.6		7	DO	32		0		9		-		
	END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing				7 -					- - - -		
					8							



Soil Engineers Ltd.

JOB NO.: 1911-S057 LOG OF BOREHOLE NO.: 5

PROJECT DESCRIPTION: Proposed Residential Development METHOD OF BORING: Flight-Auger

PROJECT LOCATION: 230 Finch Avenue

DRILLING DATE: December 12, 2019

FIGURE NO.:

5

(Part 4, Plan #40 R-29767)

City of Pickering

	City of Pickering	1				_	_	Dyn	amic (Cono	(blov	uc/20	cm)	Т							—		
			SAMP	LES		10	0	30)	50	7	0	90			Atte	erbe	era l	Limit	S			
EI. (m) Depth (m)	SOIL DESCRIPTION	Number	Туре	N-Value	Depth Scale (m)		× 50	Shea	ar Stre 100 L etratio (blow	ength	t (kN/ 50 	'm²) 200				PL -	ture	e Co	 	nt (%)	.)		WATER LEVEL
120.2	Ground Surface	╫	'	_	_	\vdash								t	ШĹ					<u> </u>	_		_
139.3 0.0	25 cm TOPSOIL				0	\vdash				Т	Τ			H		Τ.	T	Т		o	\dashv	П	
138.6	Brown DISTURBED/WEATHERED SOIL sand a trace of gravel	1	DO	3	-	O											8						
0.7	Brown, compact to dense	2	DO	22	1 -	-	(5							10								
	FINE TO COARSE SAND					ш															$\perp \perp$	Ш	
	some silt	3	DO	40	3	-			0					3									
137.2 2.1	Brown, loose				2 -	-																Ш	
	SANDY SILT	4	DO	6	- - -	0											21						
136.4 2.9	Brown, loose				3 -	П															П	$\ \cdot\ $	
2.,	FINE TO COARSE SAND	5	DO	7	3 -	0								3									oletion
135.3	some silt																						on com
4.0	Brown, very dense				4 -																		133.8 m on completion
	GRAVELLY SAND	6	DO	60	5 -						0				7							ㅐ	W.L. @ EI.
						Ħ								l							\top		
133.8 5.5	Grey, compact	+			_																		$\overline{\underline{iggr}}$
	SILTY SAND TILL				6 -																	•	
132.7	SILIT SAND HEL	7	DO	30				C)						9								
6.6	END OF BOREHOLE Installed 50 mm Ø monitoring well to 6.0 m sand backfill from 2.4 to 6 m Bentonite from 0 to 2.4 m provided with a steel protective casing				7 -	-																	
1					8	Ш																	



Soil Engineers Ltd.



Reference No: 1911-S057

U.S. BUREAU OF SOILS CLASSIFICATION

			GRA	VEL								SANI)				SILT		CLAV	
			COARSE				FINE	(COARS	E N	MEDIUM	Л	FINE	V.	FINE		SILI		CLAY	
	UNIFIED SOIL CLASSIFICA	ΓΙΟΝ																		
	G	RAVEI	Ĺ						SA	ND							SILT &	CLAY		
	COARSE		F	INE	COA	ARSE	N	/IEDIU	JM				FINE							
	3" 2-1/2" 2" 1-1/2" 1"	3/4"	1/2" 3/	/8"	ŀ	8 10) 16	20	31	0 4	0 50	60	100	140	200	270 325				
ſ		<u> </u>	•				,	11.				'	'							
ŀ		\rightarrow																		
l		`																		
ŀ														+						
l				\downarrow																
I					_															
ŀ																				
l								\nearrow	\bigcup											
ŀ																				
l																				
l																				
ŀ														$+\!\!+\!\!\!+$						
l																				
ŀ														\rightarrow	+					
l																				
I																				
L																				

Project: Proposed Residential Development

Grain Size in millimeters

230 Finch Avenue (Part 4, Plan #40 R-29767), City of Pickering Location:

10

Liquid Limit (%) = Plastic Limit (%) =

Plasticity Index (%) =

Moisture Content (%) =

Estimated Permeability

Sample No: Depth (m): 0.3 Elevation (m): 141.3

Borehole No:

(cm./sec.) =


Classification of Sample [& Group Symbol]:

GRAVELLY SAND, some silt



Reference No: 1911-S057

U.S. BUREAU OF SOILS CLASSIFICATION

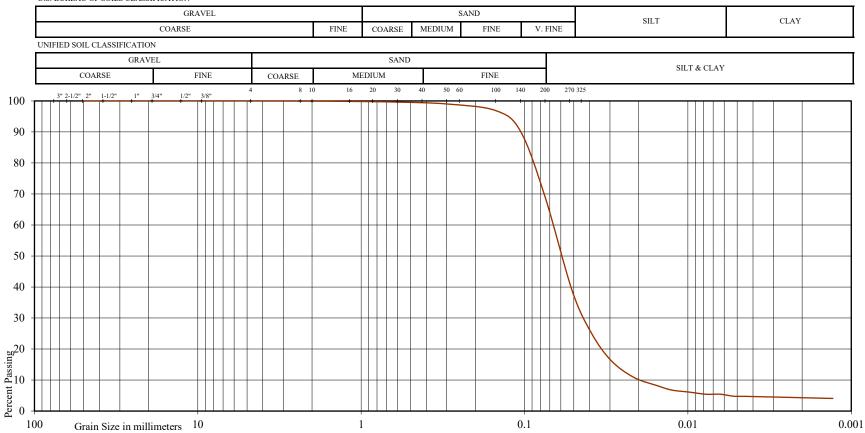

Project: Proposed Residential Development

5

4

Borehole No:

Sample No:

230 Finch Avenue (Part 4, Plan #40 R-29767), City of Pickering Location:

Liquid Limit (%) =

Plastic Limit (%) =

Plasticity Index (%) =

Moisture Content (%) = 21

Estimated Permeability

Depth (m): 2.5


 $(cm./sec.) = 10^{-4}$ Elevation (m): 136.8

Classification of Sample [& Group Symbol]: SANDY SILT, a trace of clay Figure:



Reference No: 1911-S057

U.S. BUREAU OF SOILS CLASSIFICATION

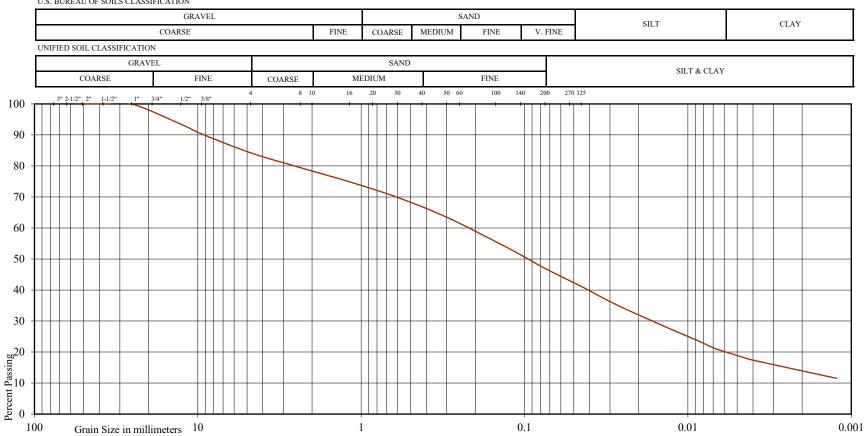

Project: Proposed Residential Development

230 Finch Avenue (Part 4, Plan #40 R-29767), City of Pickering Location:

Liquid Limit (%) =

Plastic Limit (%) =

(cm./sec.) =

Plasticity Index (%) =

Moisture Content (%) = 10

Estimated Permeability

Depth (m): 6.3

Borehole No:

Sample No:

Elevation (m): 135.3 Classification of Sample [& Group Symbol]:

1


7

SILTY SAND TILL, some clay and gravel



Reference No: 1911-S057

U.S. BUREAU OF SOILS CLASSIFICATION

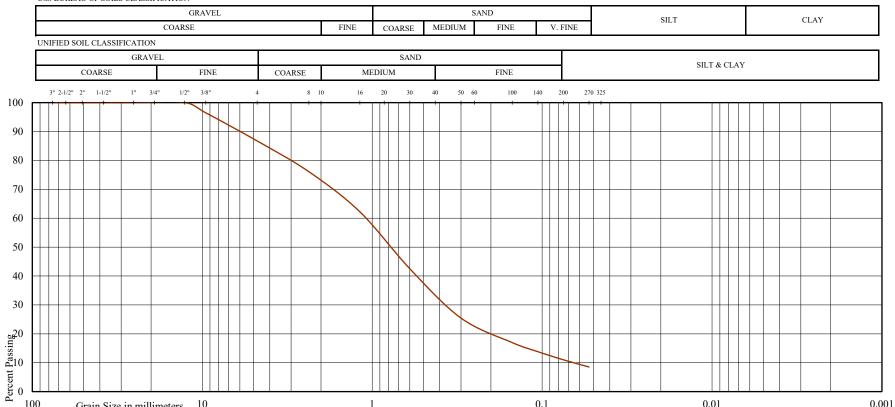

0.1

Proposed Residential Development Project:

Grain Size in millimeters

230 Finch Avenue (Part 4, Plan #40 R-29767), City of Pickering Location:

10

Liquid Limit (%) = Plastic Limit (%) =

Plasticity Index (%) =

Moisture Content (%) =

Estimated Permeability

0.01

Depth (m): 2.5

(cm./sec.) =

Classification of Sample [& Group Symbol]:

2

100


Borehole No:

Elevation (m): 139.0

Sample No:

FINE TO COARSE SAND, some silt and gravel

0.001

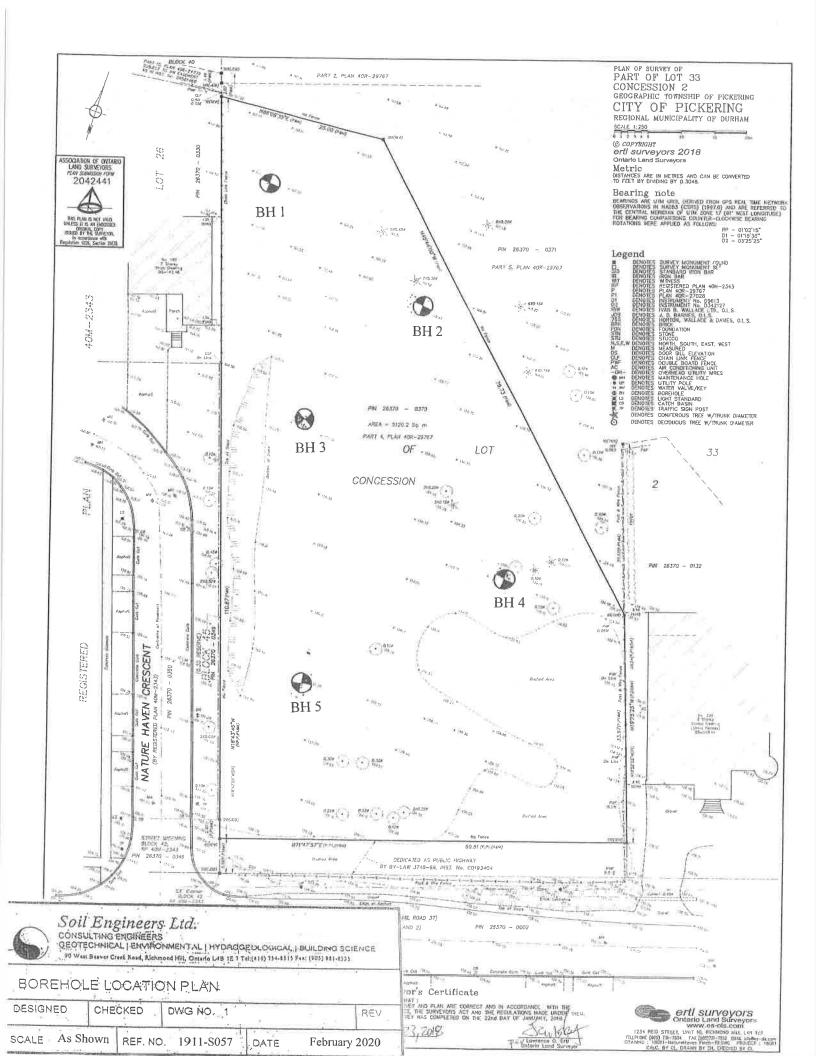



GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE

SUBSURFACE PROFILE **DRAWING NO. 2 SCALE: AS SHOWN**

SANDY SILT

JOB NO.: 1911-S057

REPORT DATE: February 2020


PROJECT DESCRIPTION: Proposed Residential Development

SAND FILL SILTY SAND

LEGEND

SILTY SAND TILL

PROJECT LOCATION: 230 Finch Avenue

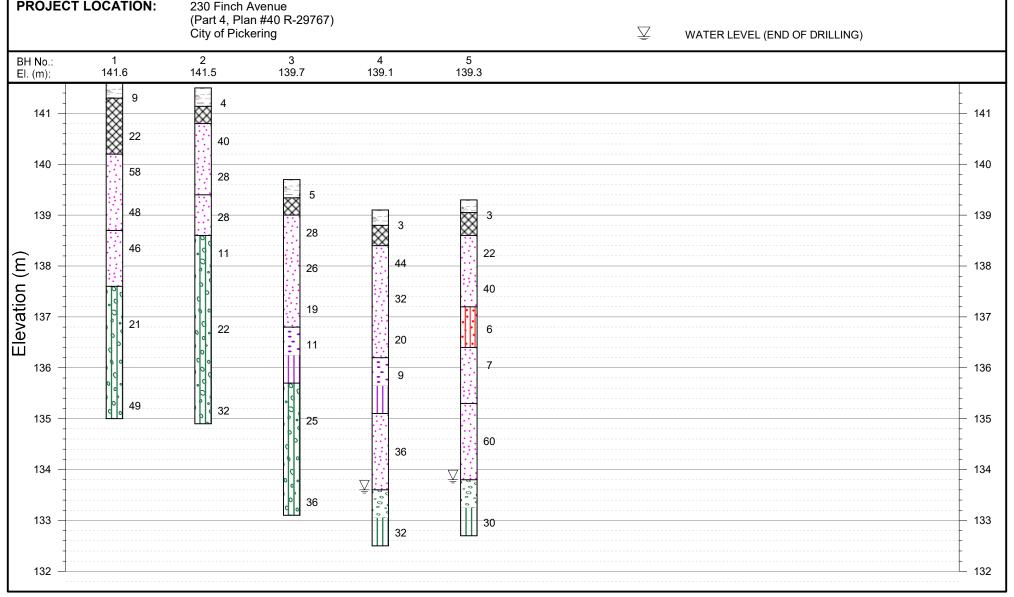

90 WEST BEAVER CREEK ROAD, SUITE 100, RICHMOND HILL, ONTARIO L4B 1E7 · TEL: (416) 754-8515 · FAX: (905) 881-8335

TEL: (705) 721-7863 FAX: (705) 721-7864

MISSISSAUGA TEL: (905) 542-7605 FAX: (905) 542-2769

OSHAWA TEL: (905) 440-2040 FAX: (905) 725-1315

NEWMARKET TEL: (905) 853-0647 FAX: (905) 881-8335

MUSKOKA TEL: (705) 684-4242 FAX: (705) 684-8522

HAMII TON TEL: (905) 777-7956 FAX: (905) 542-2769

August 18, 2023

Reference No. 1911-W057 Page 1 of 3

Highglen Homes Limited 10148 Warden Avenue Markham, Ontario L6C 1N3

Attention: Mr. Johan Perciasepe

Re: **Spring Season Groundwater Level Monitoring**

Proposed Residential Development

230 Finch Avenue. Part 4, Plan # 40 R-29767

Town of Pickering

Dear Sir:

Soil Engineers Ltd. (SEL) conduct a spring groundwater table monitoring program at the captioned property located, at 230 Finch Avenue, Town of Pickering (the Subject Site). This letter presents the results for the Spring, seasonal high groundwater table monitoring program.

Background Review

A spring season groundwater level monitoring program was carried out at the Subject Site, at the location shown on **Drawing No. 1**. The study was authorized in support of a proposed residential development. The purpose of the groundwater monitoring program is to verify the seasonal spring high groundwater levels and their associated fluctuations beneath the Subject Site.

Shallow groundwater level monitoring program was conducted at the monitoring wells, that were previously installed on the Subject Site by SEL as a part of the geotechnical investigation (SEL Reference No.: 1911-S057), and the hydrogeological assessment (SEL Reference No.: 1911-W057).

The groundwater levels within the monitoring wells were manually recorded during six (6) monitoring events, including three (3) monitoring events conducted for the hydrogeological assessment in January 2020, and three (3) monitoring events completed during the spring 2023 (between April 14 and June 19, 2023). A summary of the groundwater monitoring program is presented in **Table 1**. The locations of the monitoring wells are shown on **Drawing No. 2**.

Table 1-Groundwater Level Monitoring Details

Well ID		Jan. 8, 2020	Jan. 14, 2020	Jan. 28, 2020	April 14, 2023	May 15, 2023	June 19, 2023
BH/MW 1	mbgs	3.79	3.40	3.67	3.64	3.86	4.0
BH/WW I	masl	137.81	138.2	137.93	137.96	137.74	137.6
BH/MW 2	mbgs	3.53	2.96	3.2	2.96	3.3	3.6
BH/MW 2	masl	137.97	138.54	138.3	138.54	138.2	137.9
DII/MW 2	mbgs	2.92	2.58	2.43	2.3	2.59	2.84
BH/MW 3	masl	136.78	137.12	137.27	137.4	137.11	136.86
BH/MW 4	mbgs	3.34	2.96	2.86	2.51	2.91	2.91
DΠ/IVI W 4	masl	135.76	136.14	136.24	136.59	136.19	136.19
DII/MW/5	mbgs	3.39	3.01	2.9	2.6	2.91	2.91
BH/MW 5	masl	135.91	136.29	136.4	136.7	136.39	136.39

mbgs: metres below ground surface


surface masl: metres above sea level

Discussion

The measured groundwater levels elevations ranged from 136.19 to 138.54 metres above sea level (masl) during the three (3) spring monitoring events. The highest shallow groundwater level was measured in BH/MW 2 on April 14, 2023.

The groundwater levels were at their lowest during the April 14, 2023 monitoring event for all the monitoring wells.

We trust that this correspondence addresses your current requirements and ask that you contact us should you have any questions or require additional information.



Yours truly, **SOIL ENGINEERS LTD.**

Bhawandeep Singh Brar, B.Sc

Gavin O'Brien, M.Sc., P.Geo.

BB/GO

ENCLOSURES

Source: Ministry of Natural Resources and Forestry ©Queen's Printer for Ontario, 2019 Metres

Drawing No. 1

648800

Source: Ministry of Natural Resources and Forestry ©Queen's Printer for Ontario, 2019 0 2.5 5

Drawing No. 2


Metres

February 2025 File: **17149**

APPENDIX "H"

Topographic Survey



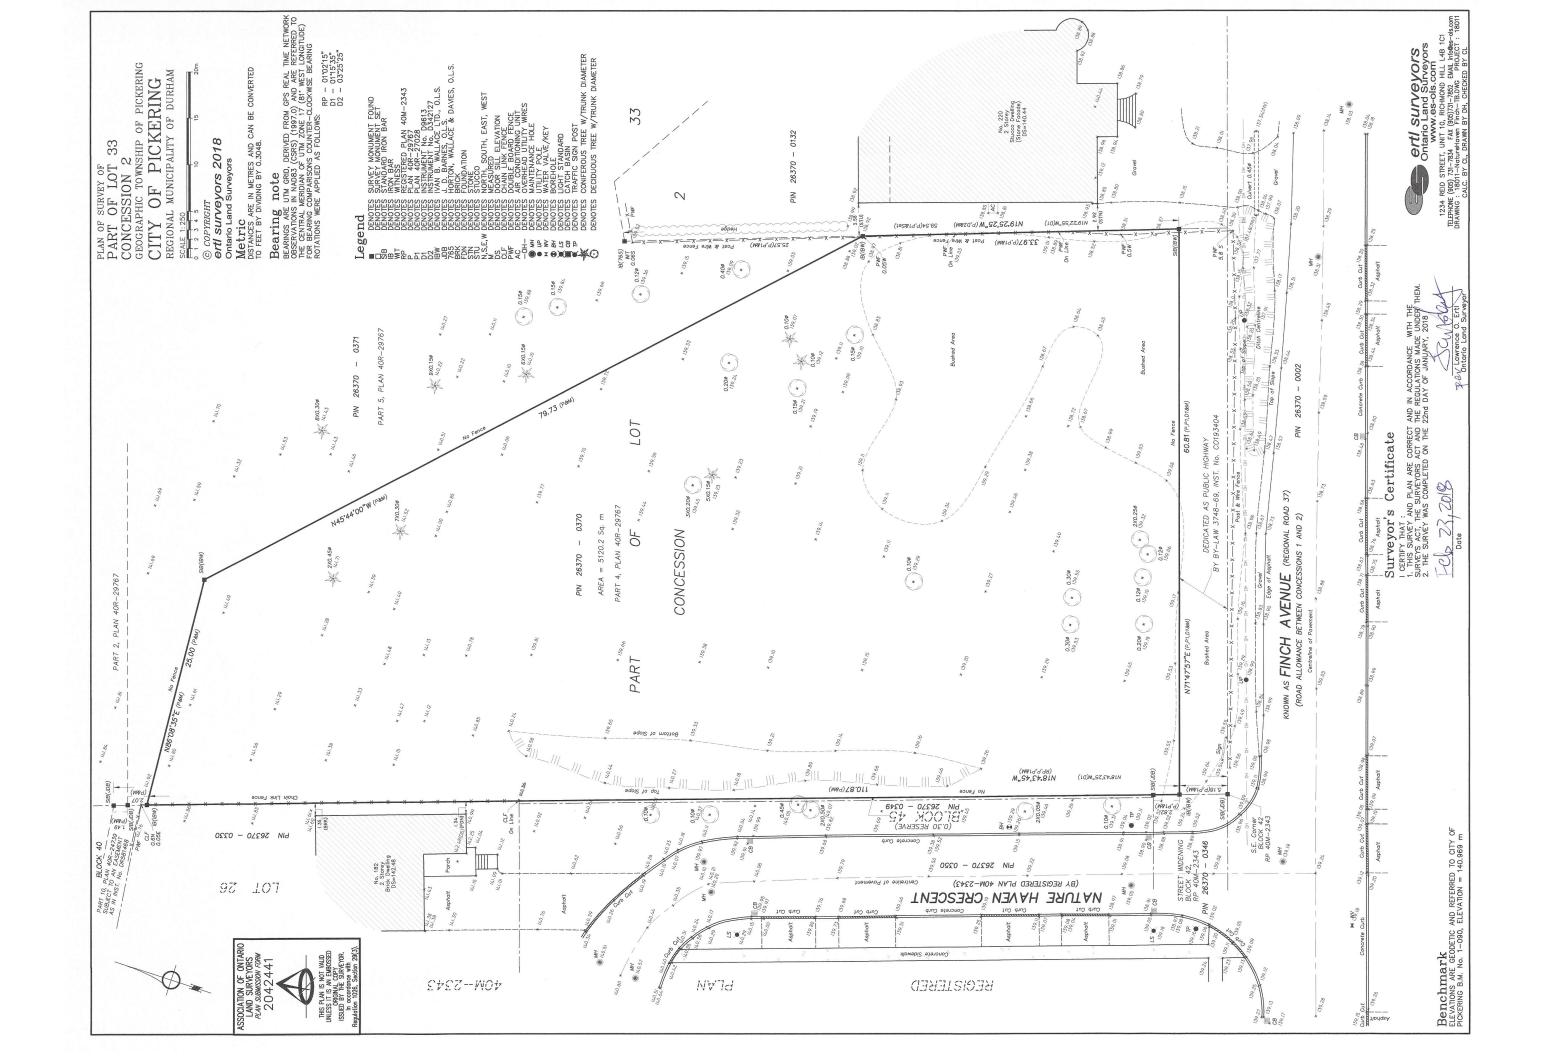

APPENDIX "I"

Functional Servicing Report for ORC Altona Road Lands



Prepared By: Sabourin Kimble & Associates Ltd.

Prepared For: Malone Given Parsons Ltd.

Project Number: 08:168

Date: February, 2010

TABLE OF CONTENTS

1.0	INTE	RODUCTION	1
2.0	STU	DY AREA	2
3.0	STO	RM DRAINAGE	4
3.1	Ex	xisting Site Drainage	4
3.2	Po	ost Development Conditions	4
3	3.2.1	Parcel 1	5
_	3.2.2	Parcel 2	
	3.2.3	Parcel 3	
-	3.2.4 3.2.5	Parcel 4 Parcel 5	
	3.2.6	Parcel 6	
-	3.2.7	Parcel 7	
3.3	Se	ervice Connections	
3.4	Re	ear Lot Catchbasin Design	7
4.0	STO	RMWATER MANAGEMENT	8
4.1	Pa	arcel 1	8
4.2	Pa	arcels 2-6	8
4.3	Pa	arcel 7	9
5.0	SAN	ITARY DRAINAGE	10
5.1	Ex	cisting Conditions	10
5.2	Pr	oposed Sanitary Servicing	10
5	5.2.1	Design Flow	10
_	.2.2	Parcel 1	
_	5.2.3	Parcel 2 – 7	
5.3	Se	ervice Connections	12
6.0	WAT	TER SUPPLY	13
6.1	Ex	cisting Water Supply Infrastructure	13
6.2	Pr	oposed Water System	13
6.3	Se	ervice Connections	13

7.0	SITE GRADING	.14
8.0	SEDIMENTATION CONTROL MEASURES	.22

LIST OF FIGURES

Figure 1 -	Study Area	3
Figure 2 -	Storm Servicing Plan - West	.Back Pocket
Figure 3 -	Storm Servicing Plan - East	.Back Pocket
Figure 4 -	Sanitary Servicing Plan - West	.Back Pocket
Figure 5 -	Sanitary Servicing Plan - East	.Back Pocket
Figure 6 -	Watermain Servicing Plan	.Back Pocket
Figure 7 -	Preliminary Grading Plan - Parcel 1	15
Figure 8 -	Preliminary Grading Plan - Parcel 2	16
Figure 9 -	Preliminary Grading Plan - Parcel 3	17
Figure 10 -	Preliminary Grading Plan - Parcel 4	18
Figure 11 -	Preliminary Grading Plan - Parcel 5	19
Figure 12 -	Preliminary Grading Plan - Parcel 6	20
Figure 13 -	Preliminary Grading Plan - Parcel 7	21



LIST OF TABLES

Table 1 -	Population Densities – Unknown Lot Configuration1	1
Table 2 -	Population Densities – Known Lot Configuration1	1



LIST OF APPENDICES

Appendix A Parcel 1 – Storm Sewer Design

Appendix B Stormwater Management Calculations



1.0 INTRODUCTION

Sabourin Kimble & Associates has been retained by Malone Given Parsons Ltd. to carry out a Functional Servicing Report for the ORC Altona Road Lands.

This Functional Servicing Report applies to the lands located within City of Pickering – Section N1 – Rouge Park Neighbourhood and will be referred to in this report as the Study Area.

The purpose of this Functional Servicing Report is to provide municipal servicing information to address stormwater management, storm drainage, sanitary drainage, water supply, and grading for these lands.




2.0 STUDY AREA

Figure 1 – Study Area, illustrates the configuration of the proposed parcels of land and the surrounding lands showing the location of the Study Area including the road pattern, development areas, and limits of development.

The ORC Altona Road Lands are located in the City of Pickering, Regional Municipality of Durham. The Study Area is bounded on the north by CP Rail lands; on the south by Ontario Hydro Corridor; on the east by Rosebank Road; and on the west by Woodview Avenue.

The Study Area has been subdivided into 7 parcels of land based on the developable boundaries, previously determined through other engineering and environmental investigations, and servicing characteristics determined by this report. These parcels are outlined in Figure 1 – Study Area and will be referred to by their parcel number from this point forward.

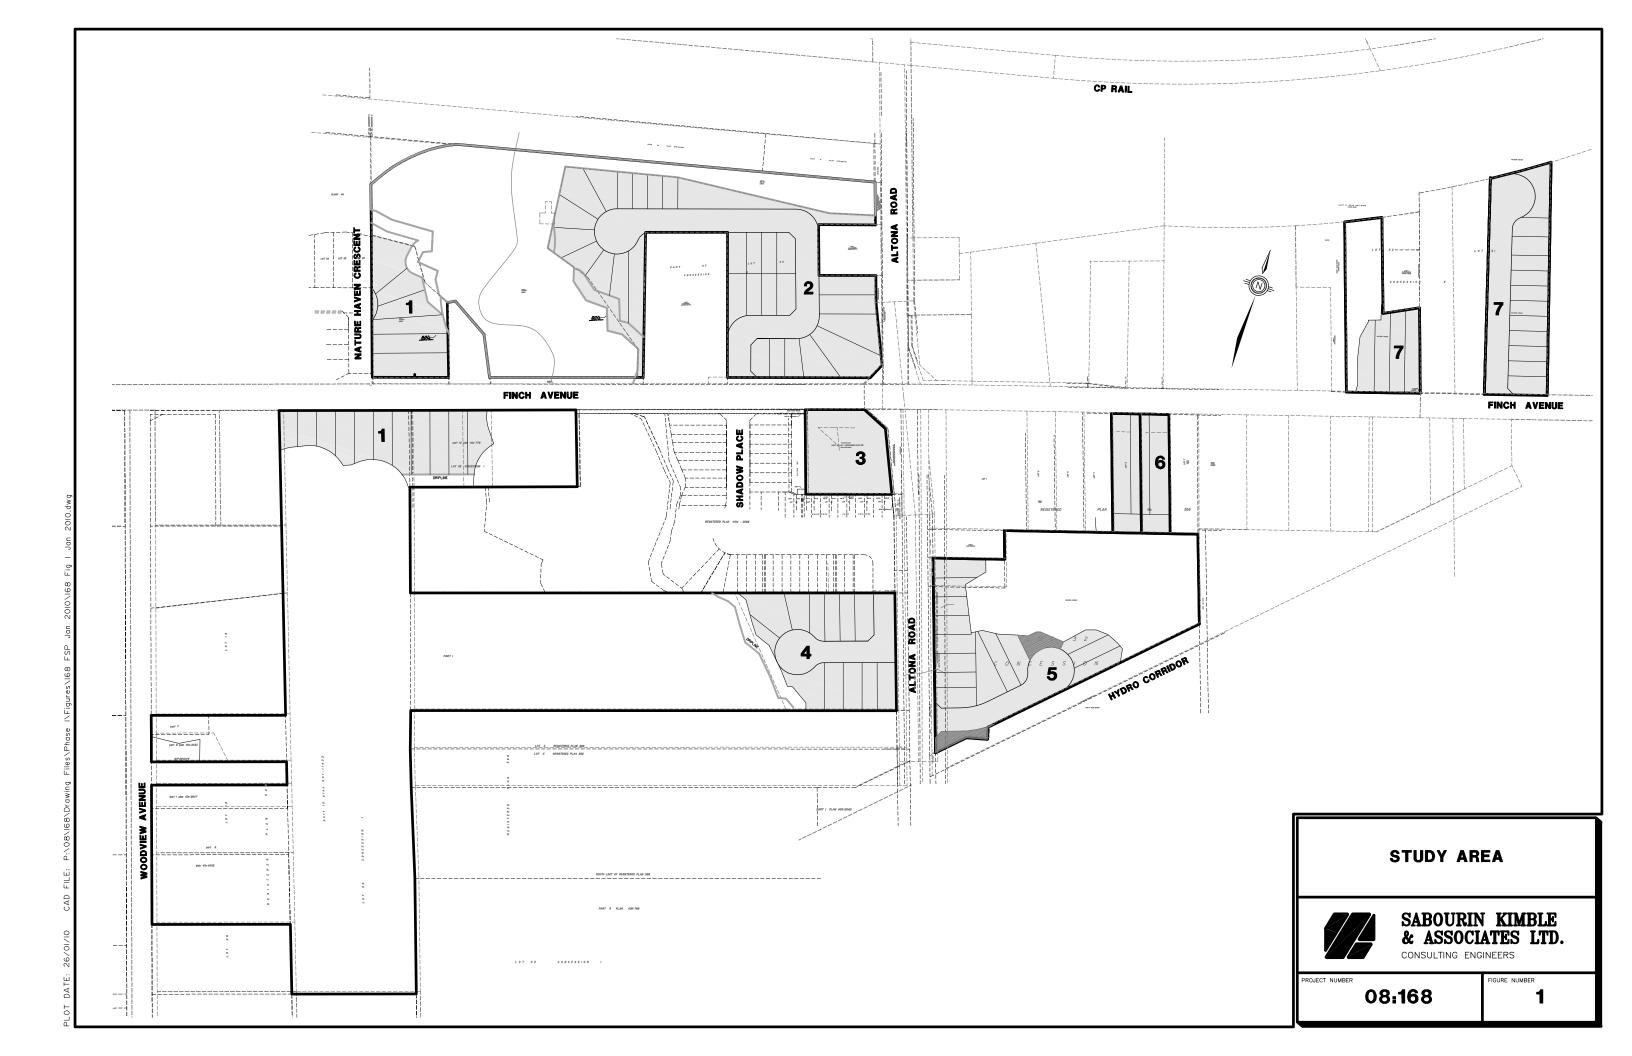

3.0 STORM DRAINAGE

3.1 Existing Site Drainage

Existing drainage from the parcels contribute to two watersheds, Petticoat Creek Watershed and Amberlea Creek Watershed. Parcels 1 through 6 are tributary to Petticoat Creek and Parcel 7 is tributary to Amberlea Creek. Drainage is conveyed to the watersheds by a combination of overland flow, existing storm sewers and road side ditches. Ditches on Altona Road are collected into an existing 1200mm diameter storm sewer which outlets into an existing stormwater management facility which provides both quality and quantity control.

3.2 Post Development Conditions

Within the Study Area, post development drainage is conveyed via local storm sewers. Storm sewers will be sized to convey post development minor storm drainage. Post development major storm drainage will be conveyed via existing overland flow routes. The design of the minor storm drainage system will be based on the City of Pickering specified design criteria. Design flows are calculated using the rational formula:

$$Q = 2.778 \times A \times I \times R$$
,

The 5-year storm event is based on the following

"I" is calculated using Yarnell's 5-year Curve

Rainfall Intensity,
$$I = \frac{2464}{t + 16}$$

A standard entry time of 10 minutes is used for all residential developments.

"R" is the runoff coefficient, as follows:

R = 0.20 for open space

R = 0.45 for single residential units

R = 0.90 for commercial



3.2.1 Parcel 1

Minor system drainage, including residential service connections, from proposed lots within Parcel 1 will contribute to existing storm sewers on Nature Haven Crescent and Finch Avenue. These existing storm sewers convey drainage to an existing Stormceptor STC-6000 on Finch Avenue, which provides water quality control. Downstream of the Stormceptor water is outlet into Petticoat Creek via the culvert under Finch Avenue. The storm sewer system is illustrated in Figure 2 – Storm Servicing Plan - West. Existing capacity of the storm sewers and Stormceptor was analyzed and found to be adequate to support the additional drainage not originally accounted for in the design. For storm sewer design calculations refer to Appendix A – Parcel 1 – Storm Sewer Design and for Stormceptor design calculations refer to Appendix B – Stormwater Management Calculations.

3.2.2 Parcel 2

Minor system drainage from Parcel 2 will be conveyed via proposed storm sewers to the existing 1050mm diameter storm sewer at the intersection of Altona Road and Finch Avenue, as shown in Figure 2 – Storm Servicing Plan – West. Existing capacity analysis was not carried out on the existing storm sewers as they were originally designed and approved to accept post development drainage from these lands.

3.2.3 Parcel 3

Minor system drainage from Parcel 3 will be conveyed via proposed sewers to the existing 1050mm diameter storm sewer on Altona Road, as shown in Figure 2 – Storm Servicing Plan – West. The existing storm sewers on Altona Road and the existing receiving stormwater management facility were sized for drainage from this land at a residential run-off coefficient of 0.46. Given that this Parcel is being proposed as a Commercial Block, which carries a run-off coefficient of 0.90, on-site controls and storage will be utilized to not exceed the existing design flow from this parcel.

3.2.4 Parcel 4

Minor system drainage from Parcel 4 will be conveyed via proposed storm sewers to the existing 1200mm diameter storm sewer on Altona Road, as shown in Figure 2 – Storm Servicing Plan – West. Existing capacity analysis was not carried out on the existing storm sewers as they were originally designed and approved to accept post development drainage from these lands.



3.2.5 Parcel 5

Minor system drainage from Parcel 5 will be conveyed via proposed storm sewers to the existing 1200mm diameter storm sewer on Altona Road, as shown in Figure 2 – Storm Servicing Plan – West. Existing capacity analysis was not carried out on the existing storm sewers as they were originally designed and approved to accept post development drainage from these lands.

3.2.6 Parcel 6

Front yard drainage from lots with Parcel 6 will flow overland to the existing ditches on Finch Avenue. The existing 525mm diameter storm sewer on Finch Avenue will be extended from the existing plug to the east limit of Parcel 6, as shown in Figure 2 – Storm Servicing Plan – West. Residential storm service connections will be connected to the existing 525mm storm sewer as well as the proposed extension of this storm sewer on Finch Avenue. The existing storm sewer on Finch Avenue and all downstream sewers were designed to accept this post development drainage. Therefore, no capacity analysis was required.

Rear-yard drainage from these 3 lots will flow overland to the existing wetland feature to the south as it does under pre-development conditions.

3.2.7 Parcel 7

Minor system drainage from Parcel 7 will be conveyed via proposed storm sewers to the existing 450mm diameter storm sewer plug on Finch Avenue, approximately 35m west of Rosebank Road, as shown in Figure 3 – Storm Servicing Plan - East. The existing storm sewer plug was originally designed to accept pre-development drainage from Parcel 7. Therefore, on-site controls and storage will be utilized to reduce the post-development flow down to the pre-development flow. On-site Level 1 treatment will also be implemented by a proposed Stormceptor.

3.3 Service Connections

The weeping tile drainage at the foundation drains for single family dwellings shall be connected to the storm sewer. All storm service connections will be constructed in accordance with municipal and regional standards. In particular, all storm sewer service connections for single family dwellings shall be individual service connections, 150mm in



diameter, minimum 2.0% gradient and 2.5m depth. The connection to the main sewer shall be made with an approved manufactured tee or approved saddle.

Roof eave downspouts are to discharge directly to the grass surface. This will promote groundwater infiltration. Residential dwellings are to be designed in a manner to accommodate roof eave downspout discharge locations to grassed surfaces, maximizing drainage travel along swales before they outlet to paved surfaces, existing road-side ditches or rear lot catchbasins.

3.4 Rear Lot Catchbasin Design

In general, rear lot grading shall be designed to minimize the number and frequency of rear lot catchbasins. However, rear lot catchbasins will be utilized to prevent drainage from flowing overland to existing adjacent properties. This rear yard drainage will be captured by swales and conveyed to rear lot catchbasins which outlet to the storm sewer system.

4.0 **STORMWATER MANAGEMENT**

The stormwater management criteria for the study area were determined as a combination of constraints and criteria established by the City of Pickering and the Toronto and Region Conservation Authority (TRCA). As previously described, the study area has been divided into seven (7) parcels and each has been examined from a stormwater management perspective.

4.1 Parcel 1

The existing parcel 1 is currently undeveloped. Under proposed conditions, there will be an increase of 0.18 hectares of drainage going to the Stormceptor (STC 6000) which is currently treating the runoff from approximately 5.2 hectares. Stormceptor sizing calculations have been done to confirm whether or not the existing Stormceptor will be adequate enough to treat this drainage. Under proposed conditions, the existing Stormceptor still removes 82% of the total suspended solids, as per Level 1 quality control criteria. See appendix 'B' for complete calculations.

4.2 Parcels 2-6

These parcels all drain to an existing stormwater management facility on Altona Road. This facility was originally designed to treat the runoff from these parcels in addition to existing developments in the area. The only exception is Parcel 3 which as mentioned previously, has a higher proposed runoff coefficient than originally accounted for.

In order to mitigate the increase in the proposed runoff coefficient of Parcel 3, the site will have the 100-year post development runoff controlled to the originally designed 5-year post development runoff. This will ensure that there is no increase in peak runoff to the pond. By controlling the 100-year storm to this rate, there will also be no major system flow from the site. The extended rational method was used to calculate the associated storage volume that would be necessary to provide this level of control. In total, 106 m³ are required. There would be several options for how to store this volume on site, including: on the roof of the commercial building, surface ponding in the parking lot or underground storage in a super-pipe. Calculations can be found in Appendix 'B'.

The Stormwater Management Report – Reflections on Petticoat Creek, BOPA Developments Inc., City of Pickering, last revised March 12, 2001, prepared by Land-Pro, was used to confirm the pond's capacity. The existing pond was originally designed



to provide Level 1 quality control for the contributing drainage area. This is still the current criteria so no additional quality treatment is required. The existing pond was also designed to provide quantity control for the contributing drainage area. Other than the commercial site, which will be controlled, there is no proposed increase in runoff coefficient or in drainage area, therefore, no additional works are proposed.

4.3 Parcel 7

As stated previously, the storm sewers on Finch Avenue were designed assuming that this land was undeveloped. In order to ensure there is capacity in the existing sewer, the 5-year post development storm, which is what the minor system is designed to, will be controlled to the 5-year pre-development storm. The extended rational method was used to determine the volume of storage required to achieve outflow rate. In total, 52 m³ of storage are required. This volume would most likely be stored in an underground super-pipe. Major system flow will discharge directly to the existing ditches on the north side of Finch Avenue. The site is within the Amberlea Creek watershed, which also requires retention of the 25 mm storm for 24 hours. Roof runoff from this parcel will be directed to rear yard infiltration galleries to achieve this.

The site requires Level 1 Quality control. This will be provided by a Stormceptor which has been sized as a STC 1000. See Appendix 'B' for all design calculations.



5.0 SANITARY DRAINAGE

5.1 Existing Conditions

Existing sanitary sewers are located on Woodview Avenue, Finch Avenue, Shadow Place and Altona Road. Sanitary drainage from the parcels will contribute to the two main sewer reaches on Woodview Avenue and Altona Road. Parcel 1 is tributary to the existing 200mm diameter sanitary sewer on Woodview Avenue and Parcels 2 through 7 are tributary to the existing 250mm diameter sanitary sewer on Altona Road.

5.2 Proposed Sanitary Servicing

5.2.1 Design Flow

In accordance with Region of Durham design guidelines, residential sewage flows shall be calculated on the basis of the following for residential areas

- Residential Average Flow 364 litres/person/day
- Infiltration 22,500 litres/gross hectare/day when foundation drains are not connected to the sanitary sewer. Calculated on the number of gross hectares of residential lands tributary to the sanitary sewer systems. Foundation drains within all areas of the Study Area are connected to the storm sewer system.

All sanitary sewers shall be sized to handle the theoretical daily peak flow, where the peaking factor for sanitary drainage is calculated as follows:

Peaking Factor,
$$K_H = \frac{1+14}{4+P^{1/2}}$$

Where, P is population in thousands

K_H is the Harmon peaking factor, maximum of 3.8 and minimum of 1.5

In accordance with Region of Durham design guidelines, when lands are zoned for a specific residential use and detailed information is not available, the following population densities shall apply in accordance with Table 1 - Population Densities – Unknown Lot Configuration.



Table 1 - Population Densities - Unknown Lot Configuration

Type of Housing	Persons/Hectare
Single Family Dwellings	60
Semi-detached Dwellings	100
Street Townhouses	125

When the number and type of housing units within the proposed development is known, the calculation of population for the proposed development shall be based on the following, Table 2 - Population Densities – Known Lot Configuration

Table 2 - Population Densities - Known Lot Configuration

Type of Housing	Persons/Unit
Single Family Dwellings	3.5
Semi-detached Dwellings	3.5
Street Townhouses	3.5

In accordance with Region of Durham standards, commercial design flow is 180m³/gross floor area hectare/day including infiltration and peaking effect.

Based on the design flow, the minimum sewer size and gradient are calculated using Manning's Formula on the basis of full flow pipes.

5.2.2 Parcel 1

Sanitary drainage from residential lots within Parcel 1 drain to a combination of existing sanitary sewers on Nature Haven Crescent and proposed sanitary sewers on Finch Avenue, as shown in Figure 4 – Sanitary Servicing Plan – West. The two local systems combine at the intersection of Woodview Avenue and Finch Avenue and flow is conveyed south on Woodview Avenue. In the City of Pickering's 2003 report, Rouge Park Neighbourhood Development Guidelines, it stated that the sanitary sewer along

Woodview Avenue will serve the area west of Petticoat Creek and with minor upgrades has the capacity to accommodate approximately 500 additional people. In 2006 Woodview Avenue was re-constructed, including extension of the existing sanitary sewer north on Woodview Avenue to Finch Avenue. This was done to serve the Rouge Park Subdivision, which added approximately 137 additional people to the Woodview Avenue sanitary sewer. ORC Lands – Parcel 1 will contribute approximately 60 more people to this sanitary sewer. As the combined 197 estimated additional people now contributing to the Woodview Avenue sanitary sewer is much less than the 500 people additional capacity stated in the City's 2003, no capacity analysis was carried forward on the Woodview Avenue sanitary sewer. At the detailed design stage for Parcel 1, allocation will have to be obtained from the City of Pickering for the proposed lots.

5.2.3 Parcel 2 – 7

Sanitary drainage from Parcels 2 through 7 drain to a combination of existing and proposed sewers, as shown in Figure 4 – Sanitary Servicing Plan – West and Figure 5 – Sanitary Servicing Plan – East. Flows from these parcels contribute to the existing sanitary sewer system on Altona Road. The design of the original system accounted for these lands under post-development conditions. For this reason a capacity analysis was not carried out or required on the existing sanitary sewer system on Altona Road.

5.3 Service Connections

Internally residential sanitary service connections are straightforward. These will be constructed in accordance with regional standards. In particular, all sanitary sewer service connections for single family dwellings shall be individual service connections, 100mm in diameter, minimum 2.0% gradient and 2.5m depth. The connection to the main sewer shall be made with an approved manufactured tee or approved saddle.



6.0 WATER SUPPLY

6.1 Existing Water Supply Infrastructure

The Study Area is located within the City of Pickering Zone 2 pressure district. As per the City of Pickering's Rouge Park Neighbourhood Development Guidelines, water supply within the neighbourhood around the Study Area is served by the Regional water supply system, which includes watermains installed along Finch and Woodview Avenues. The Development Guidelines set in the City's report states that given the recent expansion of the Ajax Water Supply Plant, there are no constraints on the system's ability to accommodate planned growth in the area and no facilities other than the extension of watermains are required.

6.2 Proposed Water System

The proposed watermain layout is shown in Figure 6 – Watermain Servicing Plan. The water distribution system shall be designed to meet Regional and Provincial standards within the Study Area for residual pressure under maximum hourly demand (40psi) as well as maximum daily demand plus fire flow (20psi). The geodetic elevation of the normal surface water level for Pickering Zone 2 reservoir is 170.0m. The highest and lowest centreline of road elevation proposed within the Study Area is 141.53m and 134.55m respectively. This equates to a static pressure range of 40.5-50.4psi. As this pressure is bordering minimum standards under static pressure conditions, discussions will have to be had with the Region regarding this during the detailed design process. A combination of temporary booster stations, raising the normal operating water surface elevation in the Zone 2 reservoir and/or strategically lowering the proposed ground elevation (from an optimal design elevation) could be considered to meet the current pressure criteria. Proposed water mains shall be sized at a later date to meet water usage with adequate flow and adequate residual pressure.

6.3 Service Connections

Flow and pressure within the Study Area is adequate, and therefore only minimum sized service connections are required in accordance with Region of Durham standards. All service connections to private properties for freehold residential dwellings shall be a nominal size of 19mm diameter type "K" copper water mains.





7.0 SITE GRADING


In accordance with road design grading criteria, the minimum desirable gradient on all roadways is 0.5%, and the maximum gradient on all roadways is 5.0%. In accordance with the above criterion, preliminary proposed road grades have been designed; refer to Figure 7-13 – Preliminary Grading Plan.


In accordance with lot grading criteria, the minimum swale grade is 2% and the maximum swale grade is 5.0%. Preliminary lot grading has been designed and can be found in Figure 7-13 – Preliminary Grading Plans.


Road and lot grading has been designed so that existing elevations around the property limits are met and to ensure all drainage is self contained and directed to appropriate storm sewer catchment devices. Exception to this occurs when the property backs on to an existing wetland and drainage is conveyed overland to the wetland under predevelopment conditions. In this case some overland drainage has been directed overland toward the wetland to ensure that the natural features of the wetland aren't adversely affected by the future development.

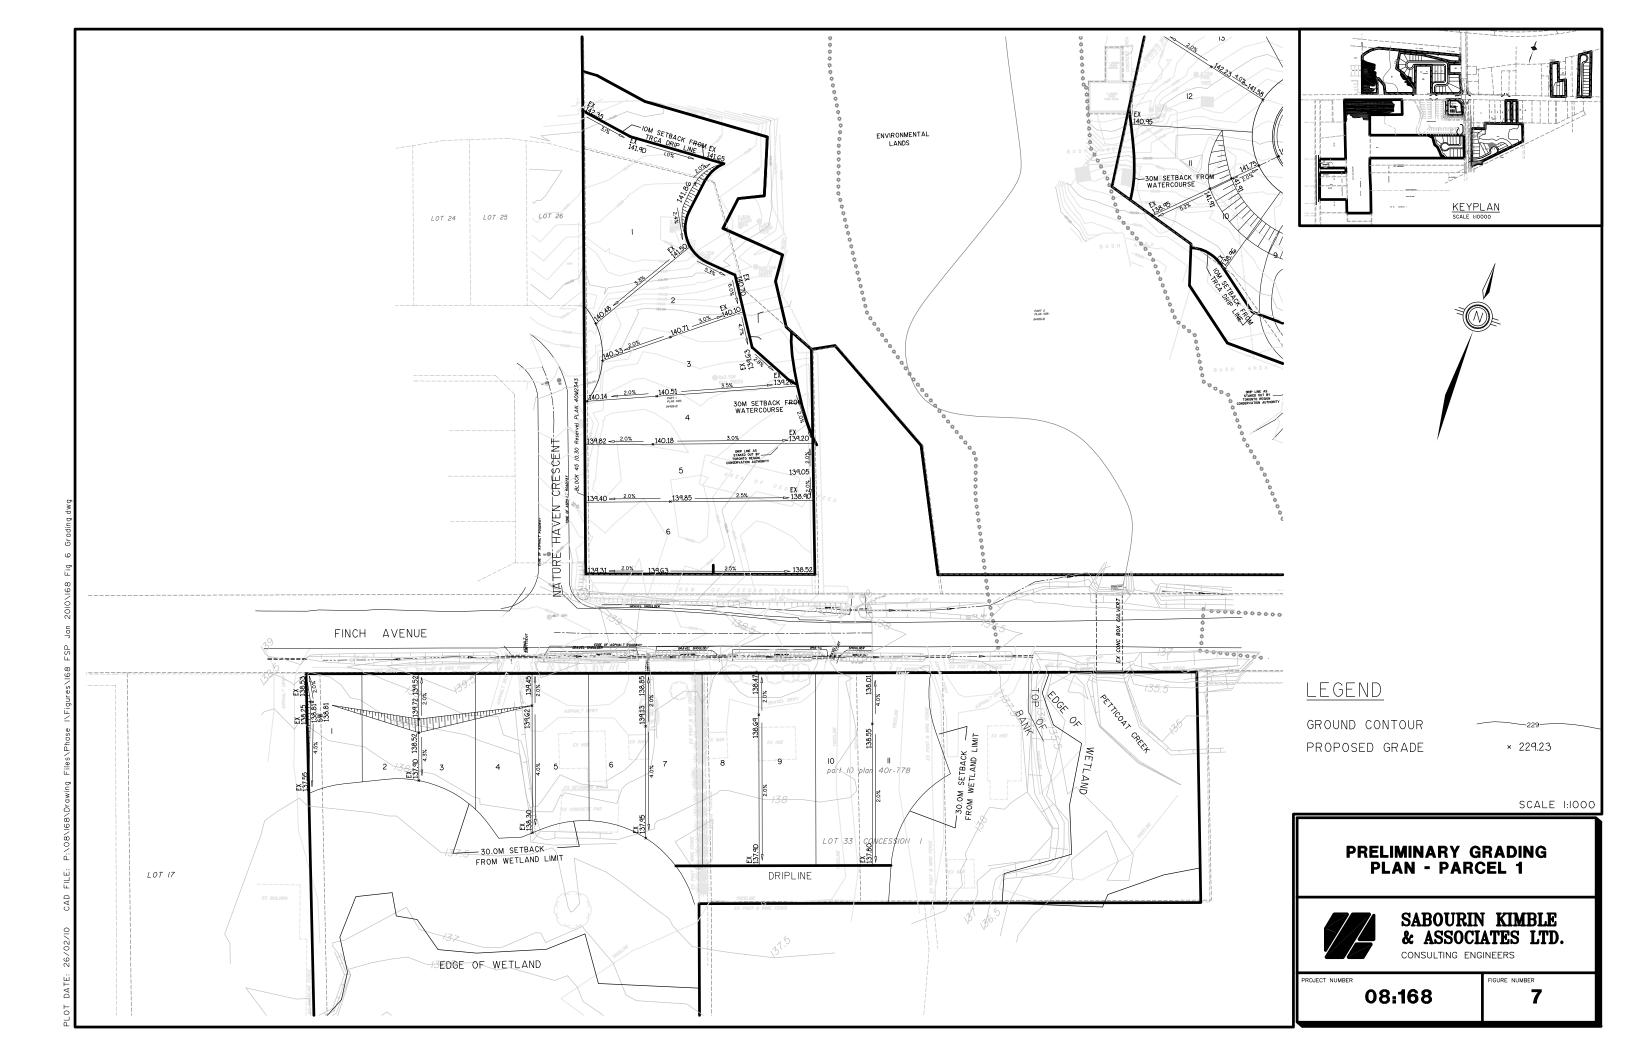


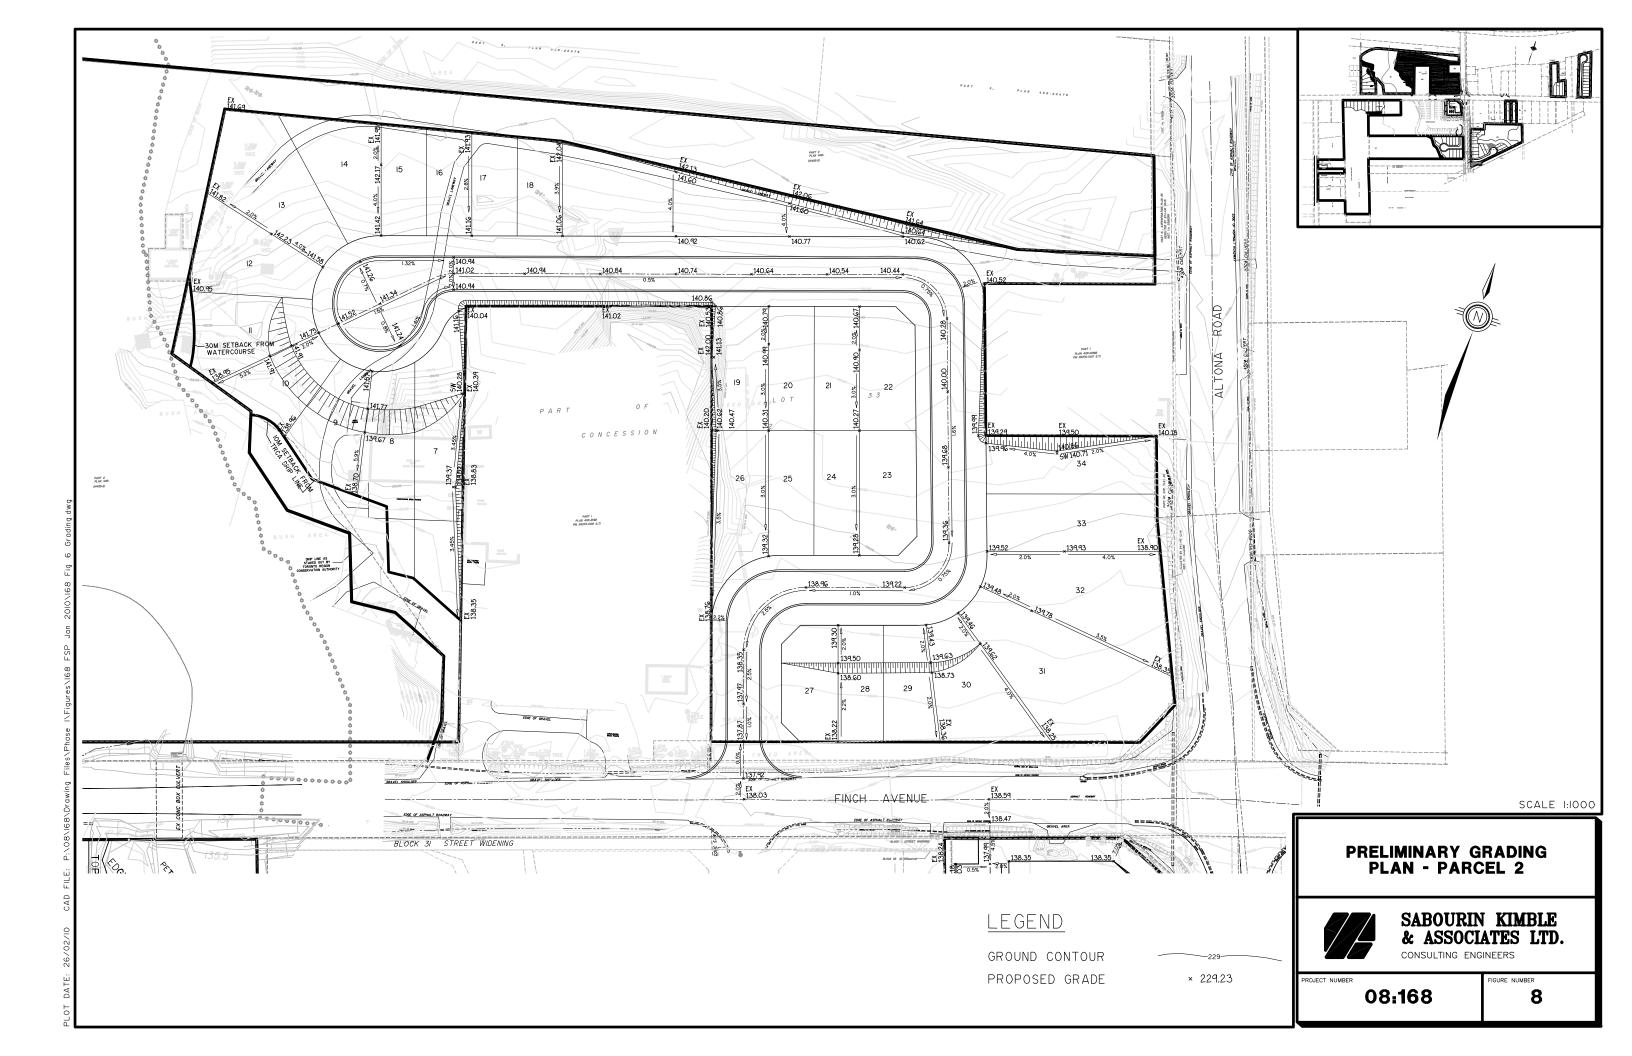


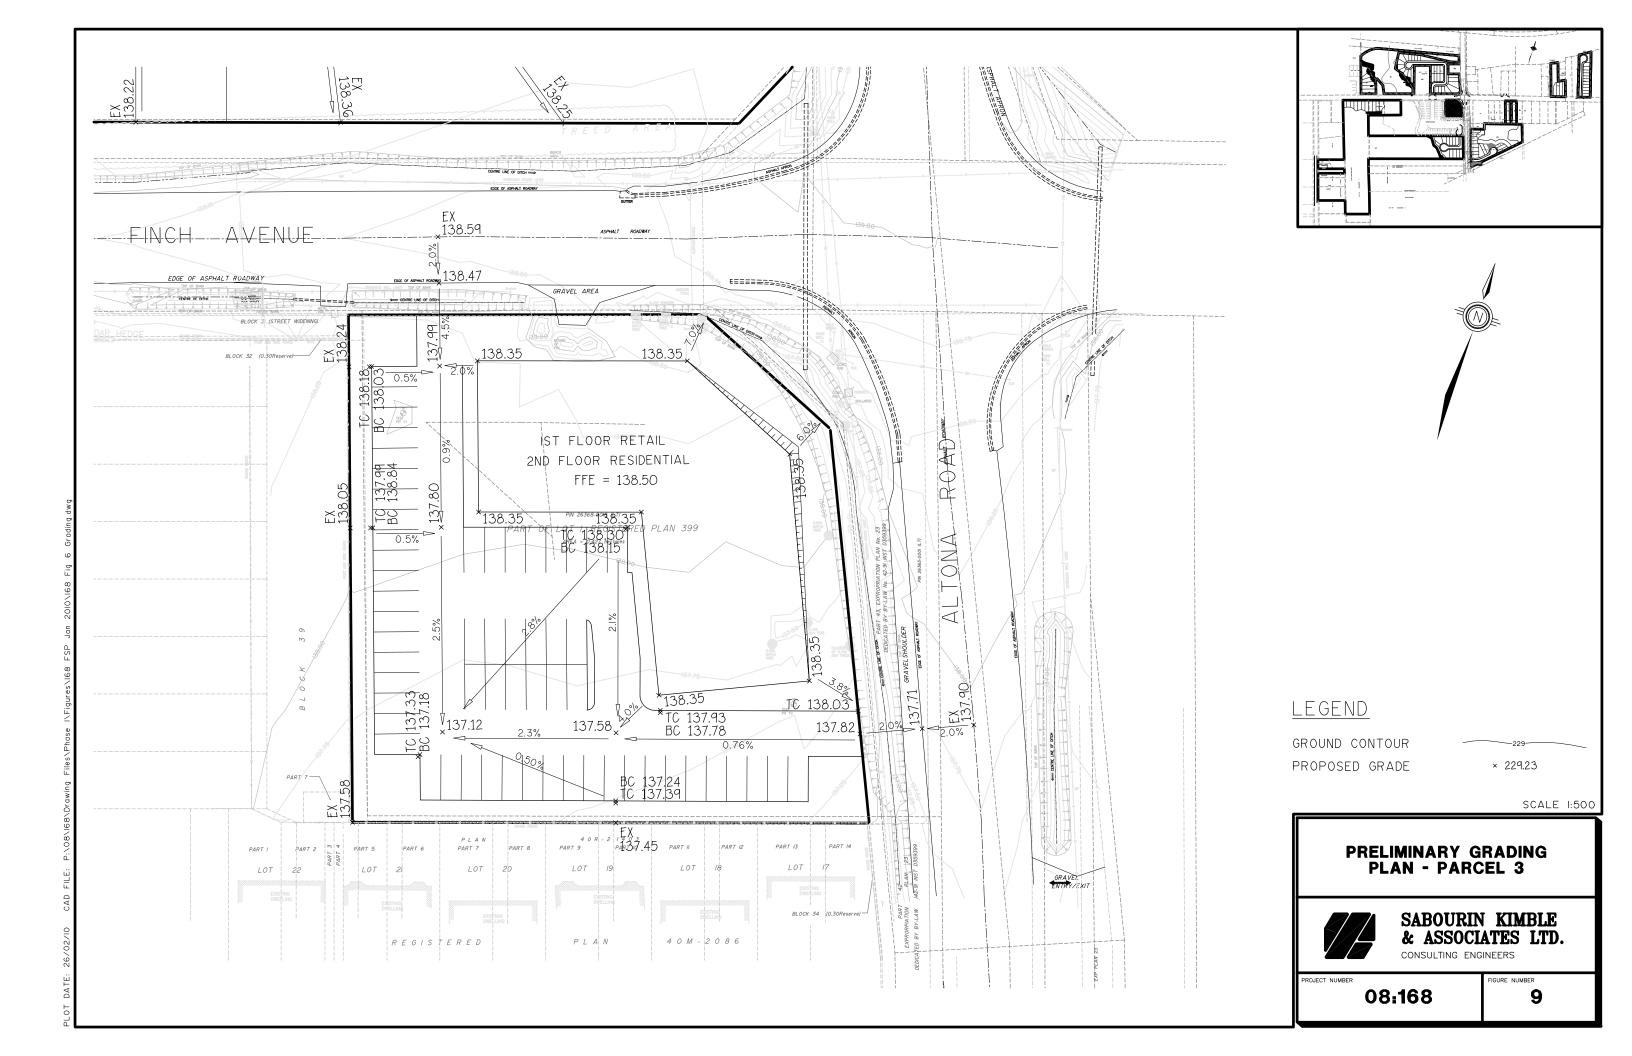

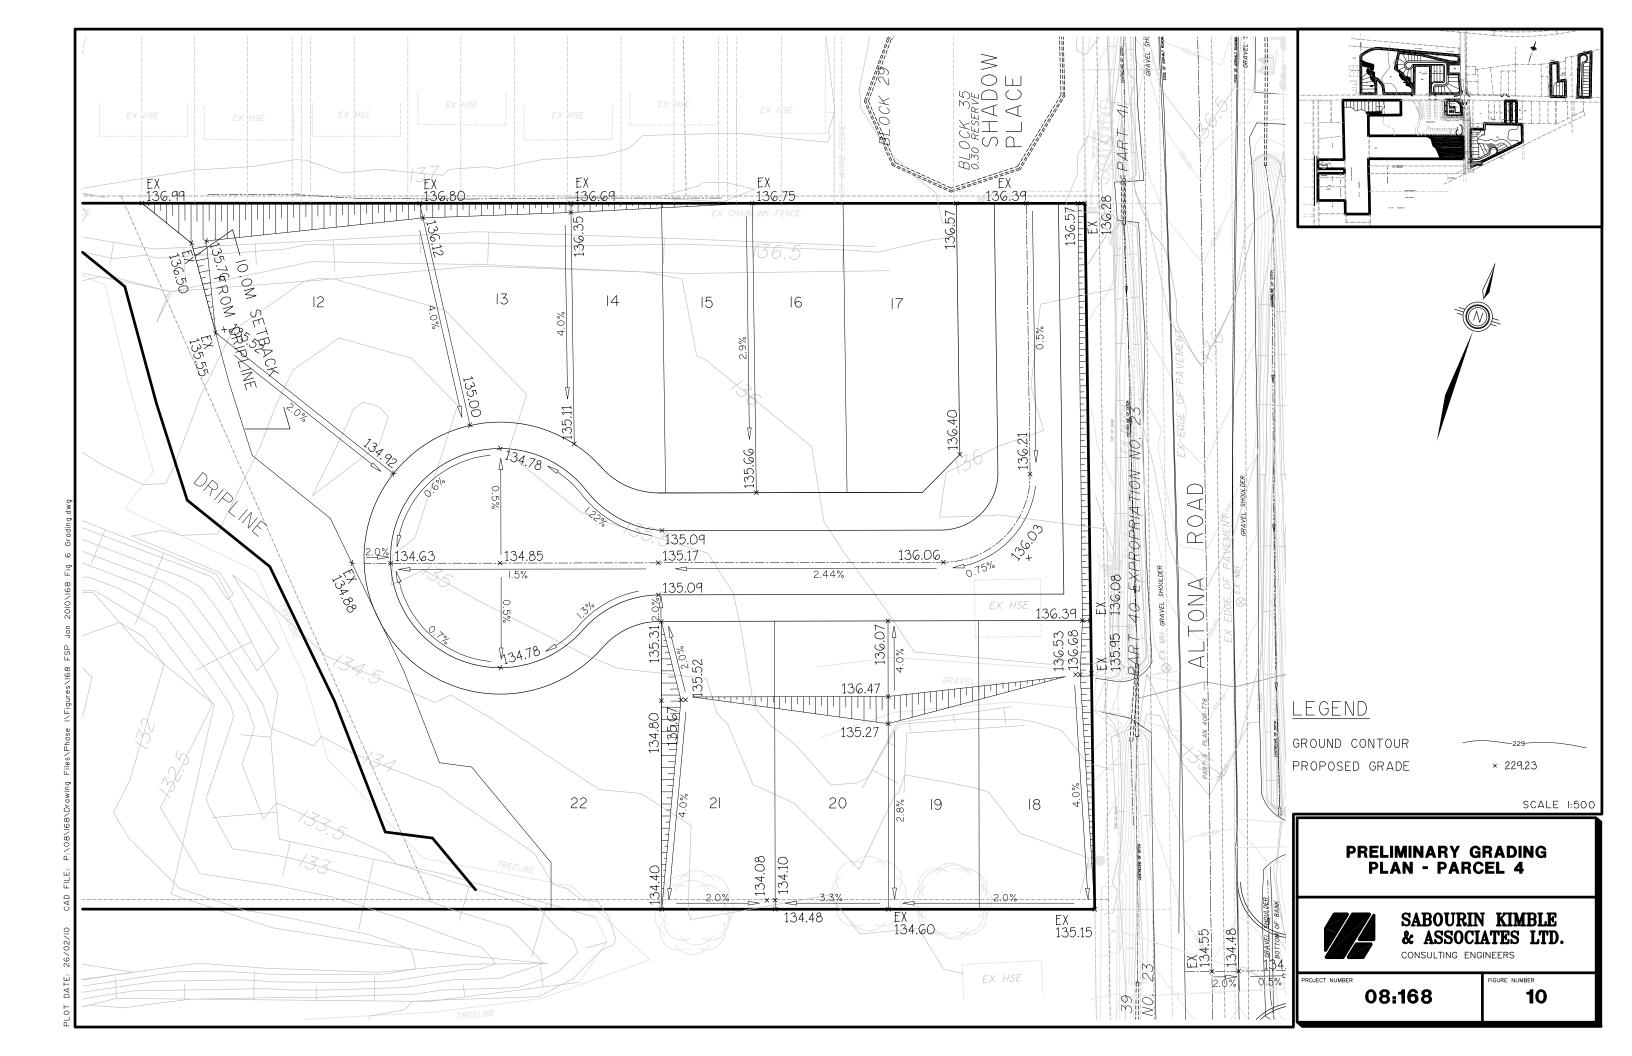

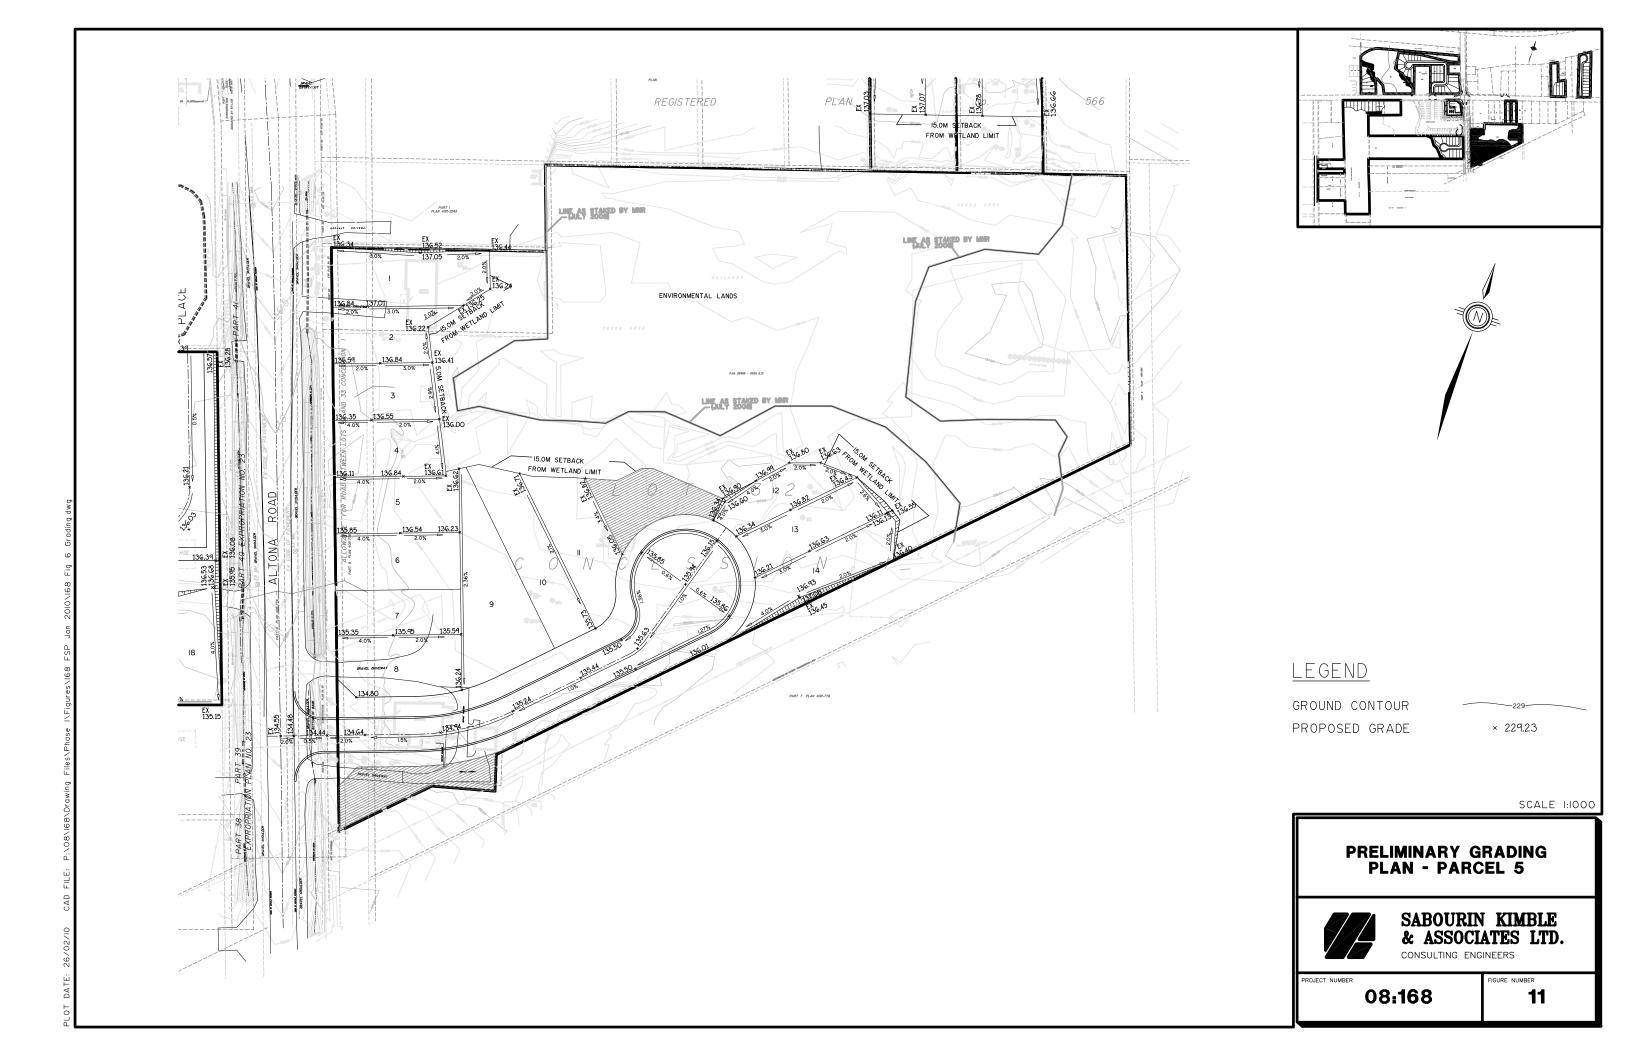

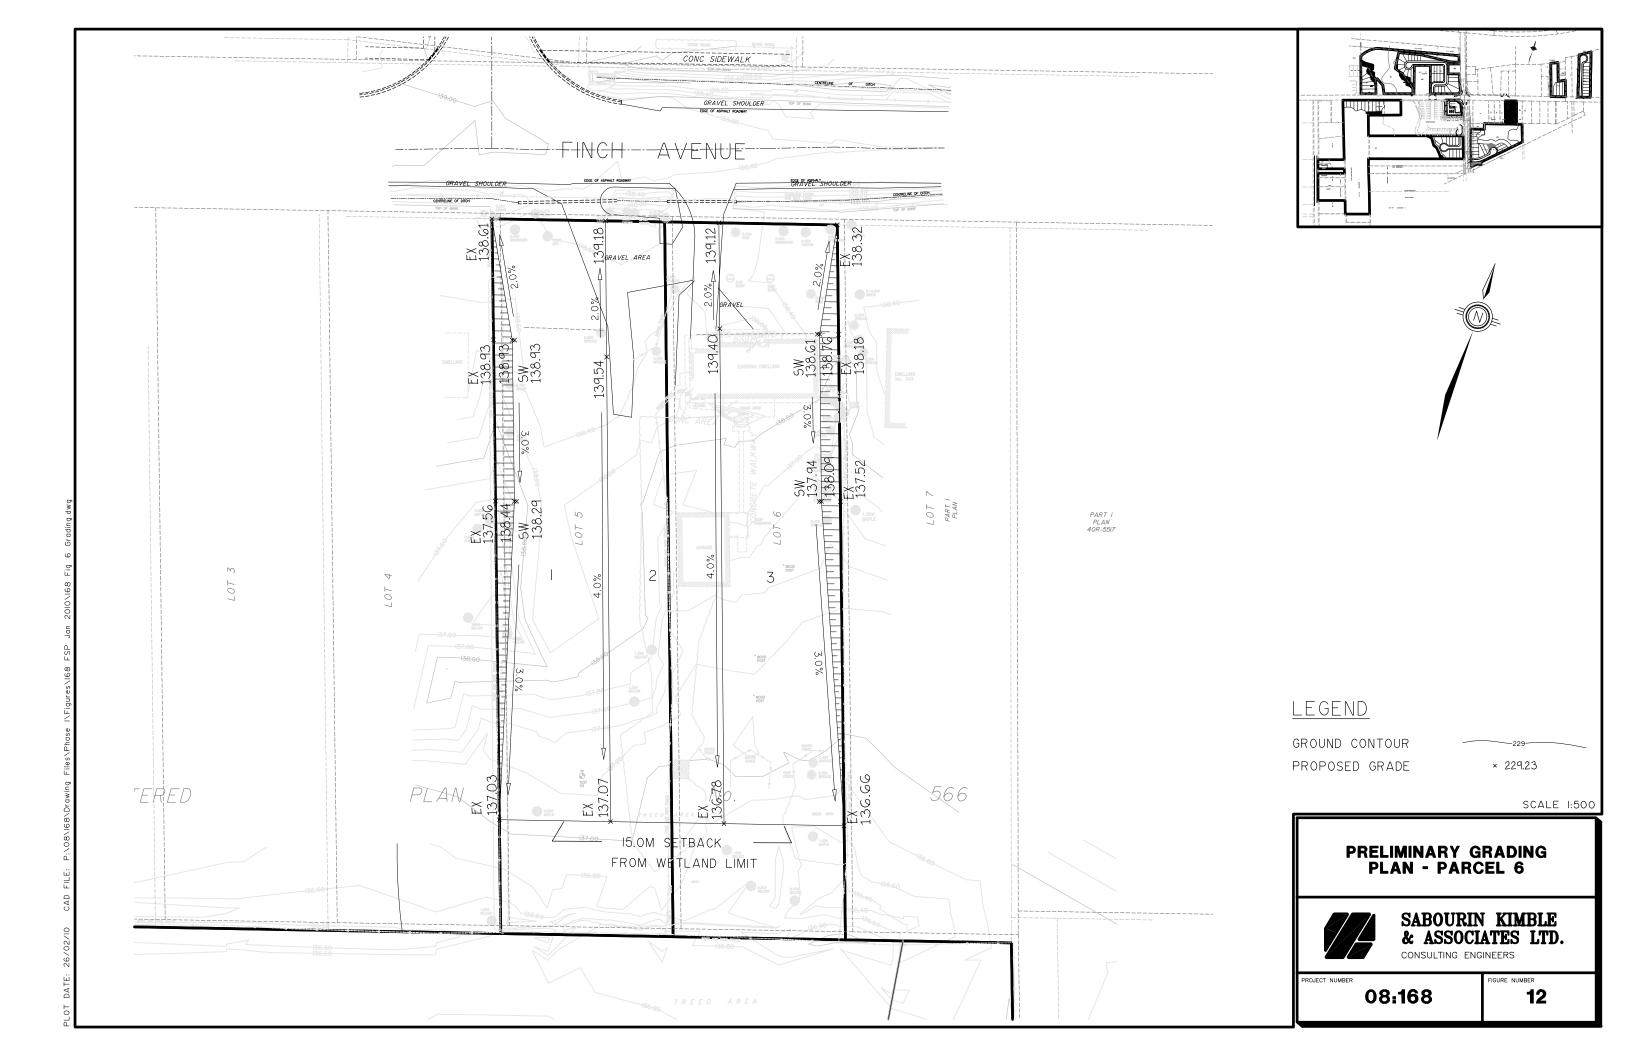

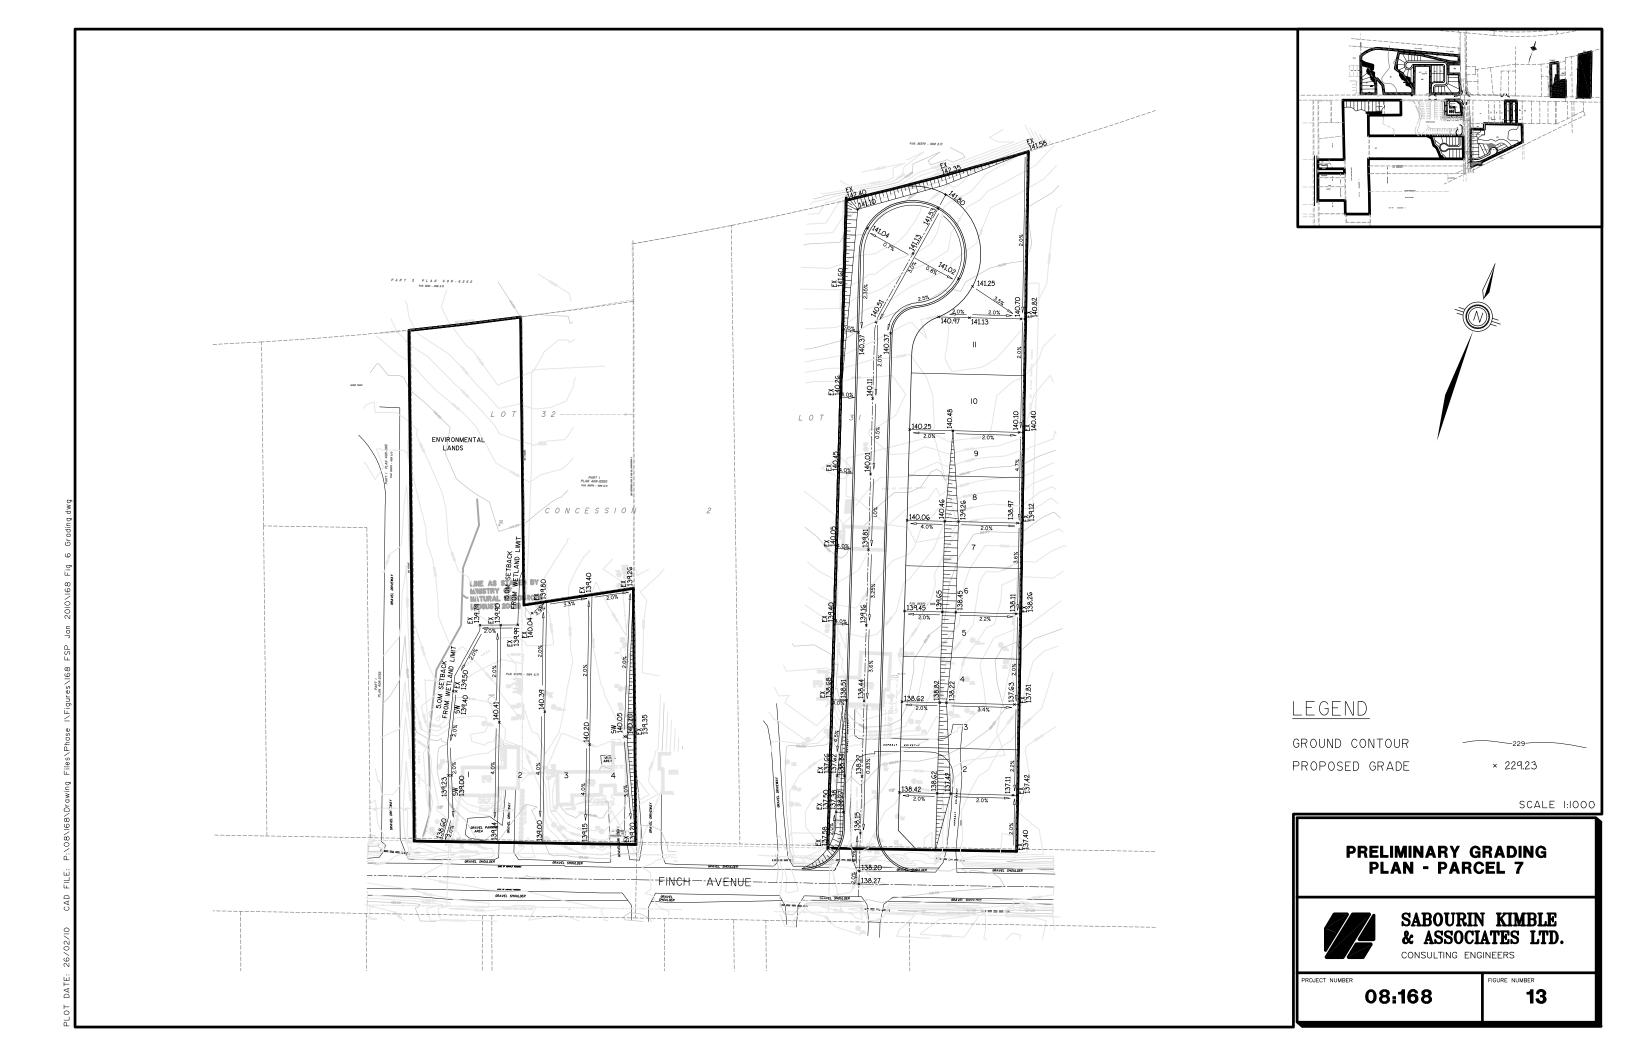

8.0 SEDIMENTATION CONTROL MEASURES

There are environmental features and existing residential properties adjacent to the Study Area. These environmental features and residential properties must be adequately protected from damage due to sedimentation runoff and erosion damage.

During construction of any portion of the Study Area, adequate erosion and sedimentation controls must be implemented to safeguard them against potential damage. In support of the detailed design for any development proposal, a comprehensive construction erosion and sedimentation control plan should be prepared. This plan should detail the works proposed to control erosion on-site and sediment transport from the site to match or exceed current Municipal and Provincial standards. Works such as sediment shields, controlled stripping/earthworks practices, sediment ponds, undisturbed buffers, filter strips and catchbasin/storm sewer sediment traps should be implemented. In support of the erosion and sedimentation control plan, a construction implementation plan and maintenance protocol should also be established on an individual basis for any phase of the Study Area.

The construction implementation plan and maintenance protocol should be completed in accordance with the Erosion and Sedimentation Control Guideline for Urban Construction, December 2006, which was created in cooperation with the greater Golden Horseshoe Area Conservation Authorities.

Sedimentation control practices will be implemented for all construction activities within the Study Area, including during tree removal, topsoil stripping, underground sewer construction, road construction and house construction. Sedimentation control measures are to be installed and operational prior to any construction activity, and are to remain in place until such time as the residential dwellings are constructed and the lot grading complete with established sod.



Appendix A Parcel 1 – Storm Sewer Design

						S	TORM SE	WER DE	SIGN SHE	ET									
							CITY	OF PICK	ERING										
																	Ti	Total Time	Consoitu
STREET	Upstream	Downstream	Α	Parcel 1 Area	Α	AxR	Acc. AR	t	1 (5yr)	Q (5yr)	Pipe	Pipe	Grade	Capacity	Velocity	Length	Time	(min)	Capacity (%)
	Manhole	Manhole	at R=0.45 (ha)	at R=0.45 (ha)	at R=0.20 (ha)	This Section (ha)	(ha)	(min)	(mm/hr)	(I/s)		(mm)	(%)	(l/s)	(m/s)	(m)	(min)	(11111)	(70)
						ROUGE	PARK SU	BDIVISIO	ON - ORC F	PARCEL	1		,						
FINCH AVENUE	1	2	0.62			0.279	0.279	10.00	94.77	73.45		375	0.50	123.98	1.12		1.56	11.56 12.73	
FINCH AVENUE	2	3	0.31			0.140		11.56			IMPERIAL	450	0.30	162.91	0.99	70.0 18.5	1.18 0.31	13.05	
FINCH AVENUE	3	4	0.07			0.032	0.450	12.73	85.75	107.19	IMPERIAL	450	0.30	162.91	0.99	18.5	0.31	13.03	0076
NATURE HAVEN ORECCENT	12	13	0.27		0.06	0.134	0.134	10.00	94.77	35.14	METRIC	300	1.10	101.42	1.43	45.0	0.52	10.52	35%
NATURE HAVEN CRESCENT	13	14	0.51		0.06			10.52	92.90	96.77	METRIC	375	1.60	221.78	2.01	83.0	0.69	11.21	44%
NATURE HAVEN CRESCENT	14	4	0.60		0.45			11.21	90.55	184.87	IMPERIAL	600	0.30	350.85	1.20	49.0	0.68	11.89	53%
															100	47.5	0.00	40.07	58%
FINCH AVENUE	4	5				0.000		13.05			IMPERIAL	675	0.30	480.32			0.22	13.27 14.12	
FINCH AVENUE	5	6	0.44			0.198		13.27			IMPERIAL	750	0.30	636.13 636.13	1.39 1.39		0.85		
FINCH AVENUE	6	7	0.54			0.243	-	14.12			IMPERIAL	750 750	0.30				0.83	15.19	
FINCH AVENUE	7	8	0.05			0.023	1.649	14.98	79.54	364.23	IMPERIAL	750	0.30	030.13	1.59	17.0	0.21	10.10	0,70
WATURE WAYEN ORECCENT	12	11	0.26			0.117	0.117	10.00	94.77	30.80	METRIC	300	2.50	152.90	2.16	41.5	0.32	10.32	20%
NATURE HAVEN CRESCENT	11	10	0.20	100.000	0.13			10.32	93.62	58.25	METRIC	375	1.90	241.68	2.19	15.5	0.12	10.44	24%
NATURE HAVEN CRESCENT	10	8	0.22	GOOD OF BREEKING		0.149		10.44	93.20	96.44	METRIC	375	1.90	241.68	2.19	62.0	0.47	10.91	40%
															4.00	400.5	4.07	16.46	76%
FINCH AVENUE	8	9(STC-6000)	0.39			0.176		15.19	-		IMPERIAL	750 750					1.27 0.37		+
FINCH AVENUE	9(STC-6000)	CULVERT	0.13			0.059	2.255	16.46	75.91	475.49	IMPERIAL	750	0.30	030.13	1.39	31.0	0.37	10.00	7070
PROJECT:		ORC LANDS	- FINCH & A	LTONA															
									Designed B	By:	RMS				SARC	JI ID	NV	IMBL	E-
PROJECT No.:		08:168																	
			-											7_ (& AS	SOC	[IAI]	ES LTI	D.—
CLIENT:		ORC					-								CONSUL	TING F	JGINEE	RS	
									Checked B	y :	WJL			_	- INSUL	TINO EI	AOHALL	1.0	
DATE:		January, 201	0				-			-			 						

Appendix B Stormwater Management Calculations



08 168 Parcel 1 STC sizing

Check existing conditions

From storm sewer design sheet:

	Area (ha)	Runoff Coefficient	Percent Impervious
	0.70	0.20	0%
	4.52	0.45	36%
Total	5.22	0.42	31%

See stormceptor sizing

Confirmed that STC 6000 is required for 80% TSS removal under existing conditions

Check proposed conditions

From storm sewer design sheet:

	Area (ha)	Runoff Coefficient	Percent Impervious
	0.70	0.20	0%
	4.70	0.45	36%
Total	5.40	0.42	31%

See stormceptor sizing

Confirmed that STC 6000 is required for 80% TSS removal under proposed conditions



Stormceptor Design Summary

PCSWMM for Stormceptor

Project Information

Date	22/02/2010
Project Name	ORC Altona Road Lands
Project Number	08 168
Location	City of Pickering

Designer Information

Company	Sabourin Kimble & Associates Ltd.
Contact	Stephen Ruddy

Notes

Existing Conditions	

Drainage Area

Total Area (ha)	5.22
Imperviousness (%)	31

The Stormceptor System model STC 6000 achieves the water quality objective removing 82% TSS for a Fine (organics, silts and sand) particle size distribution.

Rainfall

Name	TORONTO CENTRAL
State	ON
ID	100
Years of Records	1982 to 1999
Latitude	45°30'N
Longitude	90°30'W

Water Quality Objective

TSS Removal (%)	80

Upstream Storage

Storage (ha-m)	Discharge (L/s)
0	0
· •	

Stormceptor Sizing Summary

Stormceptor Model	TSS Removal
STC 300	53
STC 750	66
STC 1000	66
STC 1500	67
STC 2000	73
STC 3000	74
STC 4000	78
STC 5000	79
STC 6000	82
STC 9000	86
STC 10000	86
STC 14000	88





Particle Size Distribution

Removing silt particles from runoff ensures that the majority of the pollutants, such as hydrocarbons and heavy metals that adhere to fine particles, are not discharged into our natural water courses. The table below lists the particle size distribution used to define the annual TSS removal.

	Fine (organics, silts and sand)							
Particle Size	Distribution	Specific Gravity	Settling Velocity		Particle Size	Distribution	Specific Gravity	Settling Velocity
μm	%		m/s		μm	%		m/s
20 60 150 400 2000	20 20 20 20 20 20	1.3 1.8 2.2 2.65 2.65	0.0004 0.0016 0.0108 0.0647 0.2870					

Stormceptor Design Notes

- Stormceptor performance estimates are based on simulations using PCSWMM for Stormceptor version 1.0
- Design estimates listed are only representative of specific project requirements based on total suspended solids (TSS) removal.
- Only the STC 300 is adaptable to function with a catch basin inlet and/or inline pipes.
- Only the Stormceptor models STC 750 to STC 6000 may accommodate multiple inlet pipes.
- Inlet and outlet invert elevation differences are as follows:

Inlet and Outlet Pipe Invert Elevations Differences

Inlet Pipe Configuration	STC 300	STC 750 to STC 6000	STC 9000 to STC 14000	
Single inlet pipe	75 mm	25 mm	75 mm	
Multiple inlet pipes	75 mm	75 mm	Only one inlet pipe.	

- Design estimates are based on stable site conditions only, after construction is completed.
- Design estimates assume that the storm drain is not submerged during zero flows. For submerged applications, please contact your local Stormceptor representative.
- Design estimates may be modified for specific spills controls. Please contact your local Stormceptor representative for further assistance.
- For pricing inquiries or assistance, please contact Hanson Pipe & Precast, 1-888-888-3222.





Stormceptor Design Summary

PCSWMM for Stormceptor

Project Information

•	
	22/02/2010
Project Name	ORC Altona Road Lands
Project Number	08 168 P1
Location	City of Pickering

Designer Information

Liompany	Sabourin Kimble & Associates Ltd.
Contact	Stephen Ruddy

Notes

-			
1 -	ranged Conditions		
	Propsed Conditions		
1			

Drainage Area

Total Area (ha)	5.4
Imperviousness (%)	31

The Stormceptor System model STC 6000 achieves the water quality objective removing 82% TSS for a Fine (organics, silts and sand) particle size distribution.

Rainfall

Name	TORONTO CENTRAL
State	ON
ID	100
Years of Records	1982 to 1999
Latitude	45°30'N
Longitude	90°30'W

Water Quality Objective

TSS Removal (%)	80

Upstream Storage

Storage	Discharge
(ha-m)	(L/s)
0	0

Stormceptor Sizing Summary

Stormceptor Model	TSS Removal
STC 300	53
STC 750	66
STC 1000	66
STC 1500	66
STC 2000	72
STC 3000	73
STC 4000	78
STC 5000	78
STC 6000	82
STC 9000	85
STC 10000	85
STC 14000	88





Particle Size Distribution

Removing silt particles from runoff ensures that the majority of the pollutants, such as hydrocarbons and heavy metals that adhere to fine particles, are not discharged into our natural water courses. The table below lists the particle size distribution used to define the annual TSS removal.

	Fine (organics, silts and sand)							
Particle Size	Distribution	Specific Gravity	Settling Velocity		Particle Size	Distribution	Specific Gravity	Settling Velocity
μm	%	-	m/s		μm	%		m/s
20 60 150 400 2000	20 20 20 20 20 20	1.3 1.8 2.2 2.65 2.65	0.0004 0.0016 0.0108 0.0647 0.2870					

Stormceptor Design Notes

- Stormceptor performance estimates are based on simulations using PCSWMM for Stormceptor version 1.0
- Design estimates listed are only representative of specific project requirements based on total suspended solids (TSS) removal.
- Only the STC 300 is adaptable to function with a catch basin inlet and/or inline pipes.
- Only the Stormceptor models STC 750 to STC 6000 may accommodate multiple inlet pipes.
- Inlet and outlet invert elevation differences are as follows:

Inlet and Outlet Pipe Invert Elevations Differences

Inlet Pipe Configuration	STC 300	STC 750 to STC 6000	STC 9000 to STC 14000
Single inlet pipe	75 mm	25 mm	75 mm
Multiple inlet pipes	75 mm	75 mm	Only one inlet pipe.

- Design estimates are based on stable site conditions only, after construction is completed.
- Design estimates assume that the storm drain is not submerged during zero flows. For submerged applications, please contact your local Stormceptor representative.
- Design estimates may be modified for specific spills controls. Please contact your local Stormceptor representative for further assistance.
- For pricing inquiries or assistance, please contact Hanson Pipe & Precast, 1-888-888-3222.



STORM STORAGE QUANTITY REQUIREMENTS 100-Year Post to Original 5-year Post Development Parcel 3 City of Pickering 25/02/2010

Project:

ORC Altona Road Lands

Project Number: 08 168

Storm Intensity Curve:

	I ₅ =	2464	I ₁₀₀ =	1770
		T ^{0.714}		T ^{0.686}
Where:				
	A =	2464	A =	1770
	B =	16	B =	4
	C =	1	C =	0.82
	-	1	C =	0.82

From City of Pickering Design Criteria

As originally designed

Total Site Area = 0.427 ha Runoff Coefficient = 0.46 Time of Concentration = 10 min 5-year Intensity = 94.8 mm/hr Allowable flow = 0.052 m³/s

Proposed Conditions

Total Site Area = Runoff Coefficient = 0.427 0.90 ha

ENTRY TIME:

5.0 min

TIME STEP 1.0 min

TIME	INTENSITY (mm/hr)	PEAK DISCHARGE (m³/s)	RUNOFF VOLUME (m³)	RELEASE VOLUME (m³)	STORAGE VOLUME (m³)
5.0	292.1	0.312	93.5	15.5	78.0
6.0	267.9	0.286	103.0	18.6	84.3
7.0	247.8	0.265	111.1	21.7	89.4
8.0	230.7	0.246	118.2	24.8	93.4
9.0	216.0	0.231	124.5	27.9	96.6
10.0	203.3	0.217	130.2	31.0	99.2
11.0	192.1	0.205	135.4	34.1	101.2
12.0	182.2	0.195	140.1	37.2	102.8
13.0	173.4	0.185	144.4	40.3	104.0
14.0	165.4	0.177	148.4	43.4	104.9
15.0	158.3	0.169	152.1	46.5	105.5
16.0	151.7	0.162	155.5	49.6	105.9
17.0	145.8	0.156	158.8	52.7	106.0
18.0	140.3	0.150	161.8	55.8	106.0
19.0	135.3	0.144	164.7	59.0	105.7
20.0	130.7	0.140	167.4	62.1	105.4
21.0	126.4	0.135	170.0	65.2	104.8
22.0	122.4	0.131	172.5	68.3	104.2
23.0	118.6	0.127	174.8	71.4	103.4
24.0	115.2	0.123	177.0	74.5	102.6
25.0	111.9	0.119	179.2	77.6	101.6

THEREFORE THE MAXIMUM VOLUME REQUIRED = TIME DURATION REQUIRED TO OBTAIN MAXIMUM STORAGE =

 m^3 106 min



08 168 Parcel 7 STC sizing

Proposed conditions

	Area (ha)	Runoff Coefficient	Percent Impervious
	0.30	0.45	36%
	1.32	0.45	36%
Total	1.62	0.45	36%

STORM STORAGE QUANTITY REQUIREMENTS 5-year post development to 5-year Pre Development Parcel 7 City of Pickering 25/02/2010

ORC Altona Road Lands

Project Number: 08 168

Storm Intensity Curve:

Where:

2464 B = 16 Ç= 1

From City of Pickering Design Criteria

As originally designed (existing)

Total Site Area =

1.620

0.25

Runoff Coefficient = Time of Concentration =

10

min mm/hr

ha

5-year Intensity =

94.8

Allowable flow =

0.107

m³/s

ha

Proposed Conditions

Total Site Area = Runoff Coefficient =

1.620 0.45

ENTRY TIME: TIME STEP

5.0 min 1.0 min

TIME	INTENSITY (mm/hr)	PEAK DISCHARGE (m³/s)	RUNOFF VOLUME (m³)	RELEASE VOLUME (m³)	STORAGE VOLUME (m³)
5.0	117.3	0.238	71.3	32.0	39.3
6.0	112.0	0.227	81.7	38.4	43.3
7.0	107.1	0.217	91.1	44.8	46.3
8.0	102.7	0.208	99.8	51.2	48.6
9.0	98.6	0.200	107.8	57.6	50.2
10.0	94.8	0.192	115.2	64.0	51.2
11.0	91.3	0.185	122.0	70.4	51.6
12.0	88.0	0.178	128.3	76.8	51.5
13.0	85.0	0.172	134.2	83.2	51.0
14.0	82.1	0.166	139.7	89.6	50.2
15.0	79.5	0.161	144.9	96.0	48.9
16.0	77.0	0.156	149.7	102.4	47.3
17.0	74.7	0.151	154.2	108.8	45.5
18.0	72.5	0.147	158.5	115.2	43.4
19.0	70.4	0.143	162.5	121.6	41.0
20.0	68.4	0.139	166.3	127.9	38.4
21.0	66.6	0.135	169.9	134.3	35.6
22.0	64.8	0.131	173.3	140.7	32.6
23.0	63.2	0.128	176.6	147.1	29.4
24.0	61.6	0.125	179.6	153.5	26.1
25.0	60.1	0.122	182.6	159.9	22.6

THEREFORE THE MAXIMUM VOLUME REQUIRED = TIME DURATION REQUIRED TO OBTAIN MAXIMUM STORAGE =

 $\,m^3$ min





Stormceptor Design Summary

PCSWMM for Stormceptor

Project Information

•	
Date	23/02/2010
Project Name	ORC Altona Road Lands - Parcel
	7
Project Number	08 168
Location	City of Pickering

Designer Information

Liomnany	Sabourin Kimble & Associates Ltd.
Contact	Stephen Ruddy

Notes

1		
N/A		
IN/A		
i		

Drainage Area

Total Area (ha)	1.62
Imperviousness (%)	36

The Stormceptor System model STC 1000 achieves the water quality objective removing 80% TSS for a Fine (organics, silts and sand) particle size distribution.

Rainfall

Name	TORONTO CENTRAL
State	ON
ID	100
Years of Records	1982 to 1999
Latitude	45°30'N
Longitude	90°30'W

Water Quality Objective

TSS Removal (%)	80

Upstream Storage

Storage	Discharge
(ha-m)	(L/s)
0.000	00.000
0.002	41.000
0.004	72.000
0.005	107.000

Stormceptor Sizing Summary

Stormceptor Model	TSS Removal
	%
STC 300	70
STC 750	79
STC 1000	80
STC 1500	80
STC 2000	84
STC 3000	85
STC 4000	88
STC 5000	88
STC 6000	90
STC 9000	93
STC 10000	93
STC 14000	94





Particle Size Distribution

Removing silt particles from runoff ensures that the majority of the pollutants, such as hydrocarbons and heavy metals that adhere to fine particles, are not discharged into our natural water courses. The table below lists the particle size distribution used to define the annual TSS removal.

	Fine (organics, silts and sand)							
Particle Size	Distribution	Specific Gravity	Settling Velocity		Particle Size	Distribution	Specific Gravity	Settling Velocity
μm	%	· · · · · · · · · · · · · · · · · · ·	m/s		μm	%		m/s
20 60 150 400 2000	20 20 20 20 20 20	1.3 1.8 2.2 2.65 2.65	0.0004 0.0016 0.0108 0.0647 0.2870					

Stormceptor Design Notes


- Stormceptor performance estimates are based on simulations using PCSWMM for Stormceptor version 1.0
- Design estimates listed are only representative of specific project requirements based on total suspended solids (TSS) removal.
- Only the STC 300 is adaptable to function with a catch basin inlet and/or inline pipes.
- Only the Stormceptor models STC 750 to STC 6000 may accommodate multiple inlet pipes.
- Inlet and outlet invert elevation differences are as follows:


Inlet and Outlet Pipe Invert Elevations Differences


Inlet Pipe Configuration	STC 300	STC 750 to STC 6000	STC 9000 to STC 14000
Single inlet pipe	75 mm	25 mm	75 mm
Multiple inlet pipes	75 mm	75 mm	Only one inlet pipe.


- Design estimates are based on stable site conditions only, after construction is completed.
- Design estimates assume that the storm drain is not submerged during zero flows. For submerged applications, please contact your local Stormceptor representative.
- Design estimates may be modified for specific spills controls. Please contact your local Stormceptor representative for further assistance.
- For pricing inquiries or assistance, please contact Hanson Pipe & Precast, 1-888-888-3222.




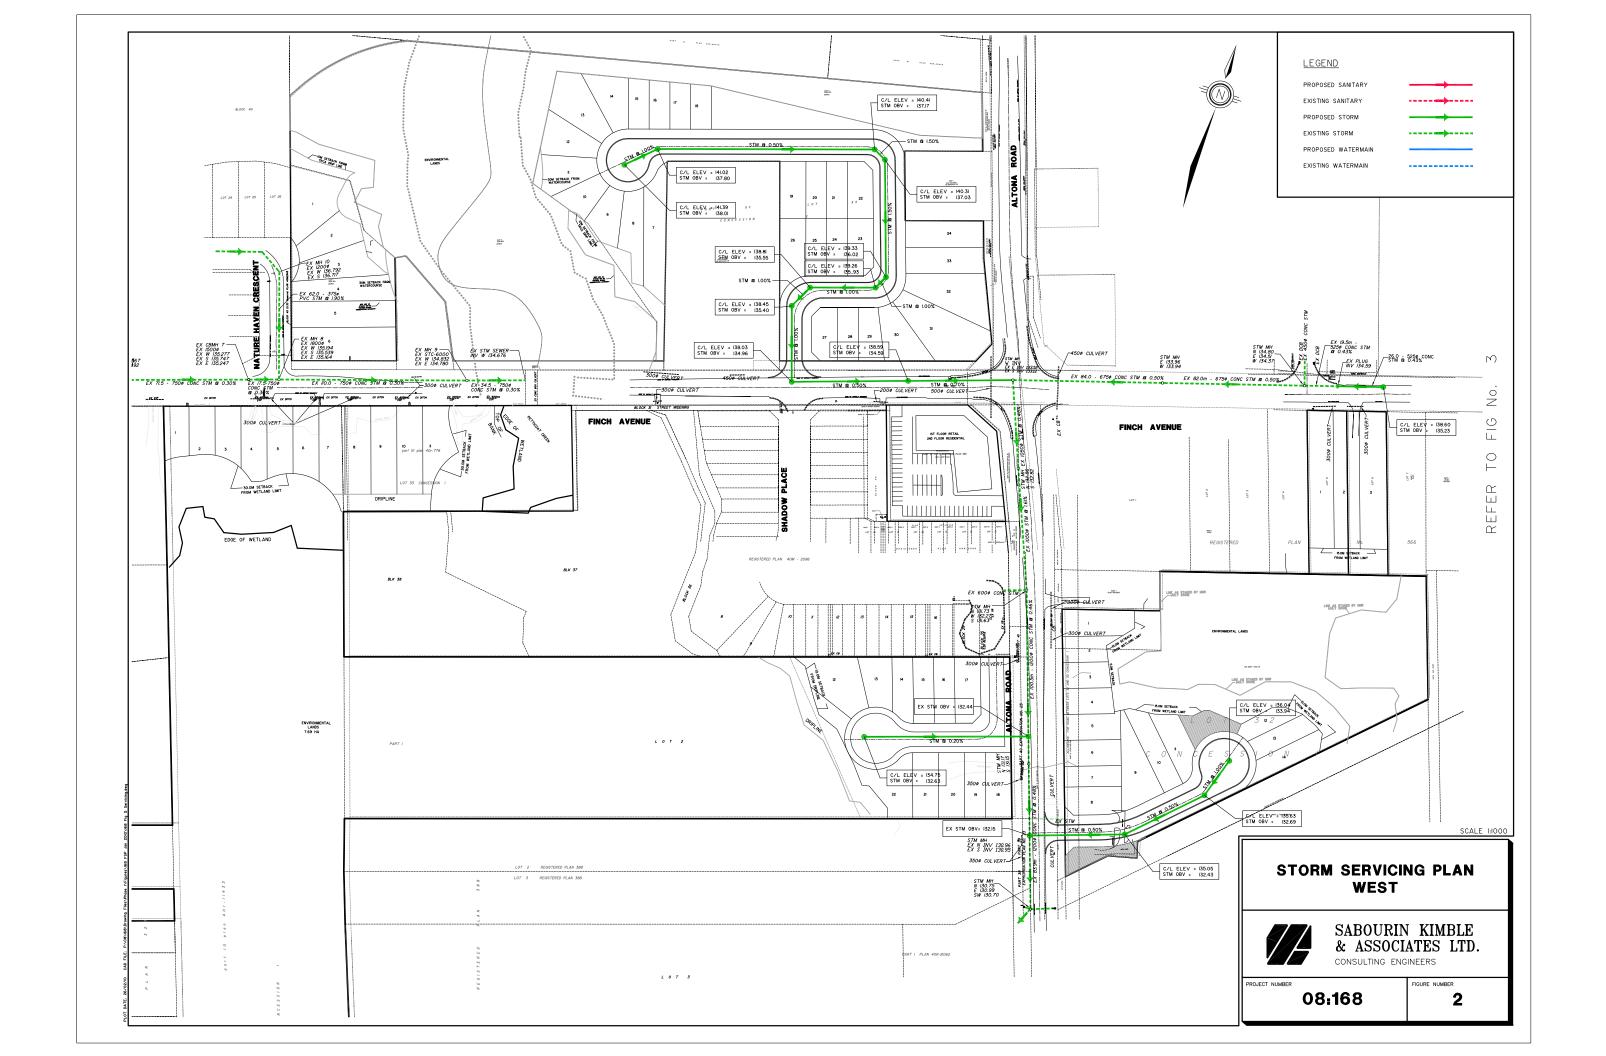

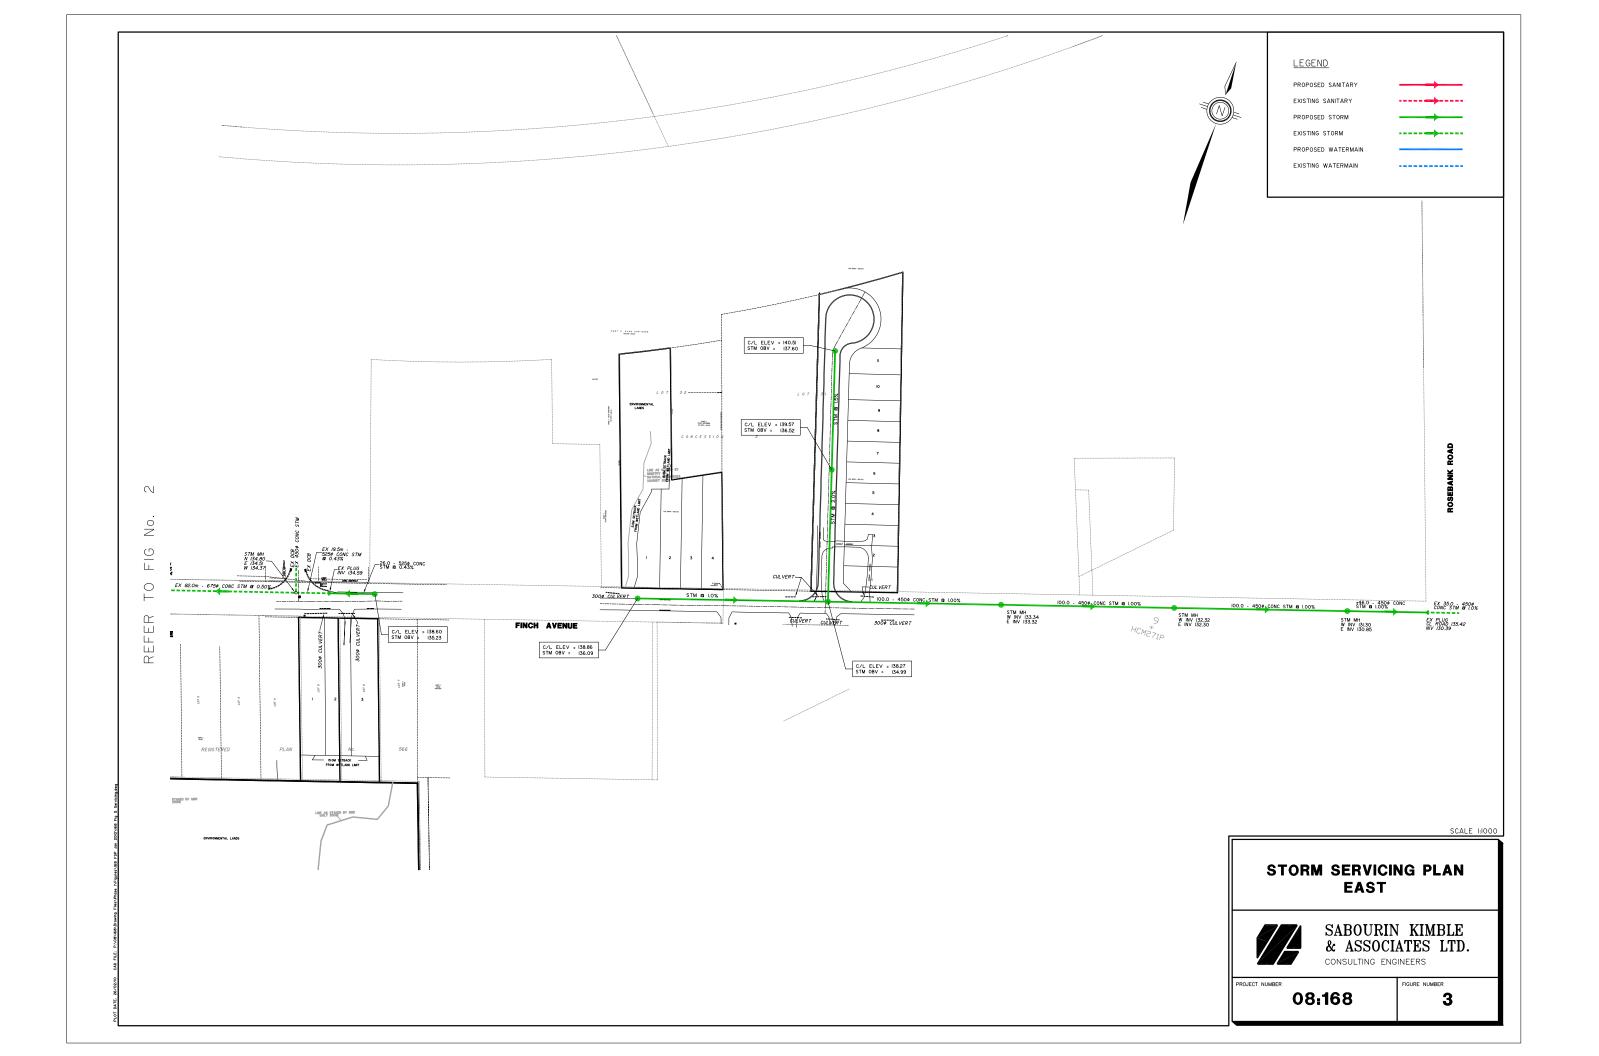

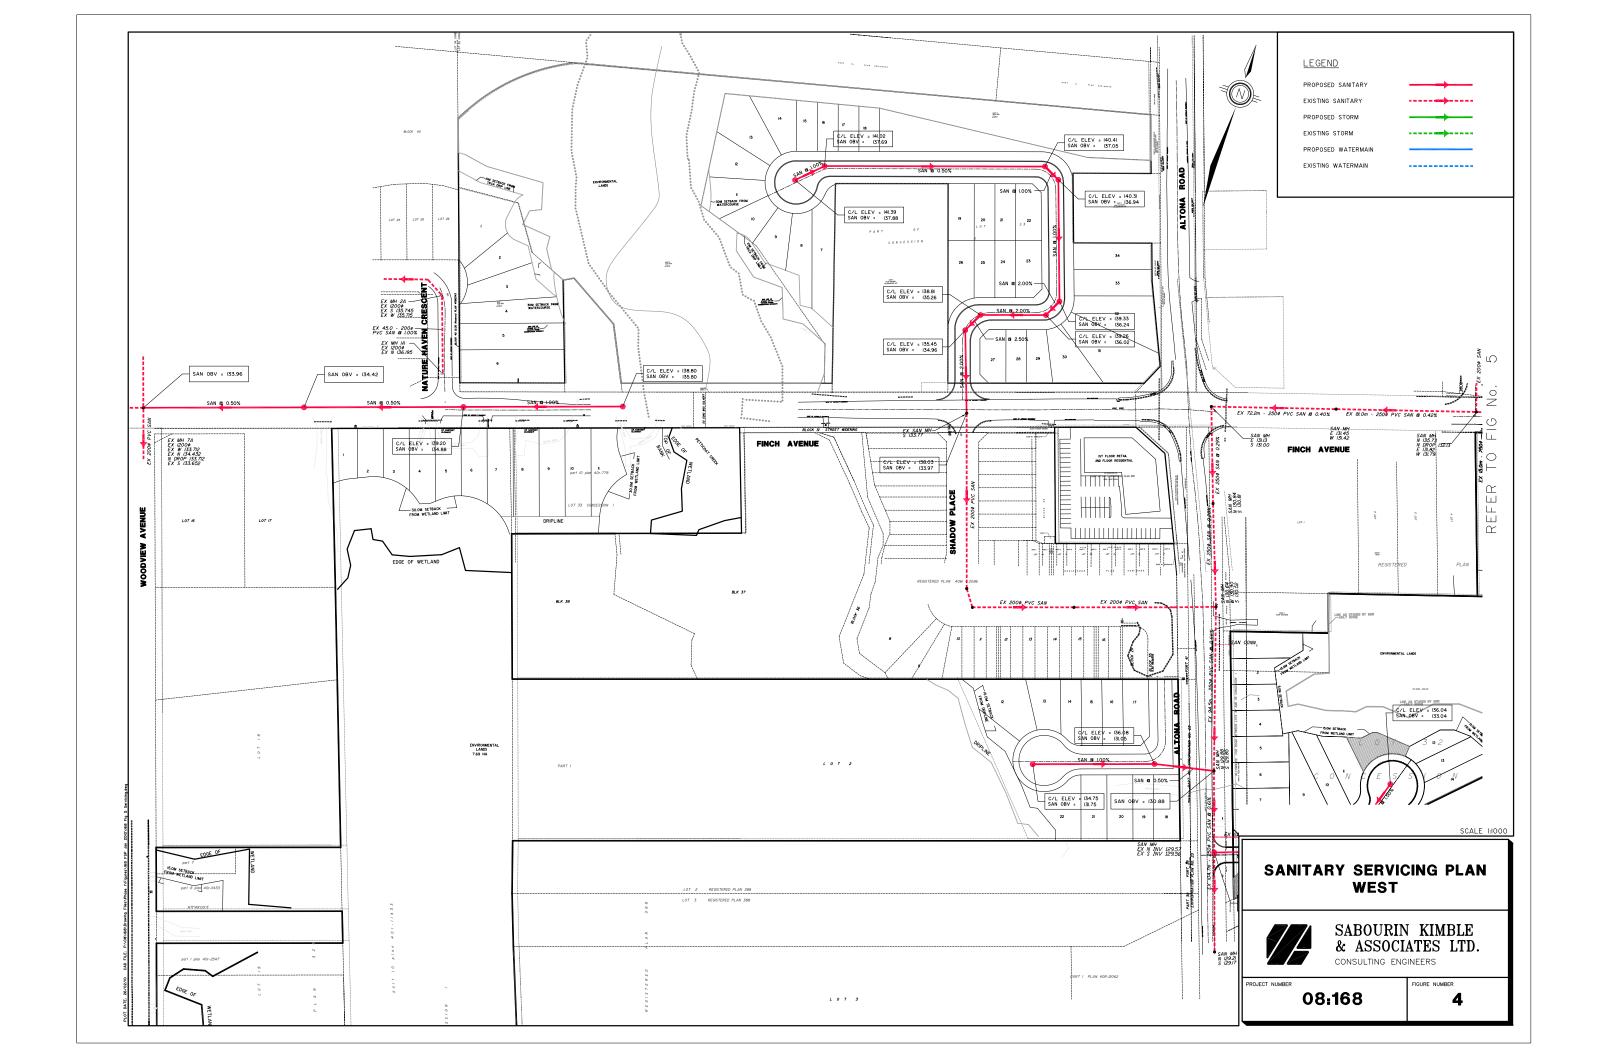

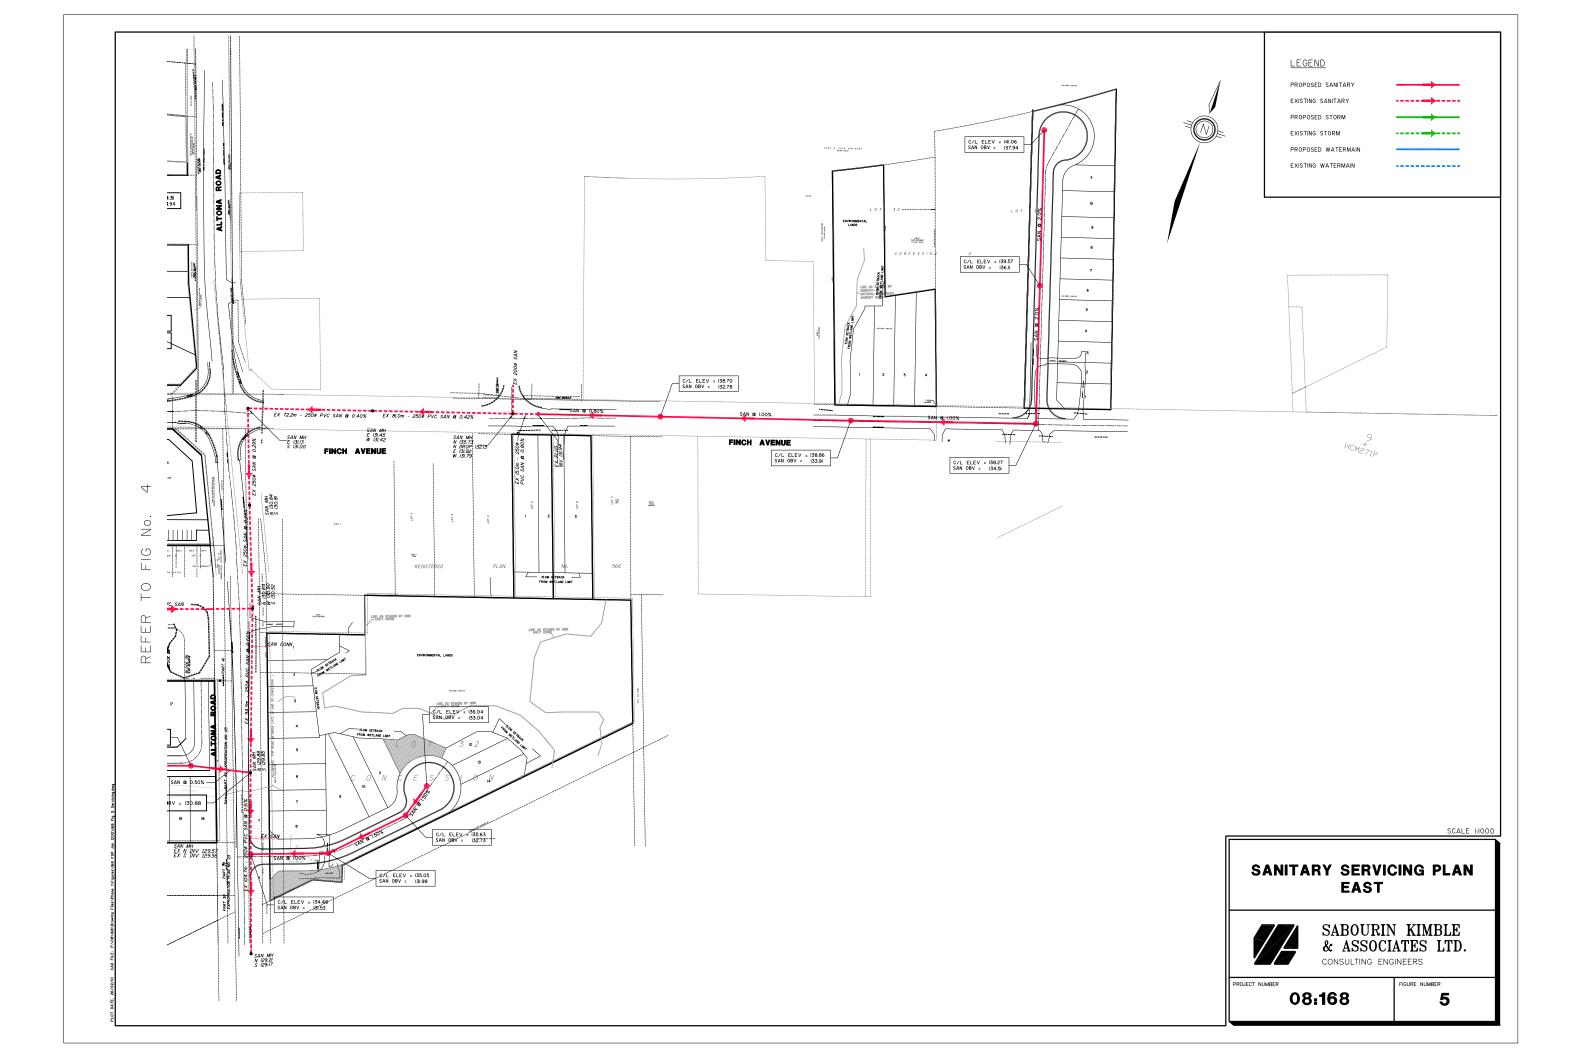

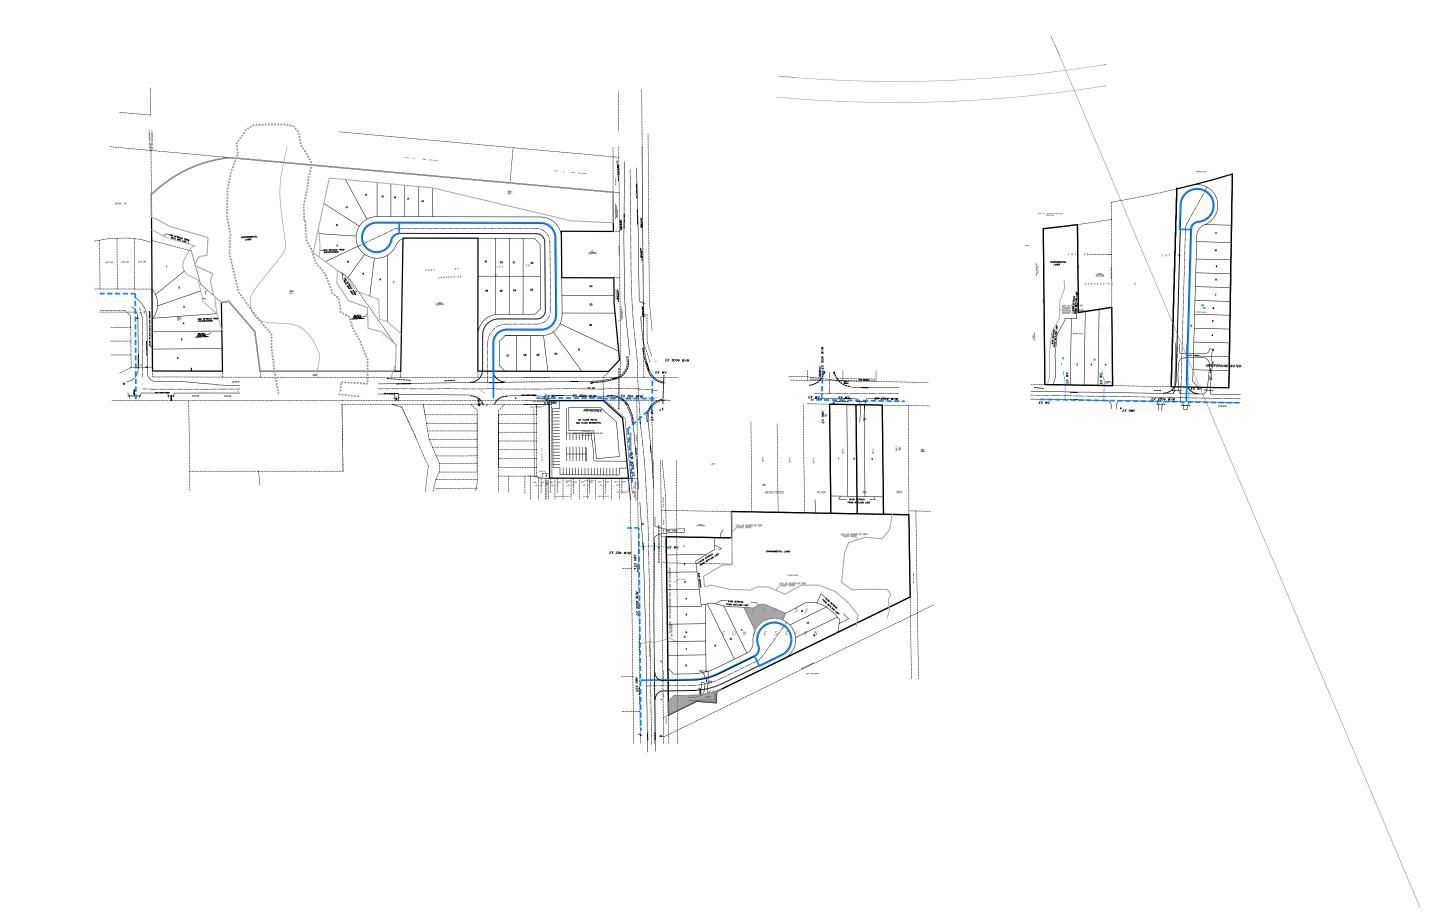

APPENDIX "J"

Functional Grading & Servicing Plans



