
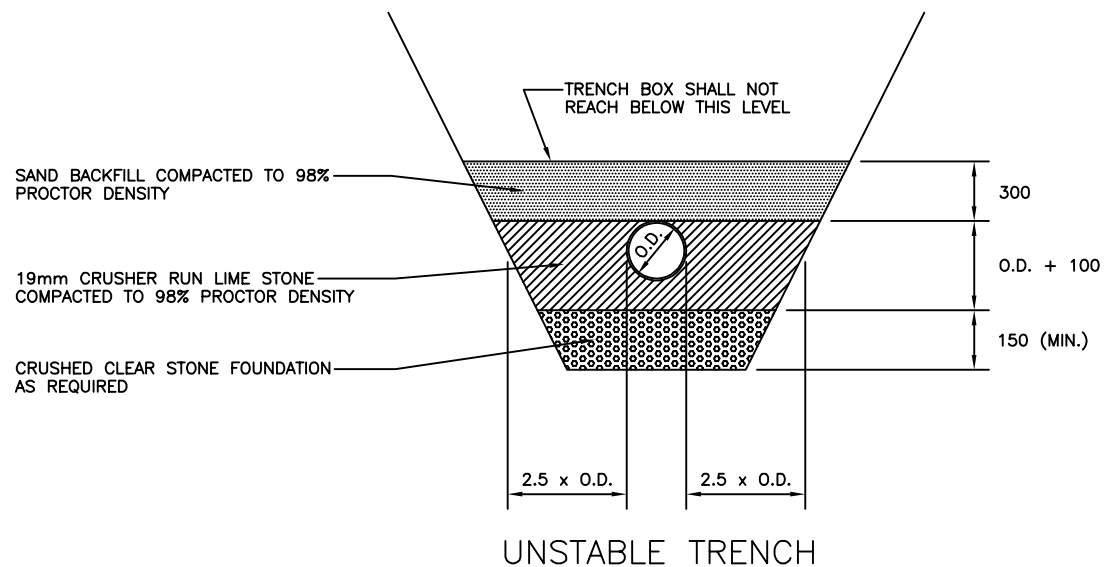


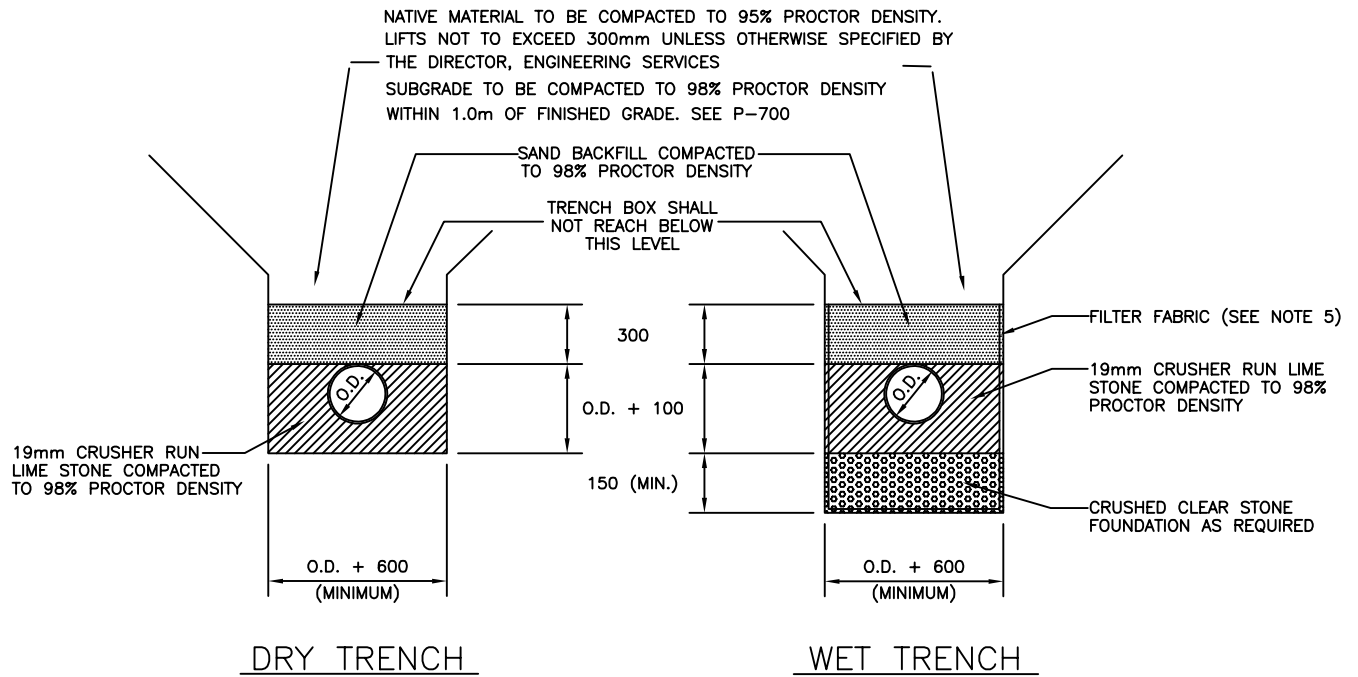

NOTES :

1. BEDDING MATERIALS SHALL BE FULLY EXTENDED AND COMPACTED AGAINST TRENCH WALLS. BEDDING MATERIALS SHALL BE PLACED IN 150mm LAYERS.
2. NO MECHANICAL COMPACTION EQUIPMENT SHALL BE USED ON TOP OF THE PIPE PRIOR TO PLACING A MINIMUM COVER OF 300mm.
3. THE PIPE SHALL BE BEDDED TO PROPOSED LINE AND GRADE WITH UNIFORM AND CONTINUOUS SUPPORT FROM THE BEDDING. BLOCKING WITH ANY HARD OBJECT SHALL NOT USED TO BRING THE PIPE TO GRADE.
4. CONCRETE SHALL NOT BE USED IN THE EMBEDMENT ZONE.
5. FILTER FABRIC SHALL BE USED IF THE GROUND WATER TABLE IS ABOVE THE TRENCH BED OR IF GROUND WATER IS FLOWING INTO THE TRENCH THROUGH THE EMBEDMENT ZONE.

All dimensions are in millimetres unless otherwise noted.

City of Pickering		Engineering Services Department	
DRAWN	P. NEUMAN	TYPE "P" BEDDING FOR P.V.C. & H.D.P.E. PIPE	REVISION NO. 3
APPROVED	S. A. VOKES		DATE NOVEMBER 2019
DATE	JANUARY 1993		P-401